


Mounting to Concrete or Stand

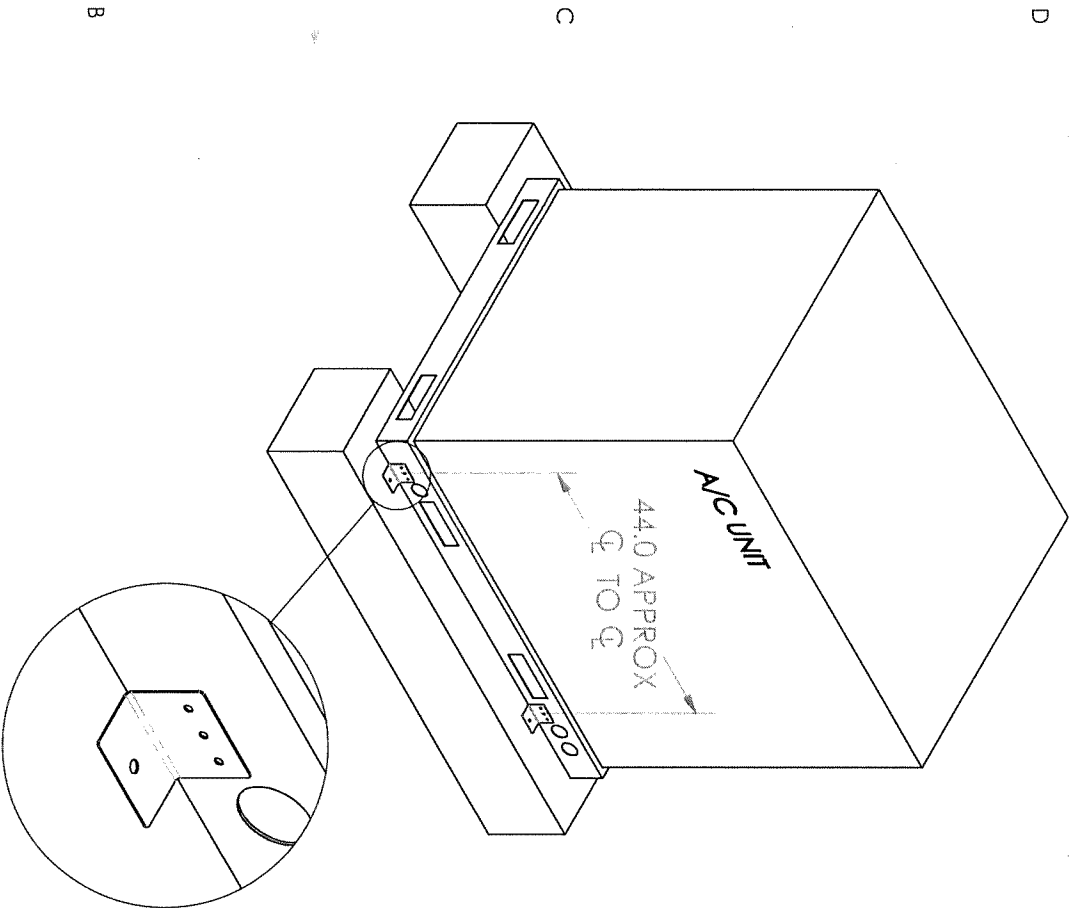

DETAIL A
SCALE 1 : 5
QTY. 2 - 1/4" SD SM
SCREWS AND WASHERS
PER BRACKET, (4) BRACKETS

QTY. 1 - 3/8" SAE GR5 bolt, nut and washer
per bracket into properly designed Metal
Stand (by others)
or
QTY. 1 - 3/8" Powers Wedge-Bolt+ anchor
per bracket into minimum 2000psi concrete
(by others), as follows:
2-1/8" min embed
2-3/4" edge distance
2-1/2" min spacing

BRYANT Chassis 3 & 4:

Models: 569J--D size 12 (min) through 14 (max)
569J--A AND 575J size 07 (min) through 14 (max)




Each condenser unit listed above conforms to the Florida Building Code 5th Edition
(2014) requirements for installation including High Velocity Hurricane Zone (HVHZ), Risk
Category III/IV (V =186 MPH), exposure category "D", and installation height up to and
including 65 feet above grade.

Worst Case is -14 (Chassis 4) 59- 5/8" x 45-7/8" x 50-3/8"

ALLOWABLE DESIGN PRESSURES FOR THE UNIT ITSELF:

Design Lateral Pressure = 197.2 psf
Design Uplift Pressure = 95.4 psf

Unit itself will withstand wind loads imposed by 197.2 psf lateral and 95.4 psf uplift
design pressures, provided the 16 GA. galvanized base rails are fastened to a properly
designed concrete slab, metal stand, curb, curb adapter, or other suitable mounting
arrangement and all factory supplied assembly fasteners are in place.

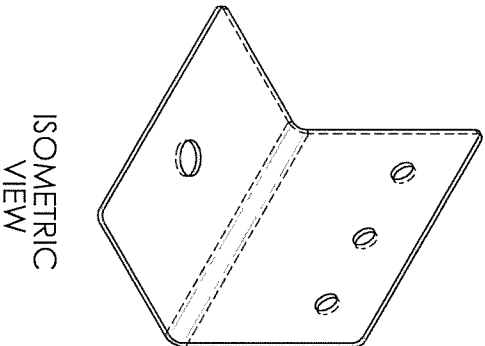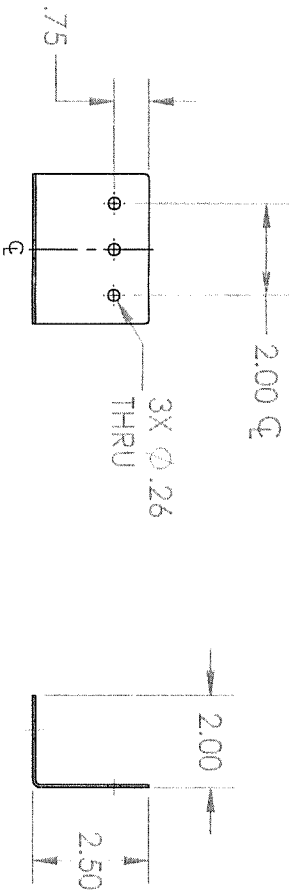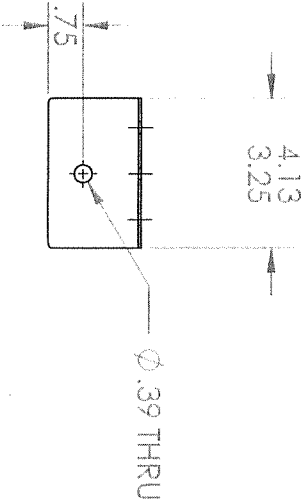

ISOMETRIC
VIEW

MATERIAL: GALVANIZED STEEL OR APPROVED EQUIVALENT
DESCRIPTION: 16 GA., 90 DEG. BRACKET

MAR 29 2016
John D. Buerosse
Florida P.E. 0050867
750 E. Sample Rd.
Bldg. 3, Suite 220
Pompano Beach, FL 33064
954-633-4692

Bryant Condenser Units
Model List and Details

Job No: Chassis 3 & 4
Data: 03-23-16
Created by: CORE

Rational Analysis 3A/4A: Worst case is 10-12.5 TON, Chassis 4 59-5/8" x 45-7/8" x 50-3/8"

Design Pressures complying to FBC Building 1620.6 (HVHZ):

V = 186 mph (Risk Cat. III/IV)

Exposure Category "D"

Z = 65 ft, Kz = 1.33, Kzt = 1.0, Kd = 0.90

Qz = .00256 Kz Kzt Kd V^2 = 106.0 psf

Lateral Wind Pressure = W_L = Qz (3.1) = 328.6 psf

Uplift Wind Pressure = U_L = Qz (1.5) = 159.0 psf

Design Lateral Pressure = W_L (0.6) = 197.2 psf

Design Uplift Pressure = U_L (0.6) = 95.4 psf

Lateral Positive Design Pressure = 121.3 psf (Worst Case Positive)

Lateral Negative Design Pressure = 75.8 psf

Sidewall Negative Design Pressure = 106.2 psf (Worst Case Negative)

22, 20, and 18 GA. panels and columns are fastened together and to 16 GA. base rails, using #10 serrated washer head self-tapping screws having 0.425" head diameter. 0.19" nominal diameter, and 0.14 minor diameter. These screws are expected to exhibit the following properties based upon ICC-ES Report ESR-2196:

Pullout Strength (22 GA.) = 306 lbs (ultimate)

Pullout Strength (20 GA.) = 351 lbs (ultimate)

Pullout Strength (18 GA. min.) = 450 lbs (ultimate)

Shear Strength (22 GA.) = 684 lbs (ultimate based on 22 GA. in-contact)

Shear Strength (20 GA.) = 684 lbs (ultimate based on 22 GA. in-contact)

Shear Strength (18 GA.) = 723 lbs (ultimate based on 22 GA. in-contact)

Shear Strength (16 GA.) = 927 lbs (ultimate based on 18 GA. in-contact)

Components and Cladding:

"Top Cover" (38AU50008):

57.7" x 44.5" draw formed 20 GA. cover, anchored at all corners with (8) cover-post screws, and along the edges with (5) cover-panel screws. The top cover also has (2) 22.4" dia. holes, reducing the total area. The overturning moment across the unit, applied to the corner post screws (2), created the highest load approximation given the uplift pressures applied to the top cover. The individual screw load calculation simplifies to dividing total uplift load by 4.

Total Area = 17.8 - 5.5 = 12.3 sq.ft.

Uplift Load = 12.3 (95.4) = 1177.1 lbs

Screw Load = 1177.1/4 = 294.8 lbs

Safety Factor = 684/294.8 = 2.3x

OK for components and cladding

"Side Panel" (38AU500030):

32.8 " x 45.7" draw formed 22 GA. panel, anchored at edges with (13) screws, as follows:

(4) screws through top panel at top, perpendicular to face

(4) screws along the right vertical edge, perpendicular to face

(4) screws at 7/16 inch above bottom edge through panel into base rail, perpendicular to face

(1) screw through left flange, parallel to face

Area = 10.2 sq.ft.

Load = 10.2 (106.2) = 1078.4 lbs

Screw Load (12 screws, 1 in shear) = 1078.44/12 = 89.9 lbs

Safety Factor = 351/89.9 = 3.9x

OK for components and cladding

"Outdoor Panel" (48TM501190):

45.49" x 11.55" draw formed 22 GA. panel, anchored with (8) screws, as follows:

(1) screws through top panel and into face at the top, perpendicular to face

(2) screws through right vertical edge into post, perpendicular to face

(4) screws along the left vertical edge of flange

(1) screw 7/16 inch above bottom edge through panel into base rail

Area = 3.7 sq.ft.

Load = 3.7 (106.2) = 387.4 lbs

Screw Load = 387.4/8 = 48.4 lbs

Safety Factor = 351/48.4 = 7.2x

OK for components and cladding

Components and Cladding (continued):

"Access Panel" (38AU500061):

42.60" x 45.00" draw formed 22 GA. panel, trapped inside "Top Cover" (38AU50008), anchored by (2) screws along each vertical edge, perpendicular to face; and (3) screws at 7/16 inch above bottom edge through panel into base rail, perpendicular to face; of which, (5) screws subtending the lower half of the panel and will be used in the load calculation:

Area = 13.3 sq.ft.

Load = 13.3 (106.2)/2 = 706.8 lbs

Screw Load = 706.8/5 = 141.4 lbs

Safety Factor = 306/141.4 = 2.2x

OK for components and cladding

Connection of upper frame and panels to base rails:

Total overturning moment applied across the width of the rails, to the (8) rail-panel screw shear capacity, 22 GA. (min) cladding into 16 GA. base rails, is the chosen load approximation to maximize design calculation variables for increased safety factor – (8) rail-post screw capacity neglected.

Connection of 22 GA. Panels to 16 GA. rails around perimeter:

Screw Load = (79,875 + 37,783)/(8)(44.5) = 331.0 lbs (shear)

Safety Factor = 927/331.0 = 2.8x

OK for components and cladding

Unit itself will withstand wind loads imposed by 197.2 psf lateral and 95.4 psf uplift design pressures, provided the 16 GA. galvanized base rails are fastened to a properly designed concrete slab, metal stand, curb, curb adapter, or other suitable mounting arrangement with all factory supplied assembly fasteners at the proper torque.

Connection of unit base rails to properly designed Metal Stand or Concrete:

Metal Stand or Concrete Connection:

Using (2) brackets, 2-1/2" x 2" x 3-1/4 - 4-1/8" wide, 16 GA. (min), spaced 44" (min) on-center into base rails,

Using (1) 3/8" SAE GR5 bolt per bracket, (2) brackets each long side:

Screw Load = (103,595 + 29,332)/(3)(2)(45.88) = 482.9 lbs (shear)

Safety Factor = 1389/482.9 = 2.9x

OK for components and cladding

Screw Load = 4113/12 = 342.7 lbs (tension)

Safety Factor = 573/342.7 = 1.7x

OK for components and cladding

Metal Stand Fasteners:

Using (2) brackets, 2-1/2" x 2" x 3-1/4 - 4-1/8" wide, 16 GA. (min), spaced 44" (min) on-center into base rails,

Using (1) 3/8" SAE GR5 bolt per bracket, (2) brackets each long side:

Bolt Load = (103,800 + 29,332)/(1)(2)(45.88) = 1448.7 lbs (tension)

Bolt Load = 4113/4 = 1028.2 lbs (shear)

Safety Factor = 3720/1448.7 = 2.6x (tension)

OK

Safety Factor = 1937/1028.2 = 1.9x (shear)

OK

Concrete Fasteners:

Using (2) brackets, 2-1/2" x 2" x 3-1/4" wide, 16 GA. (min), spaced 44" (min) on-center into base rails,

Using 2000 psi (min) concrete, 4" (min) thick (by others),

Using (1) 3/8" Powers Wedge-Bolt+ anchor per bracket, (4) brackets each long side:

Anchor Load = (103,800 + 29,332)/(1)(4)(45.88) = 1448.7 lbs (tension)


Anchor Load = 4113/4 = 1028.2 lbs (shear)

Safety Factor = 3000/1448.7 = 2.1x (tension)

OK

Safety Factor = 3100/1028.2 = 3.0x (shear)

OK

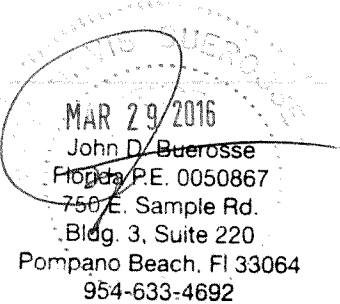


Bryant Condenser Units Model List and Details

Chassis 3 & 4

1-08-16

CORE

Mounting to Concrete or Stand

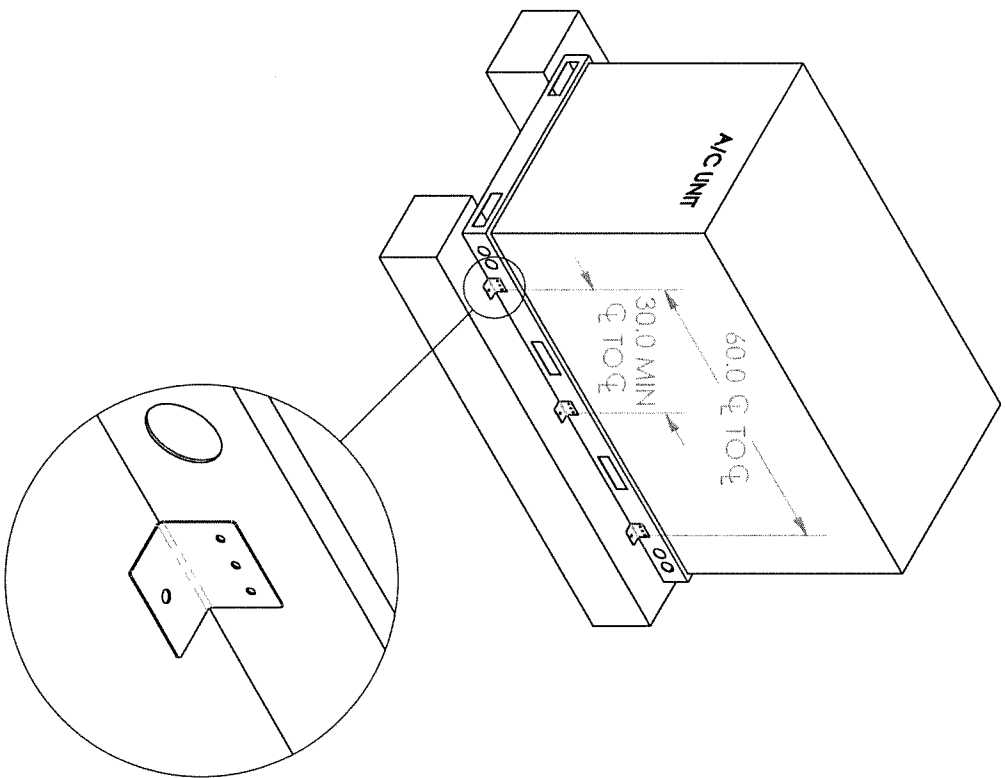

DETAIL A
SCALE 1 : 5

QTY. 3 - 1/4" SDSM
SCREWS AND WASHERS
PER BRACKET, (6) BRACKETS

QTY. 1 - 3/8" SAE GR5 bolts, nut and washer
per bracket into properly designed Metal
Stand (by others)
or
QTY. 1 - 3/8" Powers Wedge-Bolt+ anchor
per bracket into minimum 2000psi concrete
(by others), as follows:
2-1/8" min embed
2-3/4" edge distance
2-1/2" min spacing

BRYANT Chassis 6A:

Models: 569J--D, 569J--A AND 575J size 16

Each condenser unit listed above conforms to the Florida Building Code 5th Edition (2014) requirements for installation including High Velocity Hurricane Zone (HVHZ), Risk Category III/IV (V = 186 MPH), exposure category "D", and installation height up to and including 65 feet above grade.


Worst Case is -16 (Chassis 6) 85" x 43.4" x 45"

ALLOWABLE DESIGN PRESSURES FOR THE UNIT ITSELF:

Design Lateral Pressure = 197.2 psf

Design Uplift Pressure = 95.4 psf

Unit itself will withstand wind loads imposed by 197.2 psf lateral and 95.4 psf uplift design pressures provided the 16 GA. galvanized base rails are fastened to a properly designed concrete slab, metal stand, curb, curb adapter, or other suitable mounting arrangement and all factory supplied assembly fasteners are in place.

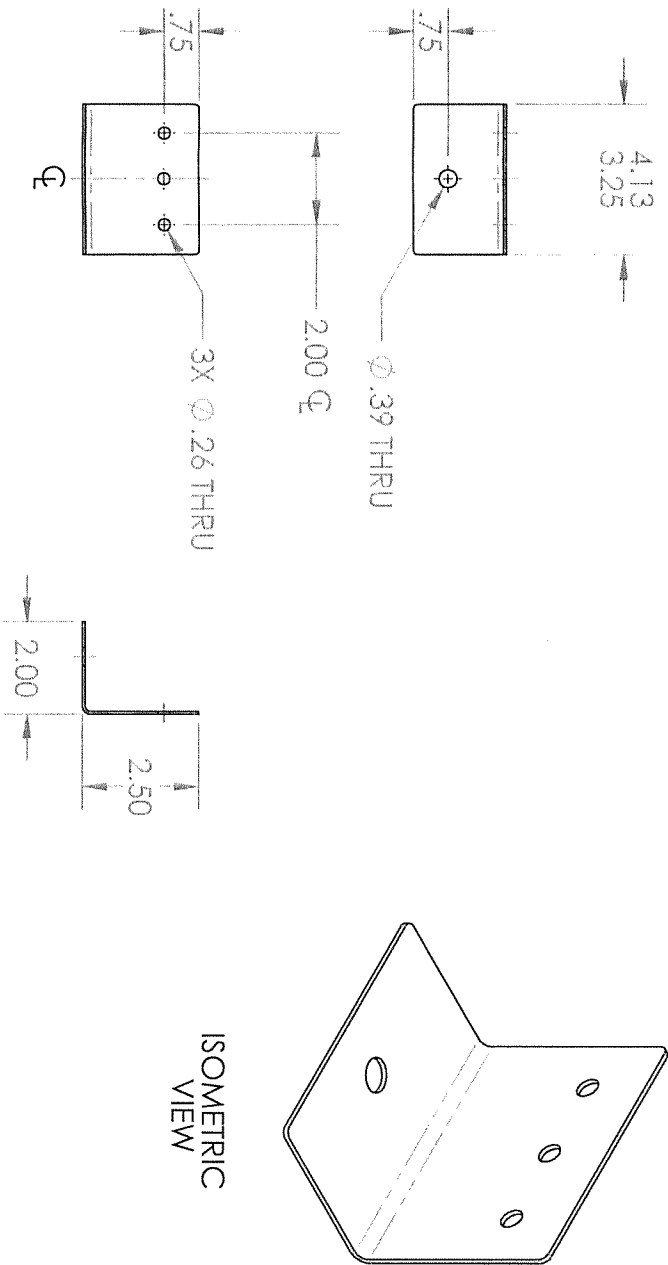

MATERIAL: GALVANIZED STEEL OR APPROVED EQUIVALENT
DESCRIPTION: 16 GA., 90 DEG. BRACKET

MAR 29 2016
John D. Buerosse
Florida PE 0050867
750/E. Sample Rd.
Bldg. 3, Suite 220
Pompano Beach, FL 33064
954-633-4692

Job No: Chassis 6A
Data: 03-23-16
Created by: CORE

Job No:
Bryant Condenser Units
Title:
Model List and Details

Rational Analysis: 15 TON Chassis 6A
86-3/8" x 45-1/8" x 50-3/8"

D
Design Pressures complying to FBC Building 1620.6 (HVHZ):
V = 186 mph (Risk Cat. III/IV)
Exposure Category "D"
Z = 65 ft. Kz = 1.33, Kzt = 1.0, Kd = 0.90
Qz = .00256 Kz Kzt Kd V^2 = 106.0 psf

Lateral Wind Pressure = Wl = Qz (3.1) = 328.6 psf
Uplift Wind Pressure = Ul = Qz (1.5) = 159.0 psf
Design Lateral Pressure = WL(0.6) = 197.2 psf
Design Uplift Pressure = UL (0.6) = 95.4 psf

Lateral Positive Design Pressure = 197.2 (0.8) / (0.8 + 0.5) = 121.3 psf (Worst Case Positive)
Lateral Negative Design Pressure = 197.2 (0.5) / (0.8 + 0.5) = 75.8 psf
Sidewall Negative Design Pressure = 197.2 (0.7) / (0.8 + 0.5) = 106.2 psf (Worst Case Negative)

22 GA. posts, 20 panels, the 18 GA. cover, and 16 GA. base rails are fastened together, using #10-12 serrated washer, self-tapping screws having 0.425" head diameter, 0.19" nominal diameter, and 0.14 minor diameter. These screws are expected to exhibit the following properties based upon ICC-ES Report ESR-2196:

- Pullout Strength (22 GA.) = 306 lbs (ultimate)
- Pullout Strength (20 GA.) = 351 lbs (ultimate)
- Pullout Strength (18 GA. min.) = 450 lbs (ultimate)
- Shear Strength (22 GA.) = 684 lbs (ultimate based on 22 GA. in-contact)
- Shear Strength (20 GA.) = 684 lbs (ultimate based on 22 GA. in-contact)
- Shear Strength (18 GA.) = 723 lbs (ultimate based on 22 GA. in-contact)
- Shear Strength (16 GA.) = 927 lbs (ultimate based on 18 GA. in-contact)

Components and Cladding:

"Top Cover" (38AU500072):
85" x 43.4" draw formed 18 GA. cover, with (3) large holes, anchored with (15) screws:
(8) cover-post screws at all corners by 22 GA. posts
(7) cover-panel screws along (3) edges by 20 GA. panels
The overturning moment across the unit, applied to the corner post screws (2), created the highest load approximation given the uplift pressures and number of screws applied to the top cover. The individual screw load calculation simplifies to dividing the total uplift load by 4.

B
Total Area = 25.6 sq.ft. - 8.3 sq.ft. = 17.3 sq.ft.
Uplift Load = 17.3 (95.4) = 1653.9 lbs
Screw Load = 1653.9/4 = 413.5 lbs
Safety Factor = 723/413.5 = 1.7x

OK for components and cladding

"Center Post" (38AU500075):
3.2" x 45.4" draw formed 20 GA. panel anchored at edges with (11) screws, as follows:

- (2) screws through top cover into top cover, perpendicular to face
- (1) screws through left vertical edge through flange, perpendicular to face
- (2) screws through right vertical edge through flange, perpendicular to face
- (2) screws at 7/16 inch above bottom edge through panel into base rail

Area = 1.01 sq.ft.
Load = 1.01 (106.2) = 107.1 lbs
Screw Load = 107.1/7 = 15.3 lbs
Safety Factor = 351/15.3 = 23.0x

OK for components and cladding

A
"Access Panel" (50HE500376):
4.5" x 43.1" draw formed 20 GA. panel anchored at edges with (4) screws, as follows:

- (2) screws through top panel and into face at the top
 - (2) screws at .35 inch above bottom edge through panel into base rail
- Area = 1.3 sq.ft.
Load = 1.3 (106.2) = 143.0 lbs
Screw Load = 143.0/4 = 35.8 lbs
Safety Factor = 351/35.8 = 9.8x

OK for components and cladding

"Front Panel" (38AU500078):

43.2" x 45.1" draw formed 20 GA. panel, anchored at edges with (7) screws, as follows:
(2) screws through each vertical edge through flanges, perpendicular to face
(3) screws at 7/16 inch above bottom edge through panel into base rail
Top edge of "Front Panel" is trapped inside the "Top Cover" (38AU500072), the bottom subtends the lower half of the panel, and the failure criterion along the bottom edge yields (5) screws for load consideration.

Half Area = 6.8 sq.ft.
Load = 6.8 (106.2)/2 = 718.3 lbs
Screw Load = 718.3/4 = 143.7 lbs
Safety Factor = 351/143.7 = 2.4x

OK for components and cladding

The remaining panel (38AU500079) "Outdoor Panel" has less area and greater fastener quantity and openings, limiting negative pressure effects for increased safety factor.

Connection of upper frame and panels to base rails:

The total overturning moment applied across the width of the base rails, to the (10) rail-panel screws shear capacity, 20 GA. (min) cladding into 16 GA. base rails, is the load approximation chosen in order to maximize design calculation variables for increased safety factor - (8) rail-post screw capacity neglected.

Connection of 20 GA. panels to 16 GA. (min) rails around the perimeter:
Screw Load = (208.395 + 58.285)/10(45.1) = 461.8 lbs (shear) per screw
Safety Factor = 1119/(461.8) = 2.4x
OK for components and cladding

Unit itself will withstand wind loads imposed by 197.2 psf lateral and 95.4 psf uplift design pressures provided the 16 GA. galvanized base rails are fastened to a properly designed concrete slab, metal stand, curb, curb adapter, or other suitable mounting arrangement with all factory supplied assembly fasteners at the proper torque.

Connection of unit base rails to properly designed Metal Stand or Concrete:

Metal Stand or Concrete Connection:
Using (3) brackets, 2-1/2" x 2" x 3-1/4 - 4-1/8" wide, 16 GA. (min), spaced 30.0" (min) on-center into base rails.
Using (3) screws per bracket, (3) brackets each long side:
Screw Load = 5959/(18) = 331.1 lbs (tension)
Safety Factor = 573/331.1 = 1.7x (tension)
Screw Load = (150,110 + 46,235)/(3)(3)(45.13) = 483.4 lbs (shear)
Safety Factor = 1389/483.4 = 2.9x (shear)

OK for components and cladding
OK for components and cladding


Metal Stand Fasteners:
Using (3) brackets, 2-1/2" x 2" x 3-1/4 - 4-1/8" wide, 16 GA. (min), spaced 30.0" (min) on-center into base rails:
Using (1) 3/8" SAE GR5 bolt/washer per bracket, (3) brackets each long side:

Bolt Load = (150,110 + 46,235)/(1)(3)(45.13) = 1371.3 lbs (tension)
Bolt Load = 5959/(3)(2) = 993.2 lbs (shear)
Safety Factor = 3720/1371.3 = 2.7x (tension)
Safety Factor = 1937/993.2 = 2.0x (shear)

OK
OK

Concrete Fasteners:
Using 2000psi (min) concrete, 4" (min) thick (by others),
Using (1) 3/8" Powers Wedge-Bolt+ anchors, (3) brackets each long side:
Bolt Load = (150,110 + 46,235)/(1)(3)(45.13) = 1371.3 lbs (tension)
Bolt Load = 5959/(6) = 993.2 lbs (shear)
Safety Factor = 3000/1371.3 = 2.2x (tension)
Safety Factor = 3100/993.2 = 3.1x (shear)


OK
OK

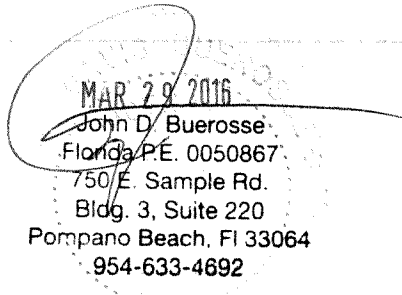

Job No: Bryant Condenser Units
Title: Model List and Details

Job No: Chassis 6A
Data: 03-23-16
Created by: CORE

Mounting to Concrete or Stand

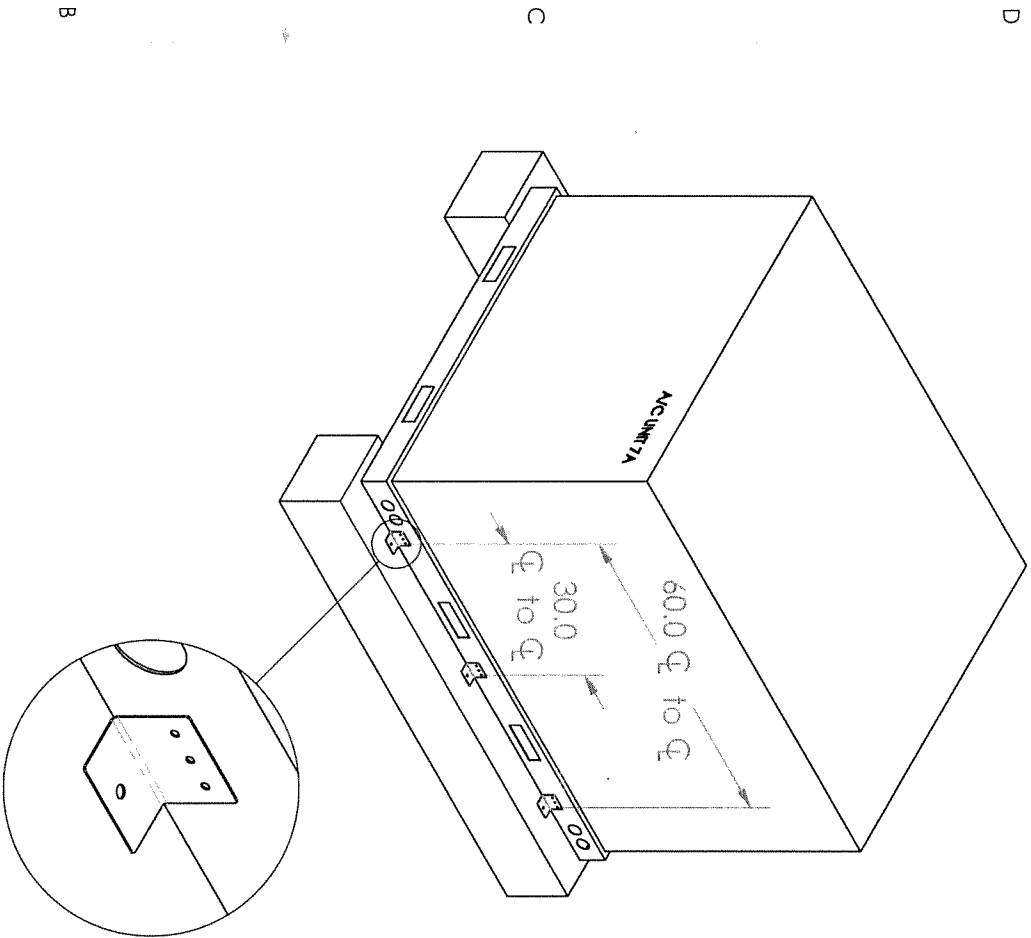

DETAIL A
SCALE 1 : 5

QTY. 4 - 1/4" SDSM
SCREWS AND WASHERS
PER BRACKET, (6) BRACKETS

QTY. 1 - 3/8" SAE GR5 bolt, nut and washer
per bracket into properly designed Metal
Stand (by others)
OR
QTY. 1 - 3/8" Powers Wedge-Bolt+ anchor
per bracket into minimum 2000psi concrete
(by others), as follows:
2-1/8" min embed
2-3/4" edge distance
2-1/2" min spacing

BRYANT Chassis 7A:

Models: 569J--D, 569J--A and 575J size 25

Each condenser unit listed above conforms to the Florida Building Code 5th Edition (2014) requirements for installation including High Velocity Hurricane Zone (HVHZ), Risk Category III/IV (V = 186 MPH), exposure category "D", and installation height up to and including 65 feet above grade.


Worst Case is -25 (Chassis 7) 86-3/8" x 67-1/8" x 50-3/8"

ALLOWABLE DESIGN PRESSURES FOR THE UNIT ITSELF:

Design Lateral Pressure = 197.2 psf

Design Uplift Pressure = 95.4 psf

Unit itself will withstand wind loads imposed by 197.2 psf lateral and 95.4 psf uplift design pressures, provided the 16 GA. galvanized base rails are fastened to a properly designed concrete slab, metal stand, curb, curb adapter, or other suitable mounting arrangement and all factory supplied assembly fasteners are in place.

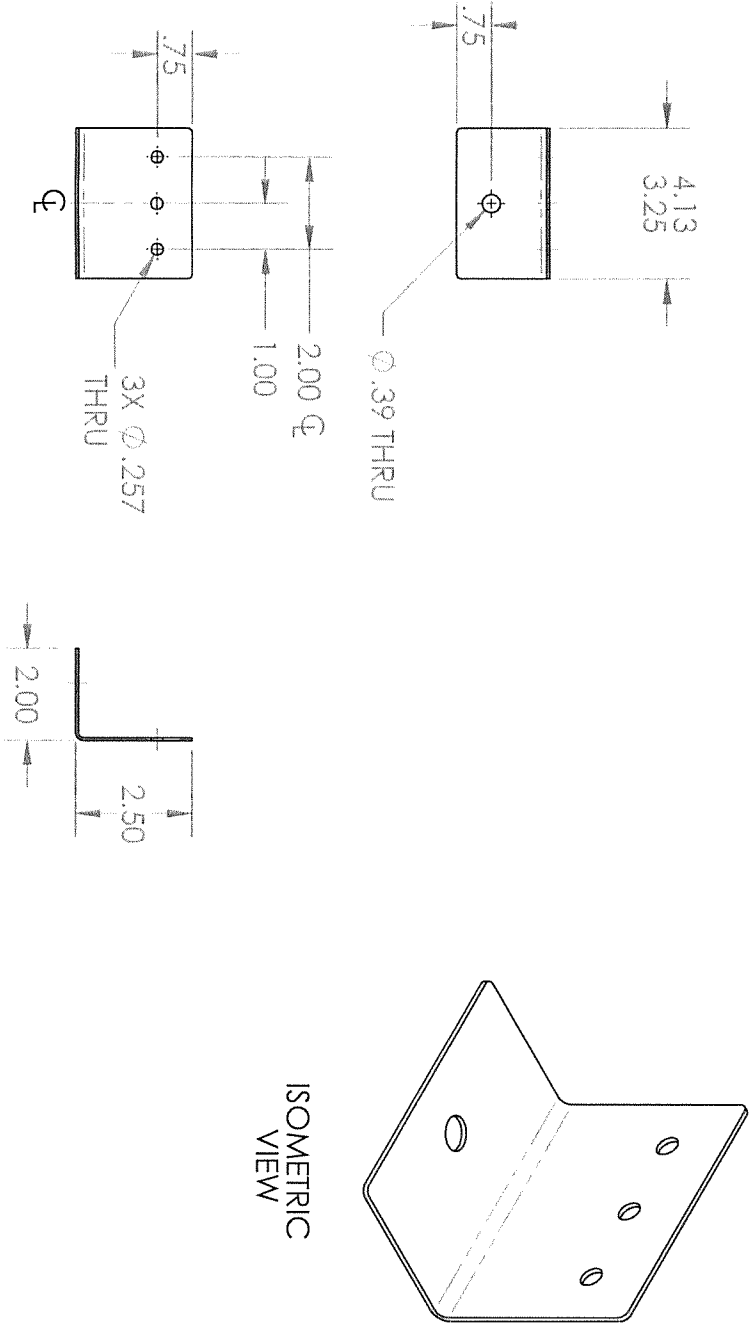

ISOMETRIC
VIEW

MATERIAL: GALVANIZED STEEL OR APPROVED EQUIVALENT
DESCRIPTION: 16 GA., 90 DEG. BRACKET

MAR 29 2016
John D. Buerosse
Florida P.E. 0050867
750 E. Sample Rd.
Bldg. 3, Suite 220
Pompano Beach, FL 33064
954-633-4692

Job No: Chassis 7A
Data: 03-23-16
Created by: CORE

Job No:
Bryant Condenser Units
Title:
Model List and Details

Rational Analysis: 20 TON Chassis 7A - 86-3/8" x 67-1/8" x 50-3/8"

Design Pressures complying to FBC Building 1620.6 (HVHZ): V = 186 mph (Risk Cat. IV), Exposure "D"
Z = 65 ft, Kz = 1.33, Kzt = 1.0, Kd = 0.90
Qz = .00256 Kz Kzt Kd V^2 = 106.0 psf

D Lateral Wind Pressure = Wt = Qz (3.1) = 328.6 psf Design Lateral Pressure = Wt(0.6) = 197.2 psf
Uplift Wind Pressure = Ul = Qz (1.5) = 159.0 psf Design Uplift Pressure = Ul(0.6) = 95.4 psf

Lateral Positive Design Pressure = 197.2 (0.8) / (0.8 + 0.5) = 121.3 psf (Worst Case Positive)
Lateral Negative Design Pressure = 197.2 (0.5) / (0.8 + 0.5) = 75.8 psf
Sidewall Negative Design Pressure = 197.2 (0.7) / (0.8 + 0.5) = 106.2 psf (Worst Case Negative)

22 GA. posts, 20 panels, the 18 GA. cover, and 16 GA. base rails are fastened together using #10-12 serrated washer, self-lapping screws having 0.425" head diameter, 0.19" nominal diameter, and 0.14 minor diameter. These screws are expected to exhibit the following properties based upon ICC-ES Report ESR-2196:

 Pullout Strength (22 GA.) = 306 lbs (ultimate) Shear Strength (22 GA.) = 684 lbs
 Pullout Strength (20 GA.) = 351 lbs (ultimate) Shear Strength (18 GA.) = 723 lbs
 Pullout Strength (18 GA. min.) = 450 lbs (ultimate) Shear Strength (16 GA.) = 927 lbs

Components and Cladding:

C "Top Cover" (50HE500278): 85.0" x 57.4" draw formed 18 GA. cover, with (4) large holes

- (4) cover-post screws at (2) corners by 22 GA. posts
- (10) cover-panel screws along (3) edges by 20 GA. panels
- (6) cover-cover screws along top seam of the unit by a second 18 GA. cover

The overturning moment across the unit, applied to the cover-post screws (4), created the highest load approximation given the uplift design pressure, number of fasteners and (1) edge trapped by adjacent cover connection. The individual screw load calculation simplifies to dividing the total uplift load by 6.
Total Area = 33.9 sq.ft. - 11.0 sq.ft. = 22.8 sq.ft.

Uplift Load = 22.8 (95.4) = 2176.9 lbs

Screw Load = 2176.9/6 = 362.8 lbs

Safety Factor = 723/362.8 = 2.0x OK for Components and Cladding

"Top Cover" (38AU500226): 84.96" x 8.90" draw formed 18 GA. panel, Area = 5.25 sq.ft.

- (8) screws through the inside flange, perpendicular to face
- (6) screws through the outside flange, parallel to face
- (1) screws through left side flange, parallel to face
- (1) screws through right side flange, parallel to face

Load = 5.25 (95.4) = 501.0 lbs

For top cover (15 screws, 6 in tension):

Screw Load = 501.0 (6)/15 = 200.4 lbs (tension)

Safety Factor = 450/200.4 = 2.2x OK for Components and Cladding

Screw Load = 501.0 (9)/15 = 300.6 lbs (shear)

Safety Factor = 927/300.6 = 3.1x OK for Components and Cladding

"Outdoor Panel" (38AU500661): 45.49" x 29.73" draw formed 20 GA. panel, Area = 9.39 sq.ft.

- (3) screws through top panel and into face at the top
- (2) screws through post (trapped) along right vertical edge, perpendicular to face
- (2) screws through left vertical edge of the flange, perpendicular to face
- (3) screws 7/16 inch above bottom edge through panel into base rail.

Load = 9.39 (106.17) = 997.19 lbs

Screw Load = 997.19/10 = 99.72 lbs

Safety Factor = 351/99.72 = 3.5x

OK for Components and Cladding

"Side Panel" (38AU500664): 45.54" x 34.99" draw formed 20 GA. panel, Area = 11.07 sq.ft.

- (4) screws through top panel into face at top
- (2) screws through left vertical edge through flange, parallel to face.
- (2) screws through right vertical edge through flange, perpendicular to face.
- (4) screws at 7/16 inch above bottom edge through panel into base rail.

Load = 11.07 (106.18) = 1174.90 lbs

Screw Load = 1174.90/12 = 97.91 lbs

Safety Factor = 351/97.91 = 3.6x

OK for components and cladding

"Front Panel" (38AU50078): 43.2" x 45.1" draw formed 20 GA. panel, Half Area = 6.8 sq.ft.

- (2) screws through post (trapped) along the vertical edge
 - (2) screws along vertical edge
 - (3) screws 7/16 inch above bottom edge through panel into base rail
- Top edge of "Front Panel" is trapped inside the "Top Cover" (38AU500226), the bottom subends the lower half of the panel, and the failure criterion along the bottom edge yields (5) screws for load consideration.
Load = 6.8 (106.2)/2 = 718.3 lbs

Screw Load = 718.3/5 = 143.7 lbs

Safety Factor = 351/143.7 = 2.4x

OK for components and cladding

"Center Post" (38AU500662): 45.37" x 19.95" draw formed 20 GA. panel, Area = 6.29 sq.ft.

- (2) screws through top panel and into face at the top
- (2) screws through post (trapped) along the vertical edge
- (2) screws along vertical edge of flange
- (3) screws 7/16 inch above bottom edge through panel into base rail

Load = 6.29 (106.2) = 667.4 lbs

Screw Load = 667.4/9 = 74.2 lbs

Safety Factor = 351/74.2 = 4.7x

OK for components and cladding

Connection of upper frame and panels to base rails:

Total overturning moment applied across the width of the rails, to the (13) rail-panel screw shear capacity, 20 GA. (min) cladding, into 16 GA. base rails, is the chosen load approximation in order to maximize design calculation variables for increased safety factor - (8) rail-post screw capacity neglected.

Connection of 20 GA. panels to 16 GA. (min) rails around the perimeter:

Screw Load = (150,110 + 128,960)/13(67.4) = 317.2 lbs (shear)

Safety Factor = 1119/317.2 = 3.5x OK for components and cladding

Unit itself will withstand wind loads imposed by 197.2 psf lateral and 95.4 psf uplift design pressures provided the 16 GA. galvanized base rails are fastened to a properly designed concrete slab, metal stand, curb, curb adapter, or other suitable mounting arrangement with all factory supplied assembly fasteners at the proper torque.

Connection of unit base rails to properly designed Metal Stand or Concrete:

Metal Stand or Concrete Connection:

Using (4) brackets, 2-1/2" x 2" x 3-1/4 - 4-1/8" wide, 16 GA. (min), spaced 30.0" (min) on-center into base rails,

Using (3) screws per bracket, (3) brackets each long side:

Screw Load = 5959/(18) = 331.1 lbs (tension)

Safety Factor = 573/331.1 = 1.7x

Screw Load = (150,110 + 99,835)/(3)(67.13) = 413.7 lbs (shear)

Safety Factor = 1389/413.7 = 3.4x

OK for components and cladding

OK for components and cladding

Metal Stand Fasteners:

Using (3) brackets, 2-1/2" x 2" x 3-1/4 - 4-1/8" wide, 16 GA. (min), spaced 30.0" (min) on-center into base rails,

Using (1) 3/8" SAE GR5 bolt/washer per bracket, (3) brackets each long side:

Bolt Load = (150,110 + 99,835)/(1)(3)(67.13) = 1241 lbs (tension)

Bolt Load = 5959/6 = 993.0 lbs (shear)

Safety Factor = 3720/1241 = 3.0x (tension)

Safety Factor = 1937/993.0 = 1.9x (shear)

OK

OK

Concrete Fasteners:

Using 2000psi (min) concrete, 4" (min) thick (by others),

Using (1) 3/8" Powers Wedge-Bolt+ anchors per bracket, (3) brackets each long side:

Anchor/Bolt Load = (150,110 + 99,835)/(1)(3)(67.13) = 1241 lbs (tension)

Anchor/Bolt Load = 5959/(6) = 993.0 lbs (shear)

Safety Factor = 3000/1241 = 2.4x (tension)

Safety Factor = 3100/993.0 = 3.1x (shear)

OK

OK

Job No:

Chassis 7A

Date:

03-23-16

Created by:

CORE

Job No:

Bryant Condenser Units

Title:

Model List and Details

MAR 29 2016
John D Buerosse
Florida P.E. 0050867
750 E. Sample Rd.
Bldg. 3, Suite 220
Pompano Beach, FL 33064
954-633-4692