


Product Data

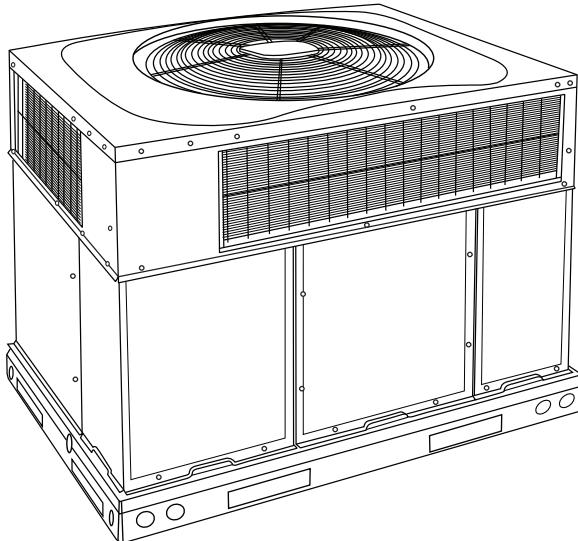

A09034

Fig. 1 - Unit 677C--B

Single-Packaged Products with Energy-Saving Features and Puron® refrigerant.

- Up to 14.5 SEER
- 12.0 EER
- 8.0 HSPF
- 81.0% AFUE (Single phase models)
- Factory-Installed TXV
- ECM Motor-Standard
- Direct Spark Ignition
- Dehumidification Feature

FEATURES/BENEFITS

One-piece heating and cooling units with low sound levels, easy installation, low maintenance, and dependable performance.

Puron is Bryant's unique refrigerant designed to help protect the environment. Puron is an HFC refrigerant which does not contain chlorine that can harm the ozone layer. Puron refrigerant is in service in millions of systems, proving highly reliable, environmentally sound performance.

Easy Installation

Factory-assembled package is a compact, fully self-contained, combination gas heating/electric heating and cooling unit that is prewired, pre-piped, and pre-charged for minimum installation expense. These units are available in a variety of standard and optional heating/cooling size combinations with voltage options to meet residential and light commercial requirements. Units are lightweight and install easily on a rooftop or at ground level. The high tech composite base eliminates rust problems associated with ground level applications.

Innovative Unit Base Design

On the inside a high-tech composite material will not rust and incorporates a sloped drain pan which improves drainage and helps inhibit mold, algae and bacterial growth. On the outside metal base rails provide added stability as well as easier handling and rigging.

Convertible duct configuration

Unit is designed for use in either downflow or horizontal applications. Each unit is converted from horizontal to downflow and includes horizontal duct covers. Downflow operation is provided in the field to allow vertical ductwork connections. The basepan seals on the bottom openings to ensure a positive seal in the vertical airflow mode.

Efficient operation **High-efficiency design** offers SEER (Seasonal Energy Efficiency Ratios) of up to 14.5, HSPF of 8.0 and AFUE (Annual Fuel Utilization Efficiency) ratings 81.0% on single phase models, and up to 80.4% on three phase models..

Energy-saving, direct spark ignition saves gas by operating only when the room thermostat calls for heating. Standard units are furnished with natural gas controls. A low-cost field installed kit for propane conversion is available for all units.

Low NOx units are designed for California installations. These models meet the California maximum oxides of nitrogen (NOx) emissions requirement of 40 nanograms/joule or less as shipped from the factory and MUST be installed in California Air Quality Management Districts and wherever a Low NOx rule exists.

Durable, dependable components **Compressors** are designed for high efficiency. Each compressor is hermetically sealed against contamination to help promote longer life and dependable operation. Each compressor also has vibration isolation to provide quieter operation. All compressors have internal high pressure and overcurrent protection.

Monoport inshot burners produce precise air-to-gas mixture, which provides for clean and efficient combustion. The large monoport on the inshot (or injection type) burners seldom, if ever, requires cleaning. All gas furnace components are accessible in one compartment.

Turbo-tubular™ heat exchangers are constructed of aluminized steel for corrosion resistance and optimum heat transfer for improved efficiency. The tubular design permits hot gases to make multiple passes across the path of the supply air.

In addition, dimples located on the heat exchanger walls force the hot gases to stay in close contact with the walls, improving heat transfer.

ECM Motor is standard on all models.

Direct-drive, PSC (Permanent Split Capacitor) condenser-fan motors are designed to help reduce energy consumption and provide for cooling operation down to 40°F (4.4°C) outdoor temperature. Motormaster® II low ambient kit is available as a field installed accessory.

Thermostat Controls

In order to take full advantage of the features afforded by your HYBRID HEAT® (dual-fuel) product, you need to install the Edge® Thermostat™ Control in either its programmable (part # TP-PRH) or non-programmable (TP-NRH) models.

Thermostatic Expansion Valve - A hard shutoff, balance port TXV maintains a constant superheat at the evaporator exit (cooling cycle) resulting in higher overall system efficiency.

Refrigerant system is designed to provide dependability. Liquid filter driers are used to promote clean, unrestricted operation. Each unit leaves the factory with a full refrigerant charge. Refrigerant service connections make checking operating pressures easier.

High and Low Pressure Switches provide added reliability for the compressor.

Indoor and Outdoor coils are computer-designed for optimum heat transfer and efficiency. The indoor coil is fabricated from copper tube and aluminum fins and is located inside the unit for protection against damage. The outdoor coil is internally mounted on the top tier of the unit.

Low sound ratings ensure a quiet indoor and outdoor environment with sound ratings as low as 73 dBA.

Easy to service cabinets provide easy multiple panel accessibility to serviceable components during maintenance and installation. The base with integrated drain pan provides easy ground level installation with a mounting pad. A nesting feature ensures a positive basepan to roof curb seal when the unit is roof mounted. A convenient 3/4-in. (19 mm) wide perimeter flange makes frame mounting on a rooftop easy.

Standard horizontal metal duct covers with insulation come with the unit and cover the horizontal duct openings. These can be left in place if the units are converted to downflow.

Integrated Gas Control (IGC) board provides safe and efficient control of heating and simplifies trouble-shooting through its built-in diagnostic function.


Cabinets are constructed of heavyduty, phosphated, zinc-coated prepainted steel capable of withstanding 500 hours in salt spray. Interior surfaces of the evaporator/heat exchanger compartment are insulated with cleanable semi-rigid insulation board, which keeps the conditioned air from being affected by the outdoor ambient

temperature and provides improved indoor air quality. (Conforms to American Society of Heating, Refrigeration and Air Conditioning Engineers No. 62P.) The sloped drain pan minimizes standing water in the drain. An external drain is provided.


Short-Cycling protection for the compressor is incorporated into our defrost control board ensuring a five minute delay (+/- 2 minutes) before restarting compressor after shutdown for any reason.

TABLE OF CONTENTS

FEATURES/BENEFITS	1
MODEL NUMBER NOMENCLATURE	3
AHRI CAPACITIES	3
PHYSICAL DATA	5-6
OPTIONS AND ACCESSORIES	7
BASE UNIT DIMENSIONS	9-10
ACCESSORY DIMENSIONS	11
SELECTION PROCEDURE	12
PERFORMANCE DATA	13-20
TYPICAL PIPING AND WIRING	50
APPLICATION DATA	51
ELECTRICAL DATA	53
TYPICAL WIRING SCHEMATICS	54-55
CONTROLS	58
GUIDE SPECIFICATIONS	59

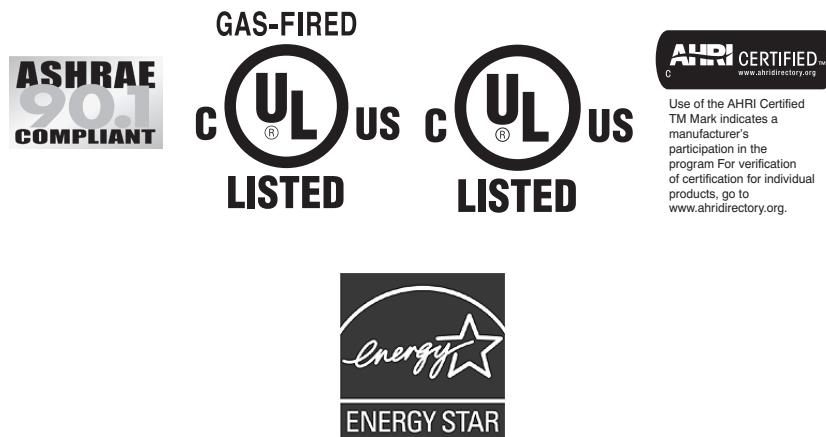

MODEL NUMBER NOMENCLATURE

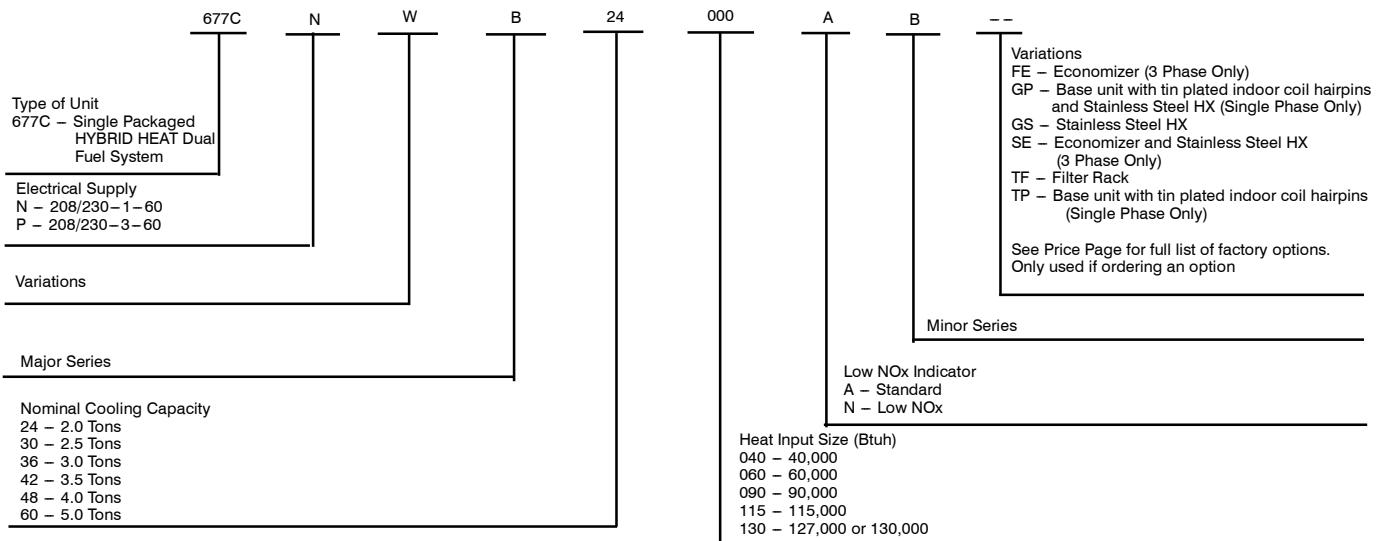

677C --- B

AHRI* CAPACITIES

COOLING CAPACITIES AND EFFICIENCIES

UNIT SIZE	NOMINAL TONS	STANDARD CFM	COOLING CAPACITY	EER	SEER
24	2	800	23000	12.0	14.2
30	2.5	1000	28600	12.0	14.2
36	3	1200	35800	12.0	14.5
42	3.5	1400	40500	12.0	14.5
48	4	1600	46500	12.0	14.5
60	5	1750	57000	12.0	14.5

HEAT PUMP HEATING CAPACITIES AND EFFICIENCIES

UNIT SIZE	HEATING CAPACITY (BTUH) @ 47°F (8.3°C)	COP @ 47°F (8.3°C)	HEATING CAPACITY (BTUH) @ 17°F (-8.3°C)	COP @ 17°F (-8.3°C)	HSPF
24	23000	3.5	11400	2.2	8.0
30	29600	3.5	15400	2.1	8.0
36	35800	3.5	19800	2.4	8.0
42	41500	3.4	23000	2.3	8.0
48	45500	3.4	26000	2.4	8.0
60	59000	3.5	32000	2.4	8.0

LEGEND

dBA—Sound Levels (decibels)

db—Dry Bulb

SEER—Seasonal Energy Efficiency Ratio

wb—Wet Bulb

COP—Coefficient of Performance

HSPF—Heating Season Performance Factor

* Air Conditioning, Heating & Refrigeration Institute.

**At "A" conditions—80°F (26.7°C) indoor db/67°F (19.4°C) indoor wb & 95°F (35°C) outdoor db.

† Rated in accordance with U.S. Government DOE Department of Energy test procedures and/or AHRI Standards 210/240.

Notes:

1. Ratings are net values, reflecting the effects of circulating fan heat.

Ratings are based on:

Cooling Standard: 80°F (26.7°C) db, 67°F (19.4°C) wb indoor entering-air temperature and 95°F (35°C) db outdoor entering-air temperature.

2. Before purchasing this appliance, read important energy cost and efficiency information available from your retailer.

GAS HEATING CAPACITIES AND EFFICIENCIES, SINGLE PHASE MODELS

UNIT SIZE	HEATING INPUT (Btuh)	OUTPUT CAPACITY (Btuh)	TEMPERATURE RISE RANGE F (C)	AFUE (%)
24040 30040	40,000	33,000	25-55 (14-31)	81.0
24060 30060 36060 42060	60,000	49,000	25-55 (13.9-30.6)	
36090 42090 48090 60090	90,000	74,000	35-65 (19.4-36.1)	
48115 60115	115,000	94,000	30-60 (16.7-33.3)	
48130 60130	130,000	104,000	35-65 (19.4-36.1)	

LEGEND

AFUE—Annual Fuel Utilization Efficiency

NOTE: Before purchasing this appliance, read important energy cost and efficiency information available from your retailer.

GAS HEATING CAPACITIES AND EFFICIENCIES, THREE PHASE MODELS

UNIT SIZE	HEATING INPUT (Btuh)	OUTPUT CAPACITY (Btuh)	TEMPERATURE RISE RANGE F (C)	AFUE (%)
24040 30040	40,000	32,000	30-60 (16.7-33.3)	80.0
24060 30060 36060 42060	60,000	48,000	25-55 (13.9-30.6)	80.0
36090 42090 48090 60090		48,000		80.0
48115 60115		47,000		78.5
48130 60130		47,000		78.5
36090 42090 48090 60090	90,000	73,000	35-65 (19.4-36.1)	80.4
48115 60115	115,000	93,000	30-60 (16.7-33.3)	80.3
48130 60130	130,000	103,000	35-65 (19.4-36.1)	78.9

LEGEND

AFUE—Annual Fuel Utilization Efficiency

NOTE: Before purchasing this appliance, read important energy cost and efficiency information available from your retailer.

PHYSICAL DATA

Unit Size	24040	24060	30040	30060	36060	36090
Nominal Capacity – ton	2	2	2.5	2.5	3	3
Shipping Weight (lb) (kg)	354 161	354 161	346 157	346 157	426 193	426 193
Compressor / Quantity			Scroll / 1			
Refrigerant			R-410A			
Refrigerant Quantity (lb) Quantity (kg)	11.1 5.0	11.1 5.0	10.3 4.7	10.3 4.7	9.9 4.5	9.9 4.5
Refrigerant Metering Device			Indoor TXV, Outdoor Dual Accurators			
Orifice OD (in) (mm)	0.032 (2) 0.81 (2)	0.032 (2) 0.81 (2)	0.037 (2) 0.94 (2)	0.037 (2) 0.94 (2)	0.038 (2) 0.97 (2)	0.038 (2) 0.97 (2)
Outdoor Coil Rows... Fins/in, face area (sq. ft.)	2...21 13.6	2...21 13.6	2...21 13.6	2...21 13.6	2...21 13.6	2...21 13.6
Outdoor Fan Nominal Airflow (cfm)	2500	2500	2700	2700	3100	3100
Diameter (in.)	24	24	24	24	26	26
Diameter (mm)	610	610	610	610	660	660
Motor hp (rpm)	1/10 (810)	1/10 (810)	1/5 (810)	1/5 (810)	1/5 (810)	1/5 (810)
Indoor Coil Rows... Fins/in, face area (sq. ft.)	3...17 3.7	3...17 3.7	3...17 3.7	3...17 3.7	3...17 4.7	3...17 4.7
Indoor Blower Nominal Airflow (cfm)	800	800	1000	1000	1200	1200
Size (in.)	10 x 10	10 x 10	10 x 10	10 x 10	11 x 10	11 x 10
Size (mm)	254 x 254	254 x 254	254 x 254	254 x 254	279 x 254	279 x 254
Motor hp	1/2	1/2	1/2	1/2	3/4	3/4
Furnace Section*						
Burner Orifice						
1–Phase Natural Gas Qty...Drill Size	2...44	3...44	2...44	3...44	3...44	3...38
1–Phase Propane Gas Qty...Drill Size	2...55	3...55	2...55	3...55	3...55	3...53
3–Phase Natural Gas Qty...Drill Size	2...44	2...38	2...44	2...38	2...38	3...38
3–Phase Propane Gas Qty...Drill Size	2...55	2...53	2...55	2...53	2...53	3...53
High Pressure Switch (psig) Cutout			650 +/– 15			
Reset (Auto)			420 +/– 25			
Loss-of-Charge/Low Pressure Switch (psig) Cutout			20 +/– 5			
Reset (Auto)			45 +/– 10			
Return Air Filters†‡ disposable (in) (mm)	20x20x1 508x508x25		20x24x1 508x610x25		24x30x1 610x762x25	

677C---B

*Based on altitude of 0 to 2000 ft (0–610 m).

†Required filter sizes shown are based on the larger of the AHRI (Air Conditioning Heating and Refrigeration Institute) rated cooling airflow or the heating airflow velocity of 300 ft/minute for high–capacity type. Air filter pressure drop for non–standard filters must not exceed 0.08 IN. W.C.

‡ If using accessory filter rack refer to filter rack installation instructions for correct filter size and quantity.

PHYSICAL DATA (CONT)

Unit Size	42060	42090	48090	48115	48130	60090	60115	60130
Nominal Capacity – ton	3.5	3.5	4	4	4	5	5	5
Shipping Weight (lb) (kg)	472 214	472 214	460 209	460 209	460 209	506 230	506 230	506 230
Compressor / Quantity	Scroll / 1							
Refrigerant	R-410A							
Refrigerant Quantity (lb) Quantity (kg)	11.3 5.1	11.3 5.1	12.5 5.7	12.5 5.7	12.5 5.7	15.2 6.9	15.2 6.9	15.2 6.9
Refrigerant Metering Device	Indoor TXV, Outdoor Dual Accurators							
Orifice OD (in) (mm)	0.040 (2) 1.02 (2)	0.040 (2) 1.02 (2)	0.040 (2) 1.02 (2)	0.040 (2) 1.02 (2)	0.040 (2) 1.02 (2)	0.049 (2) 1.24 (2)	0.049 (2) 1.24 (2)	0.049 (2) 1.24 (2)
Outdoor Coil Rows... Fins/in, face area (sq. ft.)	2...21 17.5	2...21 17.5	2...21 17.5	2...21 17.5	2...21 17.5	2...21 23.3	2...21 23.3	2...21 23.3
Outdoor Fan Nominal Airflow (cfm)	3100	3100	3100	3100	3100	3500	3500	3500
Diameter (in.)	26	26	26	26	26	26	26	26
Diameter (mm)	660	660	660	660	660	660	660	660
Motor hp	1/5	1/5	1/5	1/5	1/5	1/4	1/4	1/4
Motor (rpm)	(810)	(810)	(810)	(810)	(810)	(810)	(810)	(810)
Indoor Coil Rows... Fins/in, face area (sq. ft.)	3...17 4.7	3...17 4.7	3...17 5.6	3...17 5.6	3...17 5.6	3...17 5.6	3...17 5.6	3...17 5.6
Indoor Blower Nominal Airflow (cfm)	1400	1400	1600	1600	1600	1750	1750	1750
Size (in.)	11 x 10	11 x 10	11 x 10	11 x 10	11 x 10	11 x 10	11 x 10	11 x 10
Size (mm)	279 x 254	279 x 254	279 x 254	279 x 254	279 x 254	279 x 254	279 x 254	279 x 254
Motor hp	3/4	3/4	1	1	1	1	1	1
Furnace Section* Burner Orifice								
1 Phase Natural Gas Qty...Drill Size	3...44	3...38	3...38	3...33	3...31	3...38	3...33	3...31
1 Phase Propane Gas Qty...Drill Size	3...55	3...53	3...53	3...51	3...49	3...53	3...51	3...49
3 Phase Natural Gas Qty...Drill Size	2...38	3...38	3...38	3...33	3...31	3...38	3...33	3...31
3 Phase Propane Gas Qty...Drill Size	2...53	3...53	3...53	3...51	3...49	3...53	3...51	3...49
High Pressure Switch (psig) Cutout					650 +/- 15			
Reset (Auto)					420 +/- 25			
Loss-of-Charge/Low Pressure Switch (psig)						20 +/- 5		
Cutout						45 +/- 10		
Reset (Auto)								
Return Air Filters†‡ disposable (in) (mm)	24x30x1 610x762x25				24x36x1 610x914x25			

*Based on altitude of 0 to 2000 ft (0–610 m).

†Required filter sizes shown are based on the larger of the AHRI (Air Conditioning Heating and Refrigeration Institute) rated cooling airflow or the heating airflow velocity of 300 ft/minute for high-capacity type. Air filter pressure drop for non-standard filters must not exceed 0.08 IN. W.C.

‡ If using accessory filter rack refer to filter rack installation instructions for correct filter size and quantity.

A-Weighted Sound Power Level (dBA)

UNIT SIZE	Standard Rating (dBA)	TYPICAL OCTAVE BAND SPECTRUM (dBA) (without tone adjustment)						
		125	250	500	1000	2000	4000	8000
24	74	63.5	64.5	69	69.5	65	59.5	50
30	75	63.5	66	71	69.5	66.5	61	54
36	74	64	66	68	68	66.5	60.5	52
42	73	63.5	63.5	66.5	67	64.5	60	52.5
48	74	68.5	65	67	67.5	65	60.5	53
60	75	68	64.5	68.5	69	65.5	62	58

NOTE: Tested in accordance with AHRI Standard 270-1995 (not listed in AHRI).




677C---B

OPTIONS AND ACCESSORIES


ITEM	DESCRIPTION	FACTORY INSTALLED OPTION	FIELD INSTALLED ACCESSORY
Coil Options	Base unit with tin plated indoor coil hairpins	X	
Compressor Start Kit	Compressor Start Kit assists compressor start-up by providing additional starting torque on single-phase units only.		X
Corporate Thermostats	Thermostats provide control for the system heating and cooling functions.		X
Crankcase Heater	Crankcase Heater provides anti-floodback protection for low-load cooling applications.		X*
Economizers	Horizontal Economizer with solid state controls and barometric relief dampers includes filter racks and provide outdoor air during cooling and reduce compressor operation.		X
	Vertical Economizer with solid state controls and barometric relief dampers includes filter racks and provide outdoor air during cooling and reduce compressor operation.	X	X
Filter Rack	Filter Rack features easy installation, serviceability, and high-filtering performance for vertical applications.	X	X
Flat Roof Curbs	Flat Roof Curbs in both 8-in. (203 mm) and 14-in. (356 mm) sizes are available for roof mounted applications.		X
Flue Discharge Deflector	Directs flue gas exhaust 90 degrees upward from current discharge. Designed to allow tighter distances between unit and combustible surfaces.		X
Heat Exchanger	Stainless Steel Heat Exchanger	X	
High Altitude Propane Conversion Kit	High Altitude Propane Conversion Kit is for use at 2001 to 6000 ft (611 – 1829 m) above sea level. Kit consists of propane gas orifices that compensate for gas heat operation at high altitude.		X
Low Ambient Kit	Low Ambient Kit (Motormaster II Control) allows the use of mechanical cooling down to outdoor temperatures as low as 0°F (-18°C) when properly installed.		X
Manual Outside Air Damper	Manual Outside Air Damper includes hood and filter rack with adjustable damper blade for up to 25% outdoor air.		X
Natural to Propane Gas Conversion Kit	Natural to Propane Gas Conversion Kit allows for conversion from natural gas to propane gas (0–2000 ft) (0–610 m)		X
Propane to Natural Gas Conversion Kit	Propane to Natural Gas Conversion Kit allows for conversion from propane to natural gas for altitudes of 0–2000 ft (0–610 m)		X
Square-to-Round Duct Transition Kit	Square-to-Round Duct Transition Kit enables 24–48 size units to be fitted to 14 in. round ductwork.		X
Time Guard II	Automatically prevents the compressor from restarting for at least 4 minutes and 45 seconds after shutdown of the compressor. Not required when a corporate programmable thermostat is applied or with a RTU-MP control.		X*
Curb Adaptor	Adapter curb for new unit with base rail installed on existing curb		X
Gasket Kit	For field modified existing roof curb with new base rail unit.		X
Louver Metal Outdoor Coil Grilles	Louver Metal Outdoor Coil Grilles provide hail and vandalism protection.		X

*Refer to Price Page for application detail.



ECONOMIZER

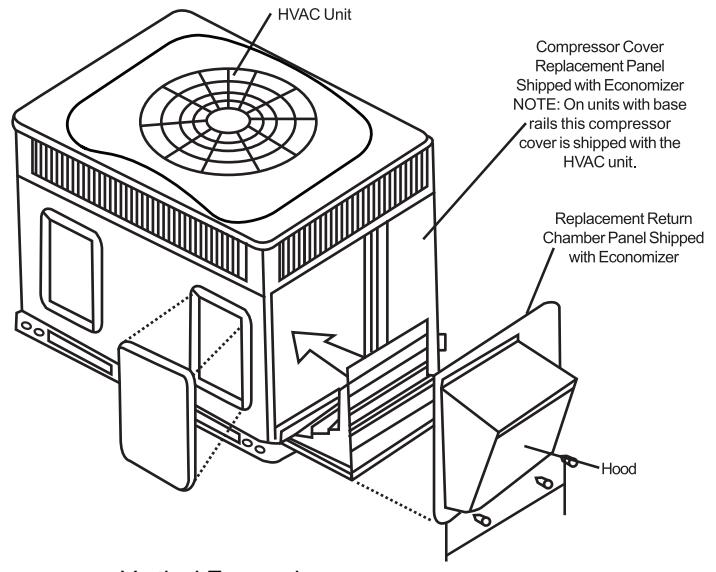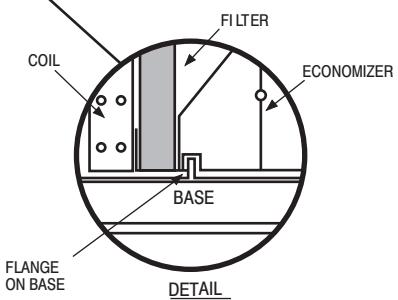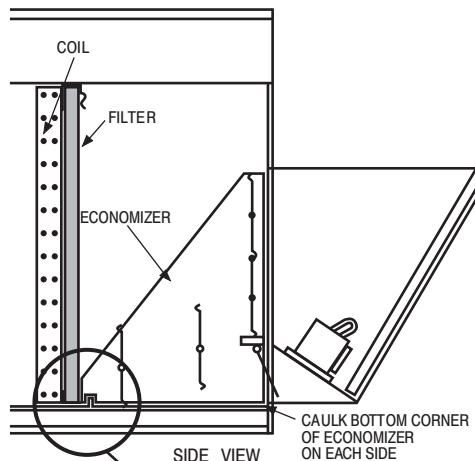

Vertical Economizer

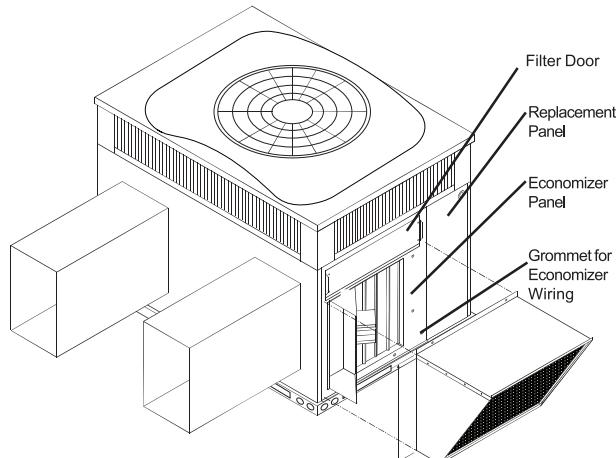

Horizontal Economizer

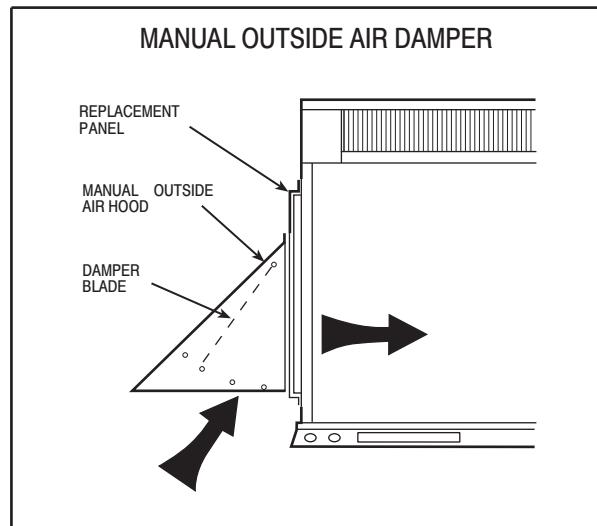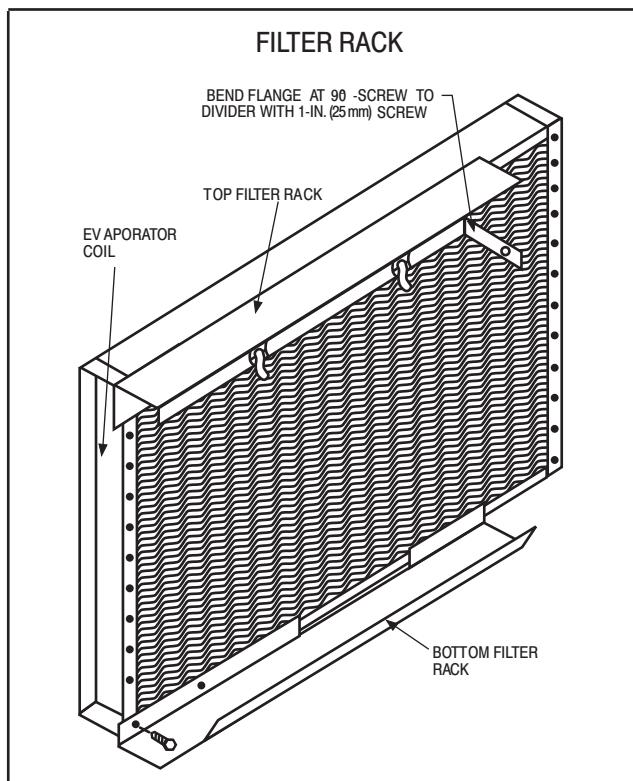


A09375

UNIT DIMENSIONS - 24-30

UNIT	ELECTRICAL CHARACTERISTICS	UNIT WT.	UNIT HEIGHT IN/MM	CENTER OF GRAVITY IN/MM
	LB KG	" "	X	Y
671C/N.PWB24/040/060)(A/N)A	208/230-1-60	368	167	44-1/8 1121 22-3/4 578 15-1/2 394 16-1/4 387
671C/N.PWB30/040/060)(A/N)A	208/230-1	360	163	44-1/8 1121 22-3/4 578 15-1/2 394 16-1/4 387
UNITS	VOLTAGE	"1"	"2"	"3"
671C/N.PWB24/040/060)(A/N)A	208/230	94	42	83 90 41 101 46
671C/N.PWB30/040/060)(A/N)A	208/230	92	42	81 37 88 40 9 45

NOTE: ALL TABLE DATA RELEVANT FOR ALL FACTORY INSTALLED OPTIONS EXCEPT ECONOMIZER

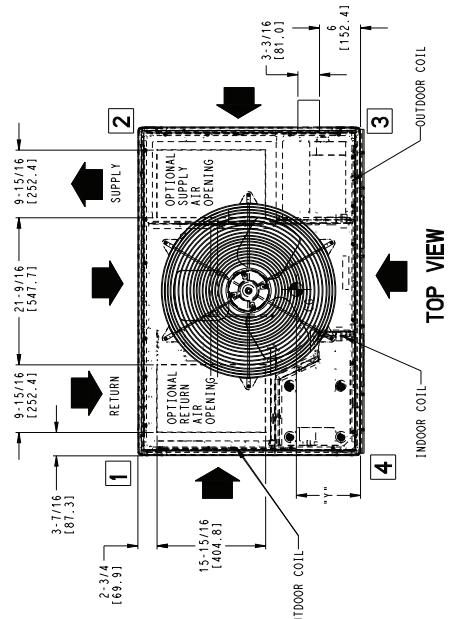

REQUIRED CLEARANCES TO COMBUSTIBLE MATL.

	INCHES [MM]
TOP OF UNIT	.14 [35.6]
DUCT SIDE OF UNIT	.12 [30.8]
SIDE OPPOSITE DUCTS	.14 [35.6]
UNIT AND BLOCK OR CONCRETE WALLS AND OTHER GROUNDED SURFACES, POWER ENTRY SIDE	.12 [30.8]
BOTTOM OF UNIT	.12 [30.8]
FLUE PANEL	.36 [914.4]

NEC REQUIRED CLEARANCES.


	INCHES [MM]
BETWEEN UNITS, POWER ENTRY SIDE	.42 [1066.8]
DUCT SIDE OF UNIT	.36 [914.0]
UNIT AND BLOCK OR CONCRETE WALLS AND OTHER GROUNDED SURFACES, POWER ENTRY SIDE	.42 [1066.8]
FLUE PANEL	.36 [914.4]

REQUIRED CLEARANCE FOR OPERATION AND SERVICING


	INCHES [MM]
EVAP. COIL ACCESS SIDE	.36 [914.0]
POWER ENTRY SIDE	.42 [1066.8]
(EXCEPT FOR NEC REQUIREMENTS)	
UNIT TOP	.48 [1219.2]
SIDE OPPOSITE DUCTS	.36 [914.0]
DUCT PANEL	.12 [304.8]

*MINIMUM DISTANCES: IF UNIT IS PLACED LESS THAN 12 [304.8] FROM WALL SYSTEM, THEN SYSTEM PERFORMANCE MAYBE COMPROMISED.


DIMENSIONS IN [] ARE IN MM

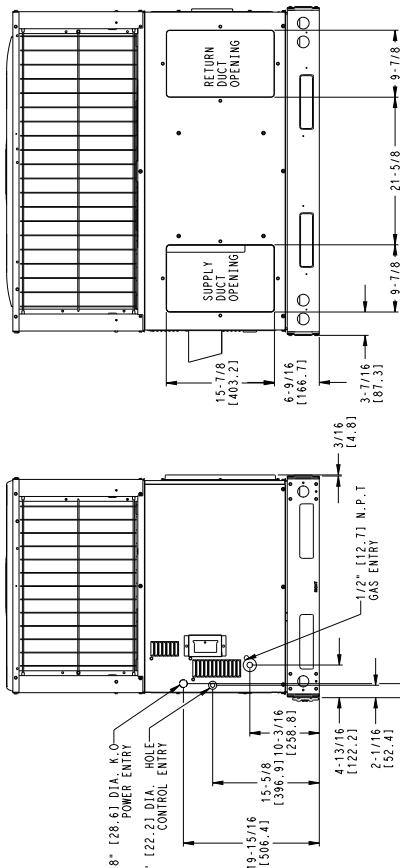

REAR VIEW

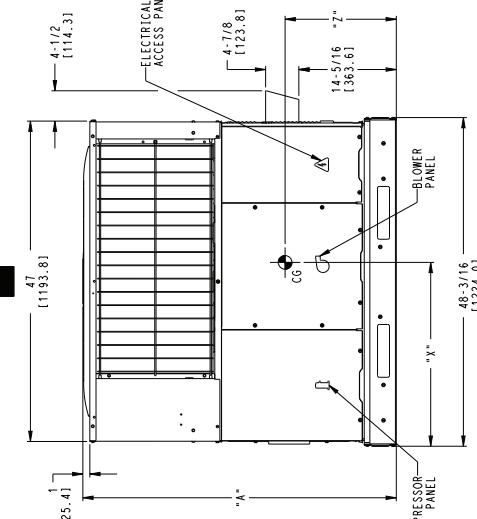

FRONT VIEW

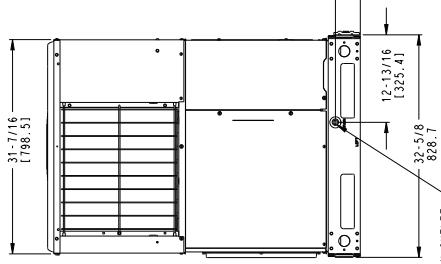

LEFT SIDE VIEW


A14393

48/V500102 REV -


677C --- B

UNIT DIMENSIONS - 36-60


677C---B

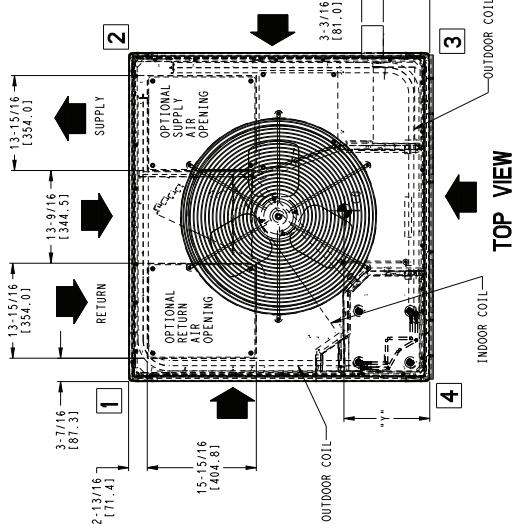

TOP VIEW

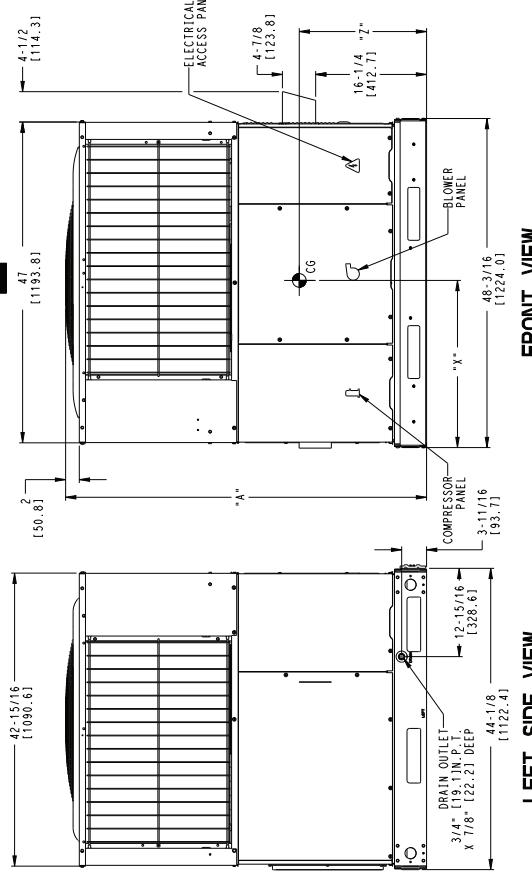

FRONT VIEW

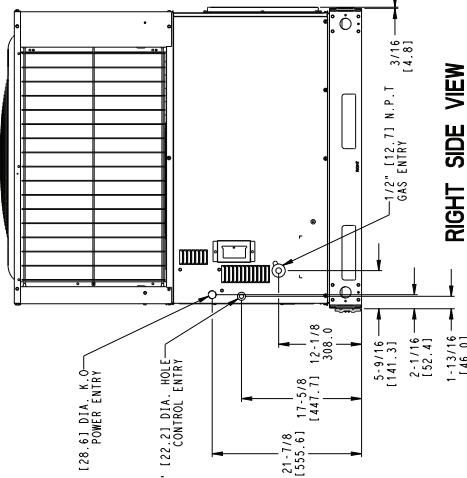


RIGHT SIDE VIEW

NOTE : ALL TABLE DATA RELEVANT FOR ALL FACTORY INSTALLED OPTIONS EXCEPT ECONOMIZER

NEC REQUIRED CLEARANCES		[INCHES [MM]]
BETWEEN UNITS, POWER ENTRY SIDE	42 [1166.8]
UNIT AND UNGROUNDED SURFACES, POWER ENTRY SIDE	42 [1166.8]
UNIT AND BLOCK OR CONCRETE WALLS AND OTHER GROUNDED SURFACES, POWER ENTRY SIDE	36 [914.0]
.....	42 [1166.8]
REQUIRED CLEARANCE FOR OPERATION AND SERVICING		[INCHES [MM]]
EVAP. COIL ACCESS SIDE	36 [914.0]
POWER ENTRY SIDE	42 [1166.8]
UNIT TOP (FOR NEC REQUIREMENTS)	48 [1219.2]
SIDE OPPOSITE DUCT(S)	36 [914.0]
SIDE PANEL	12 [304.8] *
MINIMUM DISTANCES: IF UNIT IS PLACED LESS THAN 12"		[304.8] FROM WALL


DIMENSIONS IN [] ARE IN MM

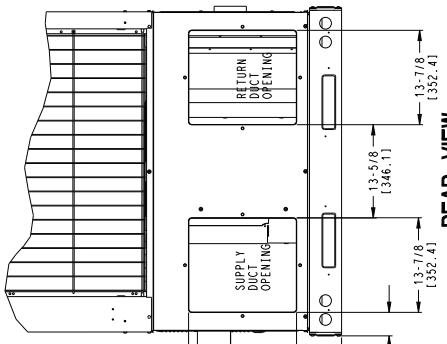


4] BEAB VIEW

48V T5000103	REV -
--------------	----------


ACCESSORY DIMENSIONS

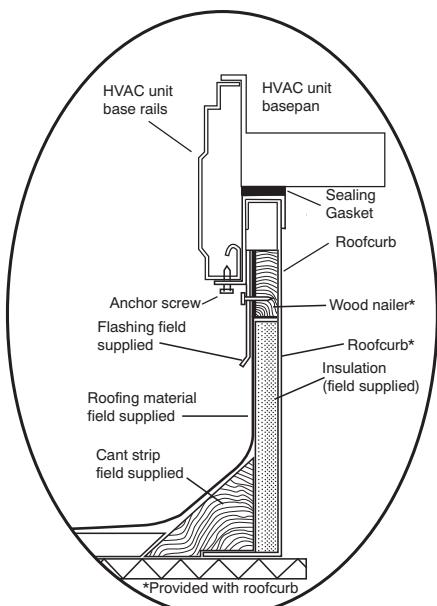

ROOF CURB DETAIL

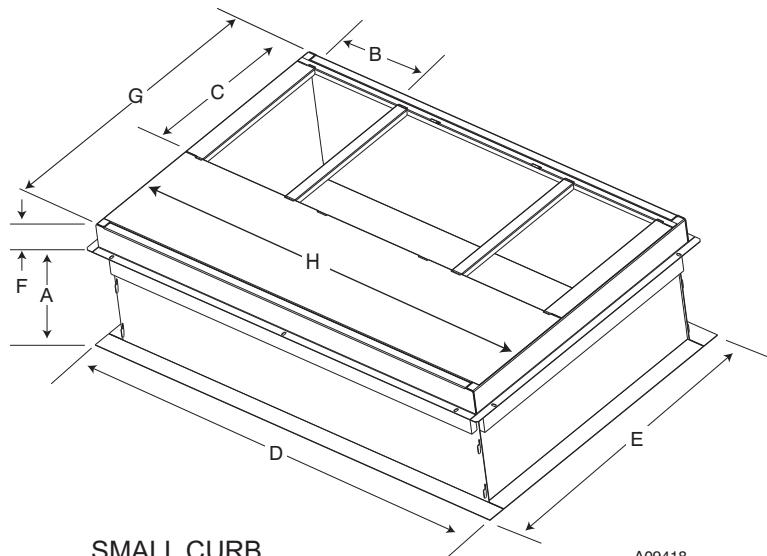

677C --- B

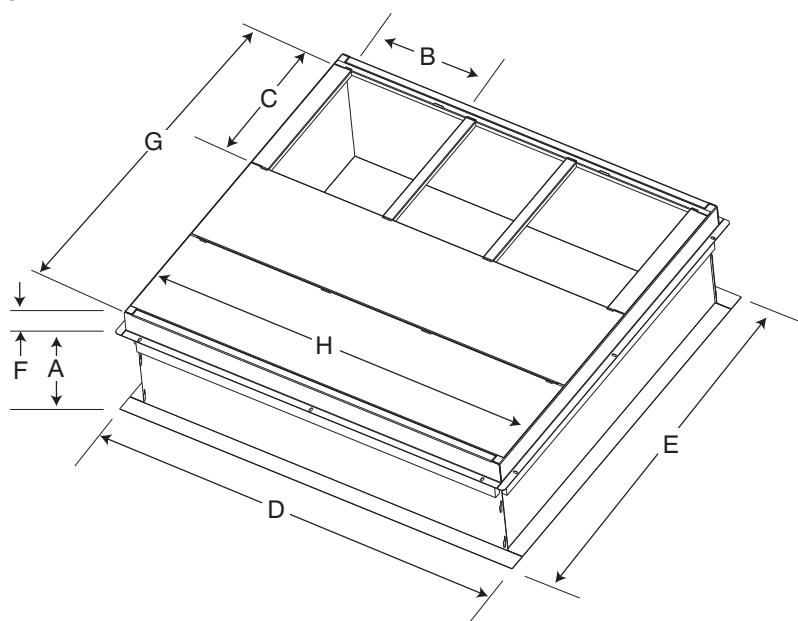

A09419

UNIT SIZE	CATALOG NUMBER	A IN. (mm)	B IN. (mm)*	C IN. (mm)	D IN. (mm)	E IN. (mm)	F IN. (mm)	G IN. (mm)	H IN. (mm)
Small	CPRFCURB010A00	11 (279)	10 (254)	16 (406)	47.8 (1214)	32.4 (822)	2.7 (69)	30.6 (778)	46.1 (1170)
	CPRFCURB011A00	14 (356)				43.9 (1116)		42.2 (1072)	
Large	CPRFCURB012A00	11 (279)	14 (356)						
	CPRFCURB013A00	14 (356)							

NOTES:

1. Roof curb must be set up for unit being installed.
2. Seal strip must be applied, as required, to unit being installed.
3. Roof curb is made of 16-gauge steel.
4. Attach ductwork to curb (flanges of duct rest on curb).
5. Insulated panels: 1-in. (25.4 mm) thick fiberglass 1 lb. density.

IMPORTANT: Do not install large base pan HYBRID HEAT units onto the small base pan (common curb). The center of gravity on a large base pan HYBRID HEAT unit could overhang the curb causing an unsafe condition. Before installing any large base pan unit onto the common curb, check the "Y" distance in the product literature dimensional drawing to ensure that "Y" is greater than 14 in. (356 mm). Do not install any large base pan unit onto the

common curb with a "Y" dimension (center of gravity) less than 14 in. (356 mm).

SELECTION PROCEDURE (WITH EXAMPLE)

1. Determine cooling and heating requirements at design conditions:

Given:

Required Cooling Capacity (TC) 34,500 Btuh
 Sensible Heat Capacity (SHC) 26,000 Btuh
 Required Heating Capacity 60,000 Btuh
 Condenser Entering Air Temperature 95°F (35°C)
 Indoor-Air Temperature 80°F (27°C) edb 67°F (19°C) ewb
 Evaporator Air Quantity 1200 CFM
 External Static Pressure 0.200 IN. W.C.
 Electrical Characteristics 208-1-60

2. Select unit based on required cooling capacity.

Enter Net Cooling Capacities table at condenser entering temperature of 95°F (35°C). Unit 036 at 1200 CFM and 67°F (19°C) ewb (entering wet bulb) will provide a total capacity of 35,800 Btuh and a SHC of 26,950 Btuh. Calculate SHC correction, if required, using Note 4 under Cooling Capacities tables.

3. Select heating capacity of unit to provide design condition requirement.

In the Heating Capacities and Efficiencies table, note that the unit 036090 will provide 74,000 Btuh with an input of 90,000 Btuh.

4. Determine fan speed and power requirements at design conditions.

Before entering the air delivery tables, calculate the total static pressure required. From the given example, the Wet Coil Pressure Drop Table, and the Filter Pressure Drop Table:

External Static Pressure	0.200 IN. W.C.
Filter	0.130 IN. W.C.
Wet Coil Pressure Drop	<u>0.180 IN. W.C.</u>
Total Static Pressure	0.510 IN. W.C.

Enter the table for Dry Coil Air Delivery—horizontal and downflow Discharge. At 0.5 ESP (external static pressure), in cooling the fan will deliver 1079 cfm with the MED speed tap selected. To achieve 1200 CFM a higher speed tap is required.

5. Select unit that corresponds to power source available.

The Electrical Data Table shows that the unit is designed to operate at 208-1-60.

PERFORMANCE DATA

24 Cooling Extended Performance Table

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F (deg C)																	
		85 (29.4)				95 (35)													
CFM	EWB	75 (23.9)		Capacity MBtuh		Total Sys kW		Capacity MBtuh		Total Sys kW		Capacity MBtuh		Total Sys kW		Capacity MBtuh		Total Sys kW	
		Total	Sens	Total	Sens	Total	Sens	Total	Sens	Total	Sens	Total	Sens	Total	Sens	Total	Sens	Total	Sens
700	57 (13.9)	21.90	21.90	1.50	21.04	21.11	20.11	1.88	19.10	19.10	2.10	18.03	18.03	2.35	16.87	16.87	2.64	16.90	16.90
	62 (16.7)	22.70	20.36	1.50	21.63	19.79	1.68	20.49	19.17	1.88	19.30	18.47	2.10	18.08	18.08	2.35	16.90	16.90	2.64
	63 (17.2)	23.06	16.63	1.50	21.94	16.09	1.68	20.75	15.53	1.88	19.50	14.94	2.11	18.17	14.31	2.36	16.75	13.64	2.64
	67 (19.4)	24.96	17.37	1.50	23.75	16.83	1.69	22.46	16.26	1.89	21.12	15.67	2.12	19.68	15.04	2.37	18.16	14.37	2.65
	72 (22.2)	27.48	14.25	1.51	26.12	13.75	1.70	24.71	13.19	1.91	23.23	12.61	2.14	21.65	12.00	2.39	19.99	11.36	2.67
	57 (13.9)	22.97	1.52	22.03	1.70	21.03	1.90	19.95	19.95	2.13	18.79	18.79	2.13	17.55	17.55	2.38	17.55	17.55	2.66
800	62 (16.7)	23.39	21.91	1.52	22.27	21.26	1.70	21.10	21.08	1.90	19.98	19.98	2.13	18.82	18.82	2.38	17.58	17.58	2.66
	63 (17.2)	23.69	17.76	1.52	22.51	17.20	1.70	21.26	16.61	1.91	19.94	15.99	2.13	18.56	15.33	2.38	17.09	14.61	2.66
	67 (19.4)	25.63	18.59	1.52	24.34	18.02	1.71	23.00	17.43	1.92	21.58	16.80	2.14	20.09	16.14	2.39	18.51	15.43	2.67
	72 (22.2)	28.18	15.05	1.53	26.77	14.50	1.73	25.28	13.93	1.93	23.72	13.32	2.16	22.08	12.68	2.41	20.35	12.02	2.69
	57 (13.9)	23.89	23.89	1.54	22.88	22.88	1.72	21.81	21.81	1.93	20.66	20.66	2.15	19.43	19.43	2.40	18.11	18.11	2.69
	62 (16.7)	24.03	23.26	1.54	22.92	22.92	1.72	21.85	21.85	1.93	20.69	20.69	2.15	19.46	19.46	2.40	18.14	18.14	2.69
900	63 (17.2)	24.20	18.85	1.54	22.96	18.28	1.72	21.66	17.64	1.93	20.30	16.99	2.15	18.86	16.29	2.40	17.35	15.52	2.68
	67 (19.4)	26.16	19.77	1.54	24.82	19.18	1.73	23.42	18.55	1.94	21.95	17.89	2.16	20.41	17.19	2.41	18.78	16.43	2.69
	72 (22.2)	28.76	15.79	1.55	27.27	15.22	1.75	25.73	14.82	1.95	24.11	14.00	2.18	22.41	13.34	2.43	20.62	12.64	2.71

*At 75°F (23.9°C) entering dry bulb—Tennessee Valley Authority (TVA) rating conditions; all others at 80°F (26.7°C) entering dry bulb. See Legend and Notes.

24 Heating Extended Performance Table -10-60 (-23.3-15.6°C)

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES deg F (deg C)																		
		20 (-6.7)				30 (-1.1)														
EDB	CFM	-10 (-23.3)		0 (-17.8)		10 (-12.2)		Capacity MBtuh		Total Sys kW		Capacity MBtuh		Total Sys kW		Capacity MBtuh		Total Sys kW		
		Total	Integ	Total	Integ	Total	Integ	Total	Integ	Total	Integ	Total	Integ	Total	Integ	Total	Integ	Total	Integ	
65 (18.3)	700	7.13	6.56	1.48	9.45	8.70	1.55	12.07	11.08	1.62	14.83	13.45	1.68	17.57	15.40	1.74	20.64	1.81	24.12	1.90
	800	7.23	6.65	1.49	9.58	8.81	1.55	12.45	11.43	1.62	14.96	13.57	1.67	17.75	15.55	1.72	20.87	1.78	24.44	2.04
	900	7.32	6.74	1.50	9.68	8.91	1.56	12.55	11.52	1.61	15.09	13.68	1.66	17.90	15.68	1.71	21.07	1.76	24.69	2.05
	70 (21.1)	6.86	6.41	1.55	9.31	8.45	1.62	11.73	10.77	1.69	14.64	13.28	1.76	17.32	15.17	1.83	20.33	1.87	23.72	1.99
	800	6.97	6.50	1.56	9.42	8.67	1.62	12.03	11.04	1.68	14.77	13.40	1.75	17.50	15.33	1.80	20.57	1.87	24.04	2.07
	900	7.06	6.62	1.62	9.69	8.17	1.69	11.42	10.48	1.76	14.43	13.51	1.74	17.65	15.47	1.79	20.76	1.85	24.29	2.04
75 (23.9)	800	6.67	6.13	1.62	9.02	8.30	1.69	11.57	10.62	1.75	14.57	13.22	1.83	17.24	15.11	1.89	20.26	1.96	23.65	2.04
	900	6.76	6.22	1.63	9.13	8.40	1.70	11.71	10.75	1.75	14.69	13.32	1.82	17.40	15.24	1.87	20.45	1.94	23.89	2.02

PERFORMANCE DATA (CONT) 30 Cooling Extended Performance Table

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F (deg C)							
		85 (29.4)				95 (35)			
CFM	EWB	75 (23.9)		Capacity MBtuh		Total Sys kW		Capacity MBtuh	
		Total	Sens	Total	Sens	Total	Sens	Total	Sens
875	57 (13.9)	27.14	27.14	1.89	26.11	2.10	25.02	2.33	23.84
	62 (16.7)	28.06	25.60	1.90	26.77	2.10	25.43	2.33	24.02
	63 (17.2)	28.55	20.86	1.90	27.21	2.10	25.81	19.58	2.33
	67 (19.4)	30.91	21.79	1.91	29.46	2.12	27.96	20.50	2.35
	72 (22.2)	34.14	17.72	1.93	32.54	2.14	30.88	16.51	2.37
	57 (13.9)	28.46	28.46	1.93	27.34	2.14	26.16	2.37	24.89
1000	62 (16.7)	28.88	27.57	1.93	27.56	2.14	26.22	2.37	24.94
	63 (17.2)	29.30	22.31	1.93	27.88	21.66	26.41	20.97	2.37
	67 (19.4)	31.70	23.35	1.95	30.18	22.69	28.60	22.00	2.38
	72 (22.2)	35.00	18.77	1.97	33.30	18.15	31.53	17.52	2.41
	57 (13.9)	29.59	29.59	1.97	28.40	2.17	27.13	2.40	25.78
	62 (16.7)	29.65	29.65	1.97	28.45	2.17	27.18	2.40	25.83
1125	63 (17.2)	29.89	23.70	1.97	28.41	2.02	23.02	2.17	26.89
	67 (19.4)	32.31	24.86	1.98	30.72	24.17	2.19	29.08	23.46
	72 (22.2)	35.63	19.78	2.01	33.88	19.11	2.21	32.06	18.43
	57 (13.9)	29.56	8.79	1.94	12.51	11.51	2.01	16.03	14.71
	62 (16.7)	30.00	9.74	8.96	12.71	11.70	2.02	16.27	14.93
	63 (17.2)	31.25	9.39	9.10	12.89	11.86	2.04	16.43	15.08
14	65 (18.3)	31.25	9.39	9.10	12.89	11.86	2.10	19.55	17.73
	70 (21.1)	30.00	9.31	8.57	12.32	11.34	2.04	14.09	2.17
	75 (23.9)	31.25	9.47	8.72	20.04	12.32	2.11	15.60	14.31
	76 (22.2)	35.63	8.67	7.98	21.1	11.51	2.12	15.85	14.55
	77 (19.4)	30.00	8.85	8.14	21.2	11.69	2.19	14.93	13.70
	78 (17.2)	31.25	9.01	8.29	21.5	12.08	2.21	15.36	14.10

*At 75°F (23.9°C) entering dry bulb—Tennessee Valley Authority [TVA] rating conditions; all others at 80°F (26.7°C) entering dry bulb. See Legend and Notes.

30 Heating Extended Performance Table -10-60 (-23.3-15.6°C)

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES deg F (deg C)							
		20 (-6.7)				30 (-1.1)			
EDB	CFM	-10 (-23.3)		0 (-17.8)		10 (-12.2)		20 (-6.7)	
		Capacity MBtuh	Total Sys kW	Capacity MBtuh	Total Sys kW	Capacity MBtuh	Total Sys kW	Capacity MBtuh	Total Sys kW
65	87.5 (18.3)	9.56	8.79	1.94	12.51	11.51	2.01	16.03	14.71
	66 (11.25)	9.74	8.96	1.96	12.71	11.70	2.02	16.27	14.93
	67 (9.13)	9.39	9.10	1.98	12.89	11.86	2.04	16.43	15.08
	68 (8.40)	20.02	12.12	11.15	21.10	15.35	14.09	21.77	18.92
	69 (8.75)	9.13	8.40	2.04	12.32	11.34	2.11	15.60	14.31
	70 (8.75)	10.00	9.31	8.57	12.32	11.34	2.11	15.85	14.55
70	71 (12.1)	10.00	9.47	8.72	20.06	12.50	11.51	21.18	19.95
	72 (9.67)	9.47	8.72	2.04	12.32	11.34	2.11	15.85	14.55
	73 (8.75)	11.25	9.75	8.87	21.1	11.51	2.12	15.94	13.70
	74 (8.75)	10.00	8.85	8.14	21.2	11.69	2.19	14.93	13.70
	75 (10.00)	11.25	9.01	8.29	21.5	12.08	2.21	15.36	14.10
	76 (11.25)	10.00	8.29	2.15	12.08	11.12	2.21	15.36	14.10
75	77 (23.9)	8.75	8.56	8.79	1.94	12.51	11.51	2.01	16.03
	78 (11.25)	9.74	9.39	9.10	1.98	12.71	11.70	2.02	16.27
	79 (9.13)	9.39	9.10	1.98	12.89	11.86	2.04	16.43	15.08
	80 (8.40)	20.02	12.12	11.15	21.10	15.35	14.09	21.77	18.92
	81 (8.75)	9.13	8.40	2.04	12.32	11.34	2.11	15.60	14.31
	82 (8.75)	10.00	9.31	8.57	12.32	11.34	2.11	15.85	14.55
76	83 (12.1)	10.00	9.47	8.72	20.06	12.50	11.51	21.18	19.95
	84 (9.67)	9.47	8.72	2.04	12.32	11.34	2.11	15.85	14.55
	85 (8.75)	11.25	9.75	8.87	21.1	11.51	2.12	15.94	13.70
	86 (8.75)	10.00	8.85	8.14	21.2	11.69	2.19	14.93	13.70
	87 (10.00)	11.25	9.01	8.29	21.5	12.08	2.21	15.36	14.10
	88 (11.25)	10.00	8.29	2.15	12.08	11.12	2.21	15.36	14.10
77	89 (23.9)	8.75	8.56	8.79	1.94	12.51	11.51	2.01	16.03
	90 (11.25)	9.74	9.39	9.10	1.98	12.71	11.70	2.02	16.27
	91 (9.13)	9.39	9.10	1.98	12.89	11.86	2.04	16.43	15.08
	92 (8.40)	20.02	12.12	11.15	21.10	15.35	14.09	21.77	18.92
	93 (8.75)	9.13	8.40	2.04	12.32	11.34	2.11	15.60	14.31
	94 (8.75)	10.00	9.31	8.57	12.32	11.34	2.11	15.85	14.55
78	95 (12.1)	10.00	9.47	8.72	20.06	12.50	11.51	21.18	19.95
	96 (9.67)	9.47	8.72	2.04	12.32	11.34	2.11	15.85	14.55
	97 (8.75)	11.25	9.75	8.87	21.1	11.51	2.12	15.94	13.70
	98 (8.75)	10.00	8.85	8.14	21.2	11.69	2.19	14.93	13.70
	99 (10.00)	11.25	9.01	8.29	21.5	12.08	2.21	15.36	14.10
	100 (11.25)	10.00	8.29	2.15	12.08	11.12	2.21	15.36	14.10

PERFORMANCE DATA (CONT)
36 Cooling Extended Performance Table

677C--B

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F (deg C)																							
		85 (29.4)				95 (35)																			
CFM	EWB	75 (23.9)		Capacity MBtuh		Total Sys kW		Capacity MBtuh		Total Sys kW		Capacity MBtuh		Total Sys kW		Capacity MBtuh		Total Sys kW							
		Total	Sens	Total	Sens	Total	Sens	Total	Sens	Total	Sens	Total	Sens	Total	Sens	Total	Sens	Total	Sens						
1050	57 (13.9)	33.80	33.80	2.35	32.51	2.62	31.13	2.92	29.64	3.26	28.00	3.65	26.21	4.10	22.2	2.40	20.46	2.71	19.40	2.99					
	62 (16.7)	35.12	31.40	2.36	33.51	2.62	31.92	2.92	30.03	3.26	28.11	3.65	26.26	4.10	22.2	2.40	20.46	2.71	19.40	2.99					
	63 (17.2)	35.63	25.64	2.36	33.98	24.84	2.63	32.23	24.00	2.93	30.35	23.10	3.26	28.32	22.12	3.65	26.12	21.07	4.10	22.2	2.40	20.46	2.71	19.40	2.99
	67 (19.4)	38.56	26.79	2.38	36.80	25.98	2.65	34.93	25.15	2.95	32.93	24.26	3.28	30.76	23.29	3.67	28.43	22.24	4.11	22.2	2.40	20.46	2.71	19.40	2.99
	72 (22.2)	42.38	22.02	2.40	40.45	21.27	2.68	38.42	20.46	2.98	36.23	19.60	3.31	33.88	18.68	3.70	31.34	17.68	4.14	22.2	2.40	20.46	2.71	19.40	2.99
	57 (13.9)	35.46	35.46	2.39	34.08	2.66	32.59	2.96	30.99	3.30	29.24	3.69	27.32	4.13	22.2	2.40	20.46	2.71	19.40	2.99					
1200	62 (16.7)	36.21	33.75	2.39	34.54	2.66	32.81	31.79	2.96	31.05	31.05	3.30	29.29	3.69	27.37	4.13	22.2	2.40	20.46	2.71	19.40	2.99			
	63 (17.2)	36.62	27.38	2.39	34.89	26.53	2.66	33.05	25.66	2.96	31.08	24.72	3.30	28.96	23.70	3.68	26.68	22.59	4.13	22.2	2.40	20.46	2.71	19.40	2.99
	67 (19.4)	39.61	28.66	2.41	37.76	27.82	2.69	35.80	26.95	2.98	33.70	26.01	3.32	31.44	25.00	3.71	29.01	23.90	4.15	22.2	2.40	20.46	2.71	19.40	2.99
	72 (22.2)	43.49	23.23	2.44	41.47	22.43	2.72	39.34	21.59	3.02	37.05	20.70	3.35	34.60	19.74	3.74	31.95	18.70	4.17	22.2	2.40	20.46	2.71	19.40	2.99
	57 (13.9)	36.89	36.89	2.43	35.42	2.70	33.84	3.00	32.14	3.34	30.28	3.72	28.26	4.17	22.2	2.40	20.46	2.71	19.40	2.99					
	62 (16.7)	37.18	35.89	2.43	35.49	2.70	33.90	3.00	32.19	3.34	30.33	3.72	28.31	4.17	22.2	2.40	20.46	2.71	19.40	2.99					
1350	63 (17.2)	37.42	29.04	2.43	35.62	28.17	2.70	33.71	27.26	2.99	31.67	26.28	3.33	29.48	25.20	3.72	27.14	24.02	4.16	22.2	2.40	20.46	2.71	19.40	2.99
	67 (19.4)	40.44	30.46	2.45	38.52	29.60	2.72	36.49	28.69	3.02	34.31	27.70	3.36	31.98	26.64	3.74	29.48	25.47	4.18	22.2	2.40	20.46	2.71	19.40	2.99
	72 (22.2)	44.37	24.36	2.48	42.29	23.54	2.75	40.06	22.67	3.05	37.69	21.74	3.39	35.15	20.74	3.77	32.42	19.67	4.21	22.2	2.40	20.46	2.71	19.40	2.99

*At 75°F (23.9°C) entering dry bulb—Tennessee Valley Authority (TVA) rating conditions; all others at 80°F (26.7°C) entering dry bulb. See Legend and Notes.

36 Heating Extended Performance Table -10-60 (-23.3-15.6°C)

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES deg F (deg C)																				
		20 (-6.7)				30 (-1.1)																
EDB	CFM	-10 (-23.3)		0 (-17.8)		10 (-12.2)		20 (-6.7)		30 (-1.1)		40 (4.4)		50 (10)		60 (15.6)						
		Total	Integ	Total	Sys	Total	Integ	Total	Sys	Total	Integ	Total	Sys	Total	Integ	Total	Integ	Total	Sys			
(18.3)	65 1050	12.06	11.10	2.28	15.34	14.11	2.37	19.31	17.73	2.48	22.99	20.85	2.57	27.20	23.83	2.67	32.01	2.79	37.62	2.96	44.15	3.17
	66 1200	12.24	11.26	2.28	15.55	14.31	2.37	19.49	17.89	2.46	23.21	21.05	2.54	27.49	24.09	2.73	32.36	2.75	38.06	2.92	43.75	3.10
	67 1350	12.40	11.41	2.29	15.73	14.47	2.37	19.66	18.05	2.46	23.40	21.22	2.53	27.72	24.29	2.72	32.62	2.73	38.08	2.98	42.98	3.07
	70 1050	11.60	10.67	2.40	14.89	13.70	2.49	19.02	17.45	2.61	22.66	20.55	2.69	26.81	23.49	2.80	31.55	2.93	37.02	3.10	43.57	3.32
	71 1200	11.79	10.84	2.40	15.10	13.89	2.49	19.22	17.64	2.59	22.88	20.75	2.67	27.09	23.74	2.88	31.91	2.97	37.47	3.10	43.39	3.24
	72 1350	11.95	10.99	2.41	15.28	14.06	2.49	19.39	17.80	2.59	23.08	20.93	2.66	27.33	23.94	2.74	32.17	2.86	37.72	3.02	42.75	3.21
(21.1)	75 1050	11.10	10.21	2.52	14.41	13.26	2.49	18.18	16.69	2.72	22.35	20.27	2.83	26.42	23.15	2.94	31.08	3.07	36.44	3.24	42.87	3.48
	76 1200	11.29	10.38	2.53	14.62	13.46	2.62	18.52	17.00	2.71	22.56	20.46	2.81	26.70	23.40	2.90	31.43	3.02	36.87	3.18	42.98	3.39
(23.9)	75 1350	11.45	10.53	2.54	14.81	13.62	2.62	18.95	17.40	2.71	22.75	20.64	2.79	26.93	23.60	2.88	31.71	2.99	37.19	3.17	42.46	3.36

PERFORMANCE DATA (CONT)

42 Cooling Extended Performance Table

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F (deg C)							
		85 (29.4)				95 (35)			
CFM	EWB	75 (23.9)		Capacity MBtuh		Total Sys kW		Capacity MBtuh	
		Total	Sens	Total	Sens	Total	Sens	Total	Sens
1225	57 (13.9)	38.52	38.52	2.64	36.98	2.93	35.30	3.27	33.49
	62 (16.7)	40.25	36.53	2.66	38.38	2.95	36.38	3.28	34.25
	63 (17.2)	40.42	29.59	2.66	38.51	2.95	36.47	27.40	34.29
	67 (19.4)	43.85	31.00	2.69	41.76	29.93	39.56	28.79	37.21
	72 (22.2)	47.65	25.61	2.73	45.34	24.58	3.02	42.92	23.50
	57 (13.9)	40.25	40.25	2.70	38.58	2.99	36.77	36.77	34.83
1400	62 (16.7)	41.40	39.06	2.71	39.43	3.00	37.36	36.48	33.33
	63 (17.2)	41.51	31.29	2.71	39.49	30.16	37.35	28.97	33.33
	67 (19.4)	45.01	32.87	2.74	42.81	31.72	3.04	40.50	30.50
	72 (22.2)	48.85	26.74	2.78	46.43	25.66	3.08	43.87	24.51
	57 (13.9)	41.72	41.72	2.75	39.93	3.05	38.01	3.39	35.94
	62 (16.7)	42.39	41.37	2.76	40.36	39.99	3.05	38.18	3.39
1575	63 (17.2)	42.38	32.88	2.76	40.28	31.70	3.05	38.04	30.44
	67 (19.4)	45.94	34.61	2.79	43.65	33.40	3.09	41.24	32.12
	72 (22.2)	49.80	27.78	2.84	47.28	26.65	3.14	44.62	25.45
	57 (13.9)	42.39	41.37	2.76	40.36	39.99	3.05	38.18	3.39
	62 (16.7)	42.38	32.88	2.76	40.28	31.70	3.05	38.04	30.44
	63 (17.2)	45.94	34.61	2.79	43.65	33.40	3.09	41.24	32.12

*At 75°F (23.9°C) entering dry bulb—Tennessee Valley Authority (TVA) rating conditions; all others at 80°F (26.7°C) entering dry bulb. See Legend and Notes.

42 Heating Extended Performance Table -10-60 (-23.3-15.6°C)

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES deg F (deg C)									
		20 (-6.7)				30 (-1.1)					
EDB	CFM	-10 (-23.3)		0 (-17.8)		10 (-12.2)		Total Capacity MBtuh		Total Sys kW	
		Total	Integ	Total	Integ	Total	Integ	Total	Integ	Total	Integ
65 (18.3)	1225 1400	13.77	12.67	2.42	17.68	2.53	21.89	20.09	2.72	25.94	23.53
	13.95 14.11	12.83	2.44	17.89	16.46	2.59	22.07	20.26	2.72	23.74	22.82
	13.95 14.11	12.98	2.46	18.12	16.68	2.61	22.25	20.42	2.73	23.93	23.02
	13.46 14.00	12.38	2.56	17.32	15.93	2.72	21.69	19.91	2.86	23.65	22.86
	13.46 14.00	12.56	2.57	17.54	16.14	2.72	21.88	20.08	2.85	23.48	22.69
	13.46 14.00	12.72	2.59	17.73	16.32	2.74	22.04	20.23	2.85	23.68	22.91
70 (21.1)	1225 1400	13.65	12.52	2.42	17.73	16.92	15.57	21.46	19.70	3.00	25.36
	13.82 14.00	12.69	2.59	17.73	16.92	15.57	21.67	19.89	3.00	25.60	23.21
	13.07 14.00	12.21	2.71	17.15	15.78	2.86	21.67	19.89	3.01	25.80	23.40
	13.45 14.00	12.38	2.73	17.36	15.97	2.88	21.83	20.04	3.09	26.56	3.19
	13.45 14.00	12.73	2.73	17.73	16.32	2.74	22.04	20.23	2.85	23.68	22.91
	13.45 14.00	12.73	2.73	17.73	16.32	2.74	22.04	20.23	2.85	23.68	22.91
75 (23.9)	1225 1400	13.27	12.21	2.42	17.15	15.78	2.86	21.67	19.89	3.09	26.54
	13.45 14.00	12.38	2.56	17.36	15.97	2.88	21.83	20.04	3.09	26.56	3.19
	13.45 14.00	12.73	2.73	17.73	16.32	2.74	22.04	20.23	2.85	23.68	22.91
	13.45 14.00	12.73	2.73	17.73	16.32	2.74	22.04	20.23	2.85	23.68	22.91
	13.45 14.00	12.73	2.73	17.73	16.32	2.74	22.04	20.23	2.85	23.68	22.91
	13.45 14.00	12.73	2.73	17.73	16.32	2.74	22.04	20.23	2.85	23.68	22.91

677°C---B

PERFORMANCE DATA (CONT)
48 Cooling Extended Performance Table

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F (deg C)							
		85 (29.4)				95 (35)			
CFM	EWB	75 (23.9)		Capacity MBtuh		Total Sys kW		Capacity MBtuh	
		Total	Sens	Total	Sens	Total	Sens	Total	Sens
57 (13.9)	44.75	44.75	3.06	42.98	3.39	41.06	3.77	39.00	4.20
62 (16.7)	46.12	41.54	3.07	43.97	3.40	41.68	30.04	37.55	4.20
63 (17.2)	46.70	33.68	3.07	44.47	32.60	3.41	42.08	31.45	30.23
67 (19.4)	50.55	35.24	3.10	48.13	34.15	3.43	45.54	32.98	31.75
72 (22.2)	55.52	28.74	3.13	52.82	27.67	3.47	49.97	26.55	3.84
57 (13.9)	46.77	46.77	3.13	44.87	3.47	42.79	38.5	40.57	4.27
62 (16.7)	47.44	44.50	3.14	45.22	3.47	42.89	38.5	40.63	4.27
63 (17.2)	47.85	35.90	3.14	45.50	34.77	3.47	42.99	33.55	3.85
67 (19.4)	51.78	37.65	3.17	49.22	36.50	3.50	46.50	35.26	3.88
72 (22.2)	56.83	30.24	3.20	53.99	29.12	3.53	51.00	27.94	3.91
57 (13.9)	48.51	48.51	3.20	46.46	3.54	44.24	44.24	3.92	41.88
62 (16.7)	48.63	48.63	3.20	46.54	3.54	44.31	43.92	41.95	4.34
63 (17.2)	48.76	38.03	3.20	46.31	3.54	43.69	35.57	3.91	40.94
67 (19.4)	52.73	39.96	3.23	50.06	38.75	3.56	47.24	37.47	3.94
72 (22.2)	57.85	31.65	3.26	54.90	30.49	3.60	51.79	29.26	3.97

*At 75°F (23.9°C) entering dry bulb—Tennessee Valley Authority [TVA] rating conditions; all others at 80°F (26.7°C) entering dry bulb. See Legend and Notes.

48 Heating Extended Performance Table -10-60 (-23.3-15.6°C)

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES deg F (deg C)							
		20 (-6.7)				30 (-1.1)			
EDB	CFM	-10 (-23.3)		0 (-17.8)		10 (-12.2)		Capacity MBtuh	
		Total	Integ	Total	Integ	Total	Integ	Total	Integ
65 (18.3)	1400	15.24	14.02	3.00	20.15	18.54	3.09	25.29	23.21
66 (18.3)	1600	15.50	14.26	3.04	20.44	18.80	3.12	25.55	23.45
70 (21.1)	1400	14.75	13.57	3.12	19.66	18.09	3.22	22.96	20.57
70 (21.1)	1600	15.01	13.81	3.16	19.94	18.34	3.25	25.26	23.19
75 (23.9)	1400	14.22	13.08	3.21	20.24	18.62	3.29	25.51	23.41
75 (23.9)	1600	14.48	13.32	3.29	19.44	17.89	3.36	24.97	22.92

48 Heating Extended Performance Table -10-60 (-23.3-15.6°C)

INDOOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F (deg C)							
		115 (46.1)				125 (51.7)			
EDB	CFM	Capacity MBtuh		Total Sys kW		Capacity MBtuh		Total Sys kW	
		Total	Integ	Total	Integ	Total	Integ	Total	Integ
65 (18.3)	1400	15.24	14.02	3.00	20.15	18.54	3.09	25.29	23.21
66 (18.3)	1600	15.50	14.26	3.04	20.44	18.80	3.12	25.55	23.45
70 (21.1)	1400	14.75	13.57	3.12	19.66	18.09	3.22	22.96	20.57
70 (21.1)	1600	15.01	13.81	3.16	19.94	18.34	3.25	25.26	23.19
75 (23.9)	1400	14.22	13.08	3.21	20.24	18.62	3.29	25.51	23.41
75 (23.9)	1600	14.48	13.32	3.29	19.44	17.89	3.36	24.97	22.92

PERFORMANCE DATA (CONT) 60 Cooling Extended Performance Table

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F (deg C)																	
		85 (29.4)				95 (35)													
CFM	EWB	Capacity MBuh		Capacity MBuh		Total Sys kW		Capacity MBuh		Total Sys kW		Capacity MBuh		Total Sys kW		Capacity MBuh		Total Sys kW	
		Total	Sens	Total	Sens	Total	Sens	Total	Sens	Total	Sens	Total	Sens	Total	Sens	Total	Sens	Total	Sens
1750	57 (13.9)	56.58	56.58	3.82	54.25	4.23	51.74	4.69	49.03	5.20	46.02	5.80	42.74	4.274	6.47				
	62 (16.7)	58.15	51.34	3.84	55.29	4.24	52.31	4.69	49.14	5.21	46.10	5.80	42.80	4.280	6.47				
	63 (17.2)	58.96	41.68	3.85	56.05	4.03	52.93	4.70	49.57	5.21	45.96	5.80	5.79	42.09	34.04	6.46			
	67 (19.4)	63.58	43.48	3.90	60.40	42.13	4.30	57.00	40.70	4.75	53.35	39.18	5.26	49.42	37.52	5.84	45.21	35.73	6.50
	72 (22.2)	69.81	35.09	3.96	66.25	33.84	4.37	62.44	32.52	4.82	58.39	31.04	5.33	54.03	29.43	5.90	49.34	27.71	6.55
	57 (13.9)	59.07	59.07	3.93	56.53	4.33	53.81	4.79	50.87	5.31	47.61	5.89	44.07	44.07	6.56				
	62 (16.7)	59.71	50.08	3.93	56.79	4.34	53.90	4.79	50.94	5.31	47.68	5.90	44.13	44.13	6.56				
2000	63 (17.2)	60.33	44.49	3.94	57.22	43.10	4.34	53.93	41.62	4.79	50.41	40.03	5.30	46.64	38.29	5.88	42.63	36.38	6.54
	67 (19.4)	64.95	46.50	3.99	61.60	45.09	4.39	58.02	43.59	4.84	54.20	41.98	5.35	50.08	40.22	5.93	45.71	38.29	6.58
	72 (22.2)	71.19	37.15	4.06	67.47	35.74	4.46	63.50	34.29	4.91	59.27	32.74	5.42	54.69	31.06	5.99	49.83	29.27	6.63
	57 (13.9)	61.14	61.14	4.03	58.43	4.43	55.52	4.89	52.36	5.40	48.89	5.99	45.23	45.23	6.65				
	62 (16.7)	61.25	4.03	58.52	4.43	55.60	4.89	52.43	5.40	48.95	5.99	45.28	45.28	6.65					
	63 (17.2)	61.37	47.18	4.03	58.11	45.72	4.43	54.69	44.17	4.88	51.04	42.48	5.38	47.15	40.61	5.96	43.03	38.53	6.62
	67 (19.4)	65.96	49.40	4.08	62.50	47.93	4.48	58.79	46.35	4.93	54.82	44.65	5.44	50.57	42.76	6.01	46.07	40.65	6.66
2250	72 (22.2)	72.28	38.89	4.15	68.41	37.47	4.55	64.28	35.97	5.00	59.88	34.37	5.51	55.14	32.63	6.08	50.13	30.78	6.71

*At 75°F (23.9°C) entering dry bulb—Tennessee Valley Authority (TVA) rating conditions; all others at 80°F (26.7°C) entering dry bulb. See Legend and Notes.

60 Heating Extended Performance Table -10-60 (-23.3-15.6°C)

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES deg F (deg C)																			
		20 (-6.7)				30 (-1.1)															
EDB	CFM	Capacity MBuh		Capacity MBuh		Capacity MBuh		Capacity MBuh		Total Sys kW		Capacity MBuh		Total Sys kW		Capacity MBuh		Total Sys kW			
		Total	Integ	Total	Integ	Total	Integ	Total	Integ	Total	Integ	Total	Integ	Total	Integ	Total	Integ	Total	Integ		
65 (18.3)	1750	21.10	19.41	3.70	26.76	3.86	32.87	30.17	4.02	39.65	4.20	46.23	40.51	4.36	53.69	4.55	62.45	4.80	72.83	5.13	
	2000	21.50	19.78	3.75	27.19	25.02	3.90	33.42	30.68	4.05	40.65	4.20	46.75	40.96	4.35	54.33	4.52	63.26	4.75	73.85	5.06
	2250	21.87	20.12	3.81	27.58	25.37	3.95	34.54	31.70	4.11	40.41	4.23	47.21	41.37	4.36	54.88	4.52	63.92	4.74	74.66	5.04
	1750	20.30	18.67	3.85	26.01	23.93	4.02	32.15	29.51	4.19	39.25	4.39	45.69	40.03	4.56	52.88	4.76	61.38	5.02	71.76	5.35
	2000	20.71	19.05	3.90	26.46	24.34	4.06	32.62	29.94	4.22	39.63	4.39	46.19	40.47	4.55	53.62	4.73	62.37	4.96	72.76	5.27
	2250	21.08	19.39	4.11	24.71	4.25	40.01	36.29	4.42	46.63	4.63	49.16	44.56	4.55	54.16	4.73	63.03	4.95	73.56	5.26	
	1750	19.43	17.88	4.01	25.22	23.21	4.19	31.39	28.81	4.38	38.81	4.60	45.73	40.94	4.78	52.29	4.98	60.72	5.24	70.71	5.58
75 (23.9)	2000	19.85	18.26	4.06	25.67	23.62	4.23	31.88	29.26	4.40	39.22	4.60	45.64	40.99	4.76	52.90	4.95	61.50	5.18	71.69	5.50
	2250	20.22	18.61	4.12	26.07	23.98	4.28	32.31	29.65	4.44	39.61	4.62	46.08	40.37	4.77	53.44	4.94	62.15	5.16	72.44	5.47

LEGEND

BF	— Bypass Factor
edb	— Entering Dry-Bulb
Ewb	— Entering Wet-Bulb
kW	— Total Unit Power Input
SHC	— Sensible Heat Capacity (1000 Btu/h)
TC	— Total Capacity (1000 Btu/h) (net)
rh	— Relative Humidity

COOLING NOTES:

1. Ratings are net; they account for the effects of the evaporator –fan motor power and heat.
2. Direct interpolation is permissible. Do not extrapolate.
3. The following formulas may be used:

$$t_{db} = t_{edb} - \frac{\text{Sensible capacity (Btu/h)}}{1.10 \times \text{cfm}}$$

t_{wbt} = Wet-bulb temperature corresponding to enthalpy
air leaving evaporator coil (h_{wbt})

Where: h_{ewo} = Enthalpy of air entering evaporator coil

4. The SHC is based on 80°F (26.7°C) edb temperature of air entering evaporator coil. Below 80°F (26.7°C) edb, subtract (corr factor × cfm) from SHC. Above 80°F (26.7°C) edb, add (corr factor × cfm) to SHC.
Correction Factor = $1.10 \times (1 + BF) \times (edb - 80)$.
5. Integrated capacity is maximum (instantaneous) capacity less the effect of frost on the outdoor coil and the heat required to defrost it.

$$h_{wbt} = h_{ewo} - \frac{\text{total capacity (Btu/h)}}{4.5 \times \text{cfm}}$$

PERFORMANCE DATA (CONT)

Natural Gas Orifice Sizes and Manifold Pressure, Single Phase Models

Nameplate Input (Btu/hr)		ALTITUDE OF INSTALLATION (FT. ABOVE SEA LEVEL) U.S.A.*				
		0 to 2000 (0–610 m)	2001 to 3000* (611 to 914 m)	3001 to 4000 (915 to 1219 m)	4001 to 5000 (1220 to 1524 m)	5001 to 6000 (1524 to 1829 m)
40000	Orifice No. (Qty)	44 (2)	45 (2)†	48 (2)†	48 (2)†	48 (2)†
	Manifold Press. (in. W.C.)	3.2	3.2	3.8	3.5	3.2
60000	Orifice No. (Qty)	44 (3)	45 (3)†	48 (3)†	48 (3)†	48 (3)†
	Manifold Press. (in. W.C.)	3.2	3.2	3.8	3.5	3.2
90000	Orifice No. (Qty)	38 (3)	41 (3)†	41 (3)†	42 (3)†	42 (3)†
	Manifold Press. (in. W.C.)	3.6	3.8	3.4	3.4	3.2
115000	Orifice No. (Qty)	33 (3)	36 (3)†	36 (3)†	36 (3)†	38 (3)†
	Manifold Press. (in. W.C.)	3.8	3.8	3.6	3.3	3.6
127000	Orifice No. (Qty)	31 (3)	31 (3)	33 (3)†	33 (3)†	34 (3)†
	Manifold Press. (in. W.C.)	3.7	3.2	3.5	3.2	3.2

*In the U.S.A., the input rating for altitudes above 2000 ft (610m) must be reduced by 4% for each 1000 ft (305 m) above sea level.

In Canada, the input rating for altitudes from 2001 to 4500 ft (611 to 1372 m) above sea level must be derated by 10% by an authorized gas conversion station or dealer.

For Canadian Installations from 2000 to 4500 ft, use U.S.A. column 2001 to 3000 ft.

Note: Orifice sizes and manifold pressure settings are based on natural gas with a heating value of 1025 Btu/ft³ and a specific gravity of .6.

† Orifices available through your distributor.

Natural Gas Orifice Sizes and Manifold Pressure, Three Phase Models

Nameplate Input (Btu/hr)		ALTITUDE OF INSTALLATION (FT. ABOVE SEA LEVEL) U.S.A.*				
		0 to 2000 (0–610 m)	2001 to 3000* (611 to 914 m)	3001 to 4000 (915 to 1219 m)	4001 to 5000 (1220 to 1524 m)	5001 to 6000 (1524 to 1829 m)
40000	Orifice No. (Qty)	44 (2)	45 (2)†	48 (2)†	48 (2)†	48 (2)†
	Manifold Press. (in. W.C.)	3.2	3.2	3.8	3.5	3.2
60000	Orifice No. (Qty)	38 (2)	41 (2)†	41 (2)†	42 (2)†	42 (2)†
	Manifold Press. (in. W.C.)	3.6	3.8	3.4	3.4	3.2
90000	Orifice No. (Qty)	38 (3)	41 (3)†	41 (3)†	42 (3)†	42 (3)†
	Manifold Press. (in. W.C.)	3.6	3.8	3.4	3.4	3.2
115000	Orifice No. (Qty)	33 (3)	36 (3)†	36 (3)†	36 (3)†	38 (3)†
	Manifold Press. (in. W.C.)	3.8	3.8	3.6	3.3	3.6
130000	Orifice No. (Qty)	31 (3)	31 (3)	33 (3)†	33 (3)†	34 (3)†
	Manifold Press. (in. W.C.)	3.8	3.2	3.7	3.4	3.3

*In the U.S.A., the input rating for altitudes above 2000 ft (610m) must be reduced by 4% for each 1000 ft (305 m) above sea level.

In Canada, the input rating for altitudes from 2001 to 4500 ft (611 to 1372 m) above sea level must be derated by 10% by an authorized gas conversion station or dealer.

For Canadian Installations from 2000 to 4500 ft, use U.S.A. column 2001 to 3000 ft.

Note: Orifice sizes and manifold pressure settings are based on natural gas with a heating value of 1025 Btu/ft³ and a specific gravity of .6.

† Orifices available through your distributor.

Propane Gas Orifice Sizes and Manifold Pressure, Single Phase Models

Nameplate Input (Btu/hr)		ALTITUDE OF INSTALLATION (FT. ABOVE SEA LEVEL) U.S.A.*				
		0 to 2000 (0–610 m)	2001 to 3000* (611 to 914 m)	3001 to 4000 (915 to 1219 m)	4001 to 5000 (1220 to 1524 m)	5001 to 6000 (1524 to 1829 m)
40000	Orifice No. (Qty)	55 (2)	56 (2)	56 (2)	56 (2)	56 (2)
	Manifold Press. (IN. W.C.)	10.0	11.0	11.0	11.0	10.7
60000	Orifice No. (Qty)	55 (3)	56 (3)	56 (3)	56 (3)	56 (3)
	Manifold Press. (IN. W.C.)	10.0	11.0	11.0	11.0	10.7
90000	Orifice No. (Qty)	53 (3)	54 (3)	54 (3)	54 (3)	54 (3)
	Manifold Press. (IN. W.C.)	10.0	11.0	11.0	11.0	11.0
115000	Orifice No. (Qty)	51 (3)	52 (3)	52 (3)	53 (3)	53 (3)
	Manifold Press. (IN. W.C.)	10.0	11.0	10.6	11.0	11.0
127000	Orifice No. (Qty)	49 (3)	50 (3)	51 (3)	52 (3)	52 (3)
	Manifold Press. (IN. W.C.)	10.0	11.0	11.0	11.0	11.0

*In the U.S.A., the input rating for altitudes above 2000 ft (610m) must be reduced by 4% for each 1000 ft (305 m) above sea level.

In Canada, the input rating for altitudes from 2001 to 4500 ft (611 to 1372 m) above sea level must be derated by 10% by an authorized gas conversion station or dealer.

For Canadian Installations from 2000 to 4500 ft (610–1372 m), use U.S.A. column 2001 to 3000 ft (611 to 914 m).

†Use Kit No. CPLPConv013C00 (0–2000 ft [0–610 m] above sea level). Use Kit No. CPLPConv014C00 (2001–6000 ft [611–1829 m] above sea level).

Propane Gas Orifice Sizes and Manifold Pressure, Three Phase Models

Nameplate Input (Btu/hr)		ALTITUDE OF INSTALLATION (FT. ABOVE SEA LEVEL) U.S.A.*				
		0 to 2000 (0–610 m)	2001 to 3000* (611 to 914 m)	3001 to 4000 (915 to 1219 m)	4001 to 5000 (1220 to 1524 m)	5001 to 6000 (1524 to 1829 m)
40000	Orifice No. (Qty)	55 (2)	56 (2)	56 (2)	56 (2)	56 (2)
	Manifold Press. (IN. W.C.)	10.0	11.0	11.0	11.0	10.7
60000	Orifice No. (Qty)	53 (2)	54 (2)	54 (2)	54 (2)	54 (2)
	Manifold Press. (IN. W.C.)	10.0	11.0	11.0	11.0	11.0
90000	Orifice No. (Qty)	53 (3)	54 (3)	54 (3)	54 (3)	54 (3)
	Manifold Press. (IN. W.C.)	10.0	11.0	11.0	11.0	11.0
115000	Orifice No. (Qty)	51 (3)	52 (3)	52 (3)	53 (3)	53 (3)
	Manifold Press. (IN. W.C.)	10.0	11.0	10.6	11.0	11.0
130000	Orifice No. (Qty)	49 (3)	50 (3)	51 (3)	52 (3)	52 (3)
	Manifold Press. (IN. W.C.)	10.0	11.0	11.0	11.0	11.0

*In the U.S.A., the input rating for altitudes above 2000 ft (610m) must be reduced by 4% for each 1000 ft (305 m) above sea level.

In Canada, the input rating for altitudes from 2001 to 4500 ft (611 to 1372 m) above sea level must be derated by 10% by an authorized gas conversion station or dealer.

For Canadian Installations from 2000 to 4500 ft (610–1372 m), use U.S.A. column 2001 to 3000 ft (611 to 914 m).

†Use Kit No. CPLPConv013*00 (0–2000 ft [0–610 m] above sea level). Use Kit No. CPLPConv014*00 (2001–6000 ft [611–1829 m] above sea level).

High Altitude Compensation, Propane Gas, Single Phase Models

Nameplate Input (Btu/hr)	Rated Heating Input (Btu/hr), Propane Gas at Installation Altitude Above Sea Level, U.S.A.*				
	0 to 2000 ft (0–610 m)	2001 to 3000 ft* (611 to 914 m)	3001 to 4000 ft (915 to 1219 m)	4001 to 5000 ft (1220 to 1524 m)	5001 to 6000 ft (1524 to 1829 m)
40000	38000	31700	31700	31700	31200
60000	57000	47500	47500	47500	46900
90000	79000	68900	68900	68600	68600
115000	103000	100400	98900	83000	83000
127000	116000	115500	111800	101300	100400

*In the U.S.A., the input rating for altitudes above 2000 ft (610m) must be reduced by 4% for each 1000 ft (305 m) above sea level.

In Canada, the input rating for altitudes from 2001 to 4500 ft (611 to 1372 m) above sea level must be derated by 10% by an authorized gas conversion station or dealer.

For Canadian Installations from 2000 to 4500 ft (610–1372 m), use U.S.A. column 2001 to 3000 ft (611 to 914 m).

High Altitude Compensation, Propane Gas, Three Phase Models

Nameplate Input (Btu/hr)	Rated Heating Input (Btu/hr), Propane Gas at Installation Altitude Above Sea Level, U.S.A.*				
	0 to 2000 ft (0–610 m)	2001 to 3000 ft* (611 to 914 m)	3001 to 4000 ft (915 to 1219 m)	4001 to 5000 ft (1220 to 1524 m)	5001 to 6000 ft (1524 to 1829 m)
40000	38000	31700	31700	31700	31200
60000	53000	45900	45900	45800	45800
90000	79000	68900	68900	68600	68600
115000	103000	100400	98900	83000	83000
130000	116000	115500	111800	101300	100400

*In the U.S.A., the input rating for altitudes above 2000 ft (610m) must be reduced by 4% for each 1000 ft (305 m) above sea level.

In Canada, the input rating for altitudes from 2001 to 4500 ft (611 to 1372 m) above sea level must be derated by 10% by an authorized gas conversion station or dealer.

For Canadian Installations from 2000 to 4500 ft (610–1372 m), use U.S.A. column 2001 to 3000 ft (611 to 914 m).

High Altitude Compensation, Natural Gas, Single Phase Models

Nameplate Input (Btu/hr)	Rated Heating Input (Btu/hr), Natural Gas at Installation Altitude Above Sea Level, U.S.A.*				
	0 to 2000 ft (0–610 m)	2001 to 3000 ft* (611 to 914 m)	3001 to 4000 ft (915 to 1219 m)	4001 to 5000 ft (1220 to 1524 m)	5001 to 6000 ft (1524 to 1829 m)
40000	40000	36000	34400	32800	31200
60000	60000	54000	51600	49200	46800
90000	90000	81000	77400	73800	70200
115000	115000	103500	98900	94300	89700
127000	127000	143000	109200	104100	99100

*In the U.S.A., the input rating for altitudes above 2000 ft (610m) must be reduced by 4% for each 1000 ft (305 m) above Sea level.

In Canada, the input rating for altitudes from 2001 to 4500 ft (611 to 1372 m) above sea level must be derated by 10% by an authorized gas conversion station or dealer.

For Canadian Installations from 2000 to 4500 ft (610–1372 m), use U.S.A. column 2001 to 3000 ft (611 to 914 m).

High Altitude Compensation, Natural Gas, Three Phase Models

Nameplate Input (Btu/hr)	Rated Heating Input (Btu/hr), Natural Gas at Installation Altitude Above Sea Level, U.S.A.*				
	0 to 2000 ft (0–610 m)	2001 to 3000 ft* (611 to 914 m)	3001 to 4000 ft (915 to 1219 m)	4001 to 5000 ft (1220 to 1524 m)	5001 to 6000 ft (1524 to 1829 m)
40000	40000	36000	34400	32800	31200
60000	60000	54000	51600	49200	46800
90000	90000	81000	77400	73800	70200
115000	115000	103500	98900	94300	89700
130000	130000	117000	111800	106600	101400

*In the U.S.A., the input rating for altitudes above 2000 ft (610m) must be reduced by 4% for each 1000 ft (305 m) above Sea level.

In Canada, the input rating for altitudes from 2001 to 4500 ft (611 to 1372 m) above sea level must be derated by 10% by an authorized gas conversion station or dealer.

For Canadian Installations from 2000 to 4500 ft (610–1372 m), use U.S.A. column 2001 to 3000 ft (611 to 914 m).

Dry Coil Air Delivery* - Horizontal and Downflow Discharge 24-60 230VAC 1-Phase

Unit Size	Heating Rise Range °F (°C)	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
24040 25 - 55 (14 - 31)	Low ¹	Blue	CFM	774	700	623	546	439	339	---	---
			BHP	0.12	0.13	0.13	0.14	0.14	0.15	---	---
	Med-Low ³	Pink	Heat Rise (°F)	39	43	48	55	NA	NA	NA	NA
			Heat Rise (°C)	21	24	27	30	NA	NA	NA	NA
	Medium ²	Red	CFM	804	734	659	574	482	387	---	---
			BHP	0.13	0.14	0.14	0.15	0.15	0.16	---	---
	High	Orange	Heat Rise (°F)	37	41	45	52	NA	NA	NA	NA
			Heat Rise (°C)	21	23	25	29	NA	NA	NA	NA
24060 25 - 55 (14 - 31)	Med-High	Black	CFM	842	787	715	641	556	461	382	---
			BHP	0.15	0.16	0.16	0.17	0.17	0.18	0.19	---
	Low ³	Blue	CFM	920	868	803	738	654	570	491	404
			BHP	0.18	0.19	0.19	0.20	0.21	0.21	0.22	0.23
	Med-Low	Pink	Heat Rise (°F)	33	35	37	41	46	53	NA	NA
			Heat Rise (°C)	18	19	21	23	25	29	NA	NA
	Medium ²	Red	CFM	1125	1075	1019	956	891	825	760	695
			BHP	0.30	0.31	0.32	0.32	0.33	0.34	0.34	0.35
	High	Orange	CFM	774	700	623	546	439	339	---	---
			BHP	0.12	0.13	0.13	0.14	0.14	0.15	---	---
24060 25 - 55 (14 - 31)	Med-High	Black	CFM	804	734	659	574	482	387	---	---
			BHP	0.13	0.14	0.14	0.15	0.15	0.16	---	---
	Low ³	Blue	CFM	920	868	803	738	654	570	491	404
			BHP	0.18	0.19	0.19	0.20	0.21	0.22	0.23	---
	Med-Low	Pink	Heat Rise (°F)	49	52	NA	NA	NA	NA	NA	NA
			Heat Rise (°C)	27	29	NA	NA	NA	NA	NA	NA
	Medium ²	Red	CFM	1125	1075	1019	956	891	825	760	695
			BHP	0.30	0.31	0.32	0.32	0.33	0.34	0.35	0.34
	High	Black	CFM	842	787	715	641	556	461	382	---
			BHP	0.15	0.16	0.16	0.17	0.17	0.18	0.19	---
	High ¹	Black	CFM	920	868	803	738	654	570	491	404
			BHP	0.30	0.31	0.32	0.32	0.33	0.34	0.35	0.34
	Med-High	Orange	Heat Rise (°F)	40	42	44	47	51	55	NA	NA
			Heat Rise (°C)	22	23	25	26	28	30	NA	NA

Dry Coil Air Delivery* - Horizontal and Downflow Discharge 24-60 230VAC 1-Phase (Cont)

Unit Size	Heating Rise Range °F (°C)	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
30040 25 - 55 (14 - 31)	Low ¹	Blue	CFM	774	700	623	546	439	339	---	---
			BHP	0.12	0.13	0.13	0.14	0.14	0.15	---	---
		Heat Rise (°F)		39	43	48	55	NA	NA	NA	NA
		Heat Rise (°C)		21	24	27	30	NA	NA	NA	NA
		CFM		906	843	771	707	624	548	451	340
	Med-Low ³	Pink	BHP	0.18	0.18	0.19	0.20	0.20	0.21	0.21	---
			Heat Rise (°F)	33	36	39	42	48	55	NA	NA
		Heat Rise (°C)		18	20	22	24	27	30	NA	NA
		CFM		1008	942	872	804	734	647	546	510
		BHP		0.22	0.23	0.24	0.24	0.24	0.26	0.26	0.27
30060 25 - 55 (14 - 31)	Medium	Red	Heat Rise (°F)	30	32	34	37	41	46	55	NA
			Heat Rise (°C)	17	18	19	21	23	26	30	NA
		CFM		1047	997	931	875	804	737	676	584
		BHP		0.25	0.26	0.26	0.27	0.28	0.28	0.29	0.30
		Heat Rise (°F)		29	30	32	34	37	41	44	51
	Med-High ²	Orange	CFM	1125	1075	1019	956	891	825	760	695
			BHP	0.30	0.31	0.32	0.32	0.33	0.34	0.34	0.35
		Heat Rise (°C)		16	17	18	19	21	23	25	28
		CFM		774	700	623	546	439	339	---	---
		BHP		0.12	0.13	0.13	0.14	0.14	0.15	---	---
30060 25 - 55 (14 - 31)	High	Black	Heat Rise (°F)	27	28	29	31	34	36	39	43
			Heat Rise (°C)	15	15	16	17	19	20	22	24
		CFM		906	843	771	707	624	548	451	340
		BHP		0.18	0.18	0.19	0.20	0.20	0.21	0.21	0.22
		Heat Rise (°F)		50	NA						
	Low ³	Blue	CFM	1008	942	872	804	734	647	546	510
			BHP	0.22	0.23	0.24	0.24	0.24	0.26	0.26	0.27
		Heat Rise (°C)		45	48	52	NA	NA	NA	NA	NA
		CFM		1047	997	931	875	804	737	676	584
		BHP		0.25	0.26	0.26	0.27	0.28	0.28	0.29	0.30
30060 25 - 55 (14 - 31)	Med-High ²	Orange	Heat Rise (°F)	43	45	48	51	NA	NA	NA	NA
			Heat Rise (°C)	24	25	27	29	NA	NA	NA	NA
		CFM		1125	1075	1019	956	891	825	760	695
		BHP		0.30	0.31	0.32	0.32	0.33	0.34	0.35	0.36
		Heat Rise (°C)		22	23	25	26	28	30	NA	NA
High ¹	Black										

Dry Coil Air Delivery* - Horizontal and Downflow Discharge 24-60 230VAC 1-Phase (Cont)

Unit Size	Heating Rise Range °F (°C)	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
36060 25 - 55 (14 - 31)	Low ³	Blue	CFM	1113	1069	1018	964	914	868	820	778
			BHP	0.16	0.17	0.18	0.19	0.20	0.21	0.23	0.24
			Heat Rise (°F)	40	42	44	47	49	52	55	NA
	Med-Low ¹	Pink	CFM	1205	1167	1120	1064	1016	975	930	886
			BHP	0.19	0.21	0.22	0.23	0.24	0.25	0.27	0.29
			Heat Rise (°C)	37	39	40	42	44	46	48	51
	Medium ²	Red	CFM	1251	1216	1171	1128	1079	1031	992	949
			BHP	0.22	0.23	0.24	0.25	0.27	0.27	0.29	0.30
			Heat Rise (°F)	36	37	38	40	42	44	45	47
36090 35 - 65 (19 - 36)	Med-High	Orange	CFM	1442	1407	1372	1326	1284	1245	1205	1160
			BHP	0.31	0.33	0.34	0.35	0.36	0.38	0.39	0.40
			Heat Rise (°F)	31	32	33	34	35	36	37	39
	High	Black	CFM	1581	1545	1509	1475	1443	1401	1357	1318
			BHP	0.39	0.41	0.43	0.44	0.46	0.47	0.49	0.51
			Heat Rise (°C)	17	18	19	19	19	20	21	22
	Low ³	Blue	CFM	1113	1069	1018	964	914	868	820	778
			BHP	0.16	0.17	0.18	0.19	0.20	0.21	0.23	0.24
			Heat Rise (°F)	28	29	30	31	31	32	33	34
36090 35 - 65 (19 - 36)	Med-Low	Pink	CFM	1251	1216	1171	1128	1079	1031	992	949
			BHP	0.19	0.21	0.22	0.23	0.24	0.25	0.27	0.29
			Heat Rise (°C)	56	58	61	64	NA	NA	NA	NA
	Medium ²	Red	CFM	1442	1407	1372	1326	1284	1245	1205	1160
			BHP	0.22	0.23	0.24	0.25	0.27	0.27	0.29	0.30
			Heat Rise (°F)	54	56	58	60	63	NA	NA	NA
	Med-High ¹	Orange	CFM	1581	1545	1509	1475	1443	1401	1357	1318
			BHP	0.31	0.33	0.34	0.35	0.36	0.38	0.39	0.40
			Heat Rise (°C)	47	48	49	51	53	55	56	59
High	Black	Black	CFM	1442	1407	1372	1326	1284	1245	1205	1160
			BHP	0.39	0.41	0.43	0.44	0.46	0.47	0.49	0.51
	Med-High	Orange	CFM	1581	1545	1509	1475	1443	1401	1357	1318
			BHP	0.39	0.41	0.43	0.44	0.46	0.47	0.49	0.51
High	Black	Black	CFM	1442	1407	1372	1326	1284	1245	1205	1160
			BHP	0.39	0.41	0.43	0.44	0.46	0.47	0.49	0.51
	Med-High	Orange	CFM	1581	1545	1509	1475	1443	1401	1357	1318
			BHP	0.39	0.41	0.43	0.44	0.46	0.47	0.49	0.51

Dry Coil Air Delivery* - Horizontal and Downflow Discharge 24-60 230VAC 1-Phase (Cont)

Unit Size	Heating Rise Range °F (°C)	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
42060 25 - 55 (14 - 31)	Low ³	Blue	CFM	1113	1069	1018	964	914	868	820	778
			BHP	0.16	0.17	0.18	0.19	0.20	0.21	0.23	0.24
			Heat Rise (°F)	40	42	44	47	49	52	55	NA
	Med-Low ¹	Pink	CFM	1205	1167	1120	1064	1016	975	930	886
			BHP	0.19	0.21	0.22	0.23	0.24	0.25	0.27	0.29
			Heat Rise (°C)	37	39	40	42	44	46	48	51
	Medium ²	Red	CFM	1442	1407	1372	1326	1284	1245	1205	1160
			BHP	0.31	0.33	0.34	0.35	0.36	0.38	0.39	0.40
			Heat Rise (°F)	31	32	33	34	35	36	37	39
	Med-High	Orange	CFM	1510	1458	1433	1390	1358	1311	1267	1227
			BHP	0.34	0.36	0.37	0.39	0.40	0.42	0.43	0.44
			Heat Rise (°C)	30	31	32	33	34	35	36	37
42090 35 - 65 (19 - 36)	High	Black	CFM	1581	1545	1509	1475	1443	1401	1357	1318
			BHP	0.39	0.41	0.43	0.44	0.46	0.47	0.49	0.49
			Heat Rise (°F)	17	18	18	19	19	20	21	22
	Low ³	Blue	CFM	1113	1069	1018	964	914	868	820	778
			BHP	0.16	0.17	0.18	0.19	0.20	0.21	0.23	0.24
			Heat Rise (°C)	16	16	17	17	17	18	18	19
	Med-Low	Pink	CFM	1205	1167	1120	1064	1016	975	930	886
			BHP	0.19	0.21	0.22	0.23	0.24	0.25	0.27	0.29
			Heat Rise (°F)	56	58	61	64	NA	NA	NA	NA
	Medium ²	Red	CFM	1442	1407	1372	1326	1284	1245	1205	1160
			BHP	0.31	0.33	0.34	0.35	0.36	0.38	0.39	0.40
			Heat Rise (°C)	47	48	49	51	53	55	56	59
42090 High	Med-High ¹	Orange	CFM	1510	1458	1433	1390	1358	1311	1267	1227
			BHP	0.34	0.36	0.37	0.39	0.40	0.42	0.43	0.44
			Heat Rise (°F)	45	47	47	49	50	52	54	55
	High	Black	CFM	1581	1545	1509	1475	1443	1401	1357	1318
			BHP	0.39	0.41	0.43	0.44	0.46	0.47	0.49	0.51
			Heat Rise (°C)	43	44	45	46	47	48	50	52

Dry Coil Air Delivery* - Horizontal and Downflow Discharge 24-60 230VAC 1-Phase (Cont)

Unit Size	Heating Rise Range °F (°C)	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)									
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8		
48090 35 - 65 (19 - 36)	Low ¹	Blue	CFM	1330	1277	1232	1191	1147	1103	1060	1004	963	919
			BHP	0.26	0.27	0.29	0.30	0.31	0.32	0.33	0.34	0.36	0.37
		Heat Rise (°F)		51	53	55	57	59	62	64	NA	NA	NA
		Heat Rise (°C)		28	30	31	32	33	34	36	NA	NA	NA
		CFM	1618	1586	1546	1511	1477	1429	1397	1354	1321	1280	
	Med-Low ²	Pink	BHP	0.44	0.45	0.48	0.49	0.50	0.51	0.52	0.53	0.55	0.56
			Heat Rise (°F)	42	43	44	45	46	48	49	50	51	53
		CFM	1935	1909	1867	1836	1808	1766	1696	1619	1535	1454	
		BHP	0.71	0.73	0.74	0.76	0.78	0.79	0.77	0.75	0.72	0.68	
		Heat Rise (°F)		NA	NA	NA	NA	NA	NA	NA	NA	NA	
48115 30 - 60 (17 - 33)	Medium ³	Red	CFM	1972	1946	1917	1880	1844	1786	1716	1635	1559	1456
			BHP	0.76	0.78	0.79	0.80	0.81	0.79	0.77	0.73	0.70	0.66
		Heat Rise (°F)		NA	NA	NA	NA	NA	NA	NA	NA	NA	
		CFM	2205	2150	2078	2011	1941	1852	1779	1672	1572	1473	
		BHP	1.04	1.02	0.99	0.95	0.92	0.87	0.85	0.79	0.75	0.70	
	Med-High	Orange	CFM	1330	1277	1232	1191	1147	1103	1060	1004	963	919
			BHP	0.26	0.27	0.29	0.30	0.31	0.32	0.33	0.34	0.36	0.37
		Heat Rise (°F)		NA	NA	NA	NA	NA	NA	NA	NA	NA	
		CFM	2205	2150	2078	2011	1941	1852	1779	1672	1572	1473	
		BHP	0.44	0.45	0.48	0.49	0.50	0.51	0.52	0.53	0.55	0.56	
48115 30 - 60 (17 - 33)	High	Black	CFM	1972	1946	1917	1880	1844	1786	1716	1635	1559	1456
			BHP	0.76	0.78	0.79	0.80	0.81	0.79	0.77	0.75	0.72	0.68
		Heat Rise (°F)		NA	NA	NA	NA	NA	NA	NA	NA	NA	
		CFM	2205	2150	2078	2011	1941	1852	1779	1672	1572	1473	
		BHP	0.44	0.45	0.48	0.49	0.50	0.51	0.52	0.53	0.55	0.56	
	Low ³	Blue	CFM	1972	1946	1917	1880	1844	1786	1716	1635	1559	1456
			BHP	0.76	0.78	0.79	0.80	0.81	0.79	0.77	0.75	0.72	0.68
		Heat Rise (°F)		NA	NA	NA	NA	NA	NA	NA	NA	NA	
		CFM	1618	1586	1546	1511	1477	1429	1397	1354	1321	1280	
		BHP	0.44	0.45	0.48	0.49	0.50	0.51	0.52	0.53	0.55	0.56	
48115 30 - 60 (17 - 33)	Med-Low ²	Pink	CFM	1972	1946	1917	1880	1844	1786	1716	1635	1559	1456
			BHP	0.76	0.78	0.79	0.80	0.81	0.79	0.77	0.75	0.70	0.66
		Heat Rise (°F)		NA	NA	NA	NA	NA	NA	NA	NA	NA	
		CFM	1935	1909	1867	1836	1808	1766	1696	1619	1535	1454	
		BHP	0.71	0.73	0.74	0.76	0.78	0.79	0.77	0.75	0.72	0.68	
	Medium ¹	Red	CFM	1972	1946	1917	1880	1844	1786	1716	1635	1559	1456
			BHP	0.76	0.78	0.79	0.80	0.81	0.79	0.77	0.75	0.70	0.66
		Heat Rise (°F)		NA	NA	NA	NA	NA	NA	NA	NA	NA	
		CFM	2205	2150	2078	2011	1941	1852	1779	1672	1572	1473	
		BHP	0.44	0.45	0.48	0.49	0.50	0.51	0.52	0.53	0.55	0.56	
48115 30 - 60 (17 - 33)	Med-High	Orange	CFM	1972	1946	1917	1880	1844	1786	1716	1635	1559	1456
			BHP	0.76	0.78	0.79	0.80	0.81	0.79	0.77	0.75	0.70	0.66
		Heat Rise (°F)		NA	NA	NA	NA	NA	NA	NA	NA	NA	
		CFM	2205	2150	2078	2011	1941	1852	1779	1672	1572	1473	
		BHP	0.44	0.45	0.48	0.49	0.50	0.51	0.52	0.53	0.55	0.56	
	High	Black	CFM	1972	1946	1917	1880	1844	1786	1716	1635	1559	1456
			BHP	0.76	0.78	0.79	0.80	0.81	0.79	0.77	0.75	0.70	0.66
		Heat Rise (°F)		NA	NA	NA	NA	NA	NA	NA	NA	NA	
		CFM	2205	2150	2078	2011	1941	1852	1779	1672	1572	1473	
		BHP	0.44	0.45	0.48	0.49	0.50	0.51	0.52	0.53	0.55	0.56	

Dry Coil Air Delivery* - Horizontal and Downflow Discharge 24-60 230VAC 1-Phase (Cont)

Unit Size	Heating Rise Range °F (°C)	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)									
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8		
48130 35 - 65 (19 - 36)	Low ³	Blue	CFM	1330	1277	1232	1191	1147	1103	1060	1004	963	919
			BHP	0.26	0.27	0.29	0.30	0.31	0.32	0.33	0.34	0.36	0.37
			Heat Rise (°F) Heat Rise (°C)	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	Med-Low ²	Pink	CFM	1618	1586	1546	1511	1477	1429	1397	1354	1321	1280
			BHP	0.44	0.45	0.48	0.49	0.50	0.51	0.52	0.53	0.55	0.56
			Heat Rise (°F) Heat Rise (°C)	59	61	62	64	65	NA	NA	NA	NA	
	Medium ¹	Red	CFM	1935	1909	1867	1836	1808	1766	1696	1619	1535	1454
			BHP	0.71	0.73	0.74	0.76	0.78	0.79	0.77	0.75	0.72	0.68
			Heat Rise (°F) Heat Rise (°C)	50	50	51	52	53	54	57	59	63	NA
60090 35 - 65 (19 - 36)	Med-High	Orange	CFM	1972	1946	1917	1880	1844	1786	1716	1635	1559	1456
			BHP	0.76	0.78	0.79	0.80	0.81	0.79	0.77	0.73	0.70	0.66
			Heat Rise (°F) Heat Rise (°C)	49	49	50	51	52	54	56	59	62	NA
	High	Black	CFM	2205	2150	2078	2011	1941	1852	1779	1672	1572	1473
			BHP	1.04	1.02	0.99	0.95	0.92	0.87	0.85	0.79	0.75	0.70
			Heat Rise (°F) Heat Rise (°C)	24	25	26	27	28	29	30	31	33	NA
	Low ³	Blue	CFM	1330	1277	1232	1191	1147	1103	1060	1004	963	919
			BHP	0.26	0.27	0.29	0.30	0.31	0.32	0.33	0.34	0.36	0.37
			Heat Rise (°F) Heat Rise (°C)	51	53	55	57	59	62	64	68	NA	NA
60090 35 - 65 (19 - 36)	Med-Low ¹	Pink	CFM	1475	1436	1399	1351	1317	1270	1236	1188	1152	1105
			BHP	0.35	0.36	0.37	0.38	0.40	0.41	0.42	0.43	0.45	0.45
			Heat Rise (°F) Heat Rise (°C)	26	26	27	28	29	30	32	34	36	NA
	Medium ²	Red	CFM	1736	1710	1668	1630	1600	1557	1522	1479	1450	1406
			BHP	0.53	0.54	0.55	0.58	0.59	0.60	0.62	0.63	0.64	0.65
			Heat Rise (°F) Heat Rise (°C)	NA	NA	41	42	44	45	46	47	48	NA
	Med-High	Orange	CFM	1935	1909	1867	1836	1808	1766	1696	1619	1535	1454
			BHP	0.71	0.73	0.74	0.76	0.78	0.79	0.77	0.75	0.72	0.68
			Heat Rise (°F) Heat Rise (°C)	NA	NA	37	38	40	42	44	46	47	NA
	High	Black	CFM	2205	2150	2078	2011	1941	1852	1779	1672	1572	1473
			BHP	1.04	1.02	0.99	0.95	0.92	0.87	0.85	0.79	0.75	0.70
			Heat Rise (°F) Heat Rise (°C)	NA	NA	NA	NA	NA	NA	NA	NA	NA	

Dry Coil Air Delivery* - Horizontal and Downflow Discharge 24-60 230VAC 1-Phase (Cont)

Unit Size	Heating Rise Range °F (°C)	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)								
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	
60115 30 - 60 (17 - 33)	Low ³ Blue	CFM	1330	1277	1232	1191	1147	1103	1060	1004	963	919
			BHP	0.26	0.27	0.29	0.30	0.31	0.32	0.33	0.34	0.36
		Heat Rise (°F)	NA	NA	NA	NA	NA	NA	NA	NA	NA	0.37
		Heat Rise (°C)	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
		CFM	1475	1436	1399	1351	1317	1270	1236	1188	1152	1105
	Pink	BHP	0.35	0.36	0.37	0.38	0.40	0.41	0.42	0.43	0.45	0.45
			Heat Rise (°F)	59	60	NA						
	Med-Low Red	CFM	1736	1710	1668	1630	1600	1557	1522	1479	1450	1406
			BHP	0.53	0.54	0.55	0.58	0.59	0.60	0.62	0.63	0.64
		Heat Rise (°F)	50	51	52	53	54	56	57	59	60	NA
60115 30 - 60 (17 - 33)	Med-High ¹ Orange	CFM	1935	1909	1867	1836	1808	1766	1696	1619	1535	1454
			BHP	0.71	0.73	0.74	0.76	0.78	0.79	0.77	0.75	0.72
		Heat Rise (°F)	45	45	46	47	48	49	51	54	56	60
		Heat Rise (°C)	25	25	26	26	27	27	28	30	31	33
		CFM	2205	2150	2078	2011	1941	1852	1779	1672	1572	1473
	High Black	BHP	1.04	1.02	0.99	0.95	0.92	0.87	0.85	0.79	0.75	0.70
			Heat Rise (°F)	39	40	42	43	45	47	49	52	55
		Heat Rise (°C)	22	22	23	24	25	26	27	29	31	33

Dry Coil Air Delivery* - Horizontal and Downflow Discharge 24-60 230VAC 1-Phase (Cont)

Unit Size	Heating Rise Range °F (°C)	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
60130 35 - 65 (19 - 36)	Low ³	Blue	CFM	1330	1277	1232	1191	1147	1103	1060	1004
			BHP	0.26	0.27	0.29	0.30	0.31	0.32	0.33	0.34
		Heat Rise (°F)	NA	NA	NA	NA	NA	NA	NA	NA	0.36
		Heat Rise (°C)	NA	NA	NA	NA	NA	NA	NA	NA	0.37
		CFM	1475	1436	1399	1351	1317	1270	1236	1188	1152
	Med-Low	Pink	BHP	0.35	0.36	0.37	0.38	0.40	0.41	0.42	0.43
			Heat Rise (°F)	65	NA						
		Heat Rise (°C)	36	NA	NA	NA	NA	NA	NA	NA	NA
		CFM	1736	1710	1668	1630	1600	1557	1522	1479	1450
		BHP	0.53	0.54	0.55	0.58	0.59	0.60	0.62	0.63	0.64
60130 Medium ²	Red	Heat Rise (°F)	55	56	58	59	60	62	63	65	NA
		Heat Rise (°C)	31	31	32	33	33	34	35	36	NA
		CFM	1935	1909	1867	1836	1808	1766	1696	1619	1535
		BHP	0.71	0.73	0.74	0.76	0.78	0.79	0.77	0.75	0.72
		Heat Rise (°F)	50	50	51	52	53	54	57	59	63
	Med-High ¹	Heat Rise (°C)	28	28	29	29	30	30	31	33	35
		CFM	2205	2150	2078	2011	1941	1852	1779	1672	1572
		BHP	1.04	1.02	0.99	0.95	0.92	0.87	0.85	0.79	0.75
		Heat Rise (°F)	44	45	46	48	50	52	54	57	61
		Heat Rise (°C)	24	25	26	27	28	29	30	32	34

*Air delivery values are without air filter and are for dry coil (See Wet Coil Pressure Drop table).

¹ Factory-shipped heating speed

² Factory-shipped cooling speed

³"NA" = Not allowed for heating speed

NOTE: Deduct field-supplied air filter pressure drop and wet coil pressure drop to obtain external static pressure available for ducting.

Shaded areas indicate speed/static combinations that are not permitted for dehumidification speed.

Dry Coil Air Delivery CFM* - Downflow Discharge - 3 Phase Only

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
24040	Low	Blue	CFM	809	664	554	447	---	---	---	---
			WATTS	85	82	87	95	---	---	---	---
		BHP	0.09	0.09	0.09	0.10	---	---	---	---	---
		Heating Rise (°F)	37	46	55	NA	NA	NA	NA	NA	NA
		Heating Rise (°C)	21	25	30	NA	NA	NA	NA	NA	NA
	Med-Low	Pink	CFM	875	787	693	612	498	392	---	---
			WATTS	101	111	115	125	131	142	---	---
		BHP	0.11	0.12	0.12	0.13	0.14	0.15	---	---	---
		Heating Rise (°F)	35	38	44	49	NA	NA	NA	NA	NA
		Heating Rise (°C)	19	21	24	27	NA	NA	NA	NA	NA
30 - 60°F (17 - 33°C)	Medium ²	Red	CFM	939	860	748	663	591	472	399	---
			WATTS	119	124	134	138	147	155	164	---
		BHP	0.13	0.13	0.14	0.15	0.16	0.17	0.18	---	---
		Heating Rise (°F)	32	35	40	46	51	NA	NA	NA	NA
		Heating Rise (°C)	18	20	22	25	28	NA	NA	NA	NA
	Med-High ¹	Orange	CFM	1026	949	873	786	694	604	516	---
			WATTS	146	151	161	167	177	183	195	---
		BHP	0.16	0.16	0.17	0.18	0.19	0.20	0.21	---	---
		Heating Rise (°F)	NA	32	35	38	44	50	59	NA	NA
		Heating Rise (°C)	NA	18	19	21	24	28	33	NA	NA
High	Black	CFM	1264	1202	1134	1070	1002	931	870	806	699
			WATTS	250	261	274	279	290	296	308	319
		BHP	0.27	0.28	0.29	0.30	0.31	0.32	0.33	0.34	0.35
		Heating Rise (°F)	NA	NA	NA	30	32	35	37	43	50
		Heating Rise (°C)	NA	NA	NA	17	18	19	21	24	28

Dry Coil Air Delivery CFM* - Downflow Discharge - 3 Phase Only (Cont)

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
24060	Low	Blue	CFM	809	664	554	447	---	---	---	---
			WATTS	85	82	87	95	---	---	---	---
		BHP	0.09	0.09	0.09	0.10	---	---	---	---	---
		Heating Rise (°F)	55	NA	NA	NA	NA	NA	NA	NA	NA
		Heating Rise (°C)	31	NA	NA	NA	NA	NA	NA	NA	NA
	Med-Low	Pink	CFM	875	787	693	612	498	392	---	---
			WATTS	101	111	115	125	131	142	---	---
		BHP	0.11	0.12	0.12	0.13	0.14	0.15	---	---	---
		Heating Rise (°F)	51	NA	NA	NA	NA	NA	NA	NA	NA
		Heating Rise (°C)	28	NA	NA	NA	NA	NA	NA	NA	NA
25 - 55°F (14 - 31°C)	Medium ²	Red	CFM	939	860	748	663	591	472	399	---
			WATTS	119	124	134	138	147	155	164	---
		BHP	0.13	0.13	0.14	0.15	0.16	0.17	0.18	---	---
		Heating Rise (°F)	47	52	NA						
		Heating Rise (°C)	26	29	NA						
	Med-High	Orange	CFM	1026	949	873	786	694	604	516	---
			WATTS	146	151	161	167	177	183	195	---
		BHP	0.16	0.16	0.17	0.18	0.19	0.20	0.21	---	---
		Heating Rise (°F)	43	47	51	NA	NA	NA	NA	NA	NA
		Heating Rise (°C)	24	26	28	NA	NA	NA	NA	NA	NA
High ¹	High ¹	Black	CFM	1264	1202	1134	1070	1002	931	870	806
			WATTS	250	261	274	279	290	296	308	319
		BHP	0.27	0.28	0.29	0.30	0.31	0.32	0.33	0.34	0.35
		Heating Rise (°F)	35	37	39	42	44	48	51	55	NA
		Heating Rise (°C)	20	21	22	23	25	27	28	31	NA

Dry Coil Air Delivery CFM* - Downflow Discharge - 3 Phase Only (Cont)

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
30040	Low	Blue	CFM	756	669	548	457	---	---	---	---
			WATTS	84	90	96	106	---	---	---	---
		BHP	0.09	0.10	0.10	0.11	---	---	---	---	---
		Heating Rise (°F)	40	45	55	NA	NA	NA	NA	NA	NA
		Heating Rise (°C)	22	25	31	NA	NA	NA	NA	NA	NA
	Med-Low ¹	Pink	CFM	1002	928	842	733	660	560	450	---
			WATTS	144	155	161	173	185	192	203	---
		BHP	0.15	0.17	0.17	0.19	0.20	0.21	0.22	---	---
		Heating Rise (°F)	30	33	36	41	46	54	NA	NA	NA
		Heating Rise (°C)	17	18	20	23	25	30	NA	NA	NA
30 - 60°F (17 - 33°C)	Medium	Red	CFM	1110	1025	967	879	814	706	611	509
			WATTS	188	195	205	211	223	236	243	255
		BHP	0.20	0.21	0.22	0.23	0.24	0.25	0.25	0.26	0.27
		Heating Rise (°F)	NA	NA	31	34	37	43	49	59	NA
		Heating Rise (°C)	NA	NA	17	19	21	24	27	33	NA
	Med-High ²	Orange	CFM	1160	1091	1004	945	866	804	699	615
			WATTS	213	225	232	243	249	261	273	285
		BHP	0.23	0.24	0.25	0.25	0.26	0.27	0.28	0.29	0.31
		Heating Rise (°F)	NA	NA	30	32	35	38	43	49	NA
		Heating Rise (°C)	NA	NA	17	18	19	21	24	27	NA
High	Black	CFM	1240	1173	1110	1031	966	902	821	726	626
			WATTS	254	266	274	284	295	302	315	327
		BHP	0.27	0.29	0.29	0.30	0.32	0.34	0.35	0.35	0.35
		Heating Rise (°F)	NA	NA	NA	31	34	37	42	48	NA
		Heating Rise (°C)	NA	NA	NA	NA	17	19	20	23	27

Dry Coil Air Delivery CFM* - Downflow Discharge - 3 Phase Only (Cont)

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
30060 25 - 55°F (14 - 31°C)	Low	Blue	CFM	756	669	548	457	---	---	---	---
			WATTS	84	90	96	106	---	---	---	---
			BHP	0.09	0.10	0.10	0.11	---	---	---	---
			Heating Rise (°F)	NA	NA	NA	NA	NA	NA	NA	NA
			Heating Rise (°C)	NA	NA	NA	NA	NA	NA	NA	NA
	Med-Low	Pink	CFM	1002	928	842	733	660	560	450	---
			WATTS	144	155	161	173	185	192	203	---
			BHP	0.15	0.17	0.17	0.19	0.20	0.21	0.22	---
			Heating Rise (°F)	44	48	53	NA	NA	NA	NA	NA
			Heating Rise (°C)	25	27	29	NA	NA	NA	NA	NA
Med-High ²	Medium	Red	CFM	1110	1025	967	879	814	706	611	509
			WATTS	188	195	205	211	223	236	243	255
			BHP	0.20	0.21	0.22	0.23	0.24	0.25	0.26	0.27
			Heating Rise (°F)	40	43	46	51	55	NA	NA	NA
			Heating Rise (°C)	22	24	26	28	30	NA	NA	NA
	High ¹	Black	CFM	1160	1091	1004	945	866	804	699	615
			WATTS	213	225	232	243	249	261	273	285
			BHP	0.23	0.24	0.25	0.26	0.27	0.28	0.29	0.31
			Heating Rise (°F)	38	41	44	47	51	55	NA	NA
			Heating Rise (°C)	21	23	25	26	29	31	NA	NA

677C---B

Dry Coil Air Delivery CFM* - Downflow Discharge - 3 Phase Only (Cont)

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
36060 25 - 55°F (14 - 31°C)	Low	Blue	CFM	1307	1249	1192	1138	1084	1038	987	934
			WATTS	158	160	173	180	193	205	218	230
			BHP	0.17	0.17	0.19	0.19	0.21	0.22	0.23	0.25
			Heating Rise (°F)	34	36	37	39	41	43	45	48
			Heating Rise (°C)	19	20	21	22	23	24	25	26
	Med-Low ¹	Pink	CFM	1365	1324	1284	1233	1181	1127	1084	1039
			WATTS	177	189	201	210	222	236	248	261
			BHP	0.19	0.20	0.22	0.23	0.24	0.25	0.27	0.28
			Heating Rise (°F)	33	34	35	36	38	39	41	43
			Heating Rise (°C)	18	19	19	20	21	22	23	24
Med-High Orange	Med	Red	CFM	1425	1384	1339	1301	1254	1199	1151	1104
			WATTS	197	210	223	235	248	257	271	284
			BHP	0.21	0.23	0.24	0.25	0.27	0.28	0.29	0.30
			Heating Rise (°F)	31	32	33	34	35	37	39	40
			Heating Rise (°C)	17	18	18	19	20	21	21	22
	High	Black	CFM	1582	1549	1509	1469	1433	1392	1346	1300
			WATTS	267	280	294	308	322	336	344	359
			BHP	0.29	0.30	0.32	0.33	0.35	0.36	0.37	0.38
			Heating Rise (°F)	28	29	29	30	31	32	33	34
			Heating Rise (°C)	16	16	16	17	17	18	18	19

Dry Coil Air Delivery CFM* - Downflow Discharge - 3 Phase Only (Cont)

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
36090 35 - 65°F (19 - 36°C)	Low	Blue	CFM	1307	1249	1192	1138	1084	1038	987	934
			WATTS	158	160	173	180	193	205	218	230
		BHP		0.17	0.17	0.19	0.19	0.21	0.22	0.23	0.25
		Heating Rise (°F)		52	54	57	60	63	NA	NA	NA
		Heating Rise (°C)		29	30	32	33	35	NA	NA	NA
	Med-Low	Pink	CFM	1365	1324	1284	1233	1181	1127	1084	1039
			WATTS	177	189	201	210	222	236	248	261
		BHP		0.19	0.20	0.22	0.23	0.24	0.25	0.27	0.28
		Heating Rise (°F)		50	51	53	55	58	60	63	65
		Heating Rise (°C)		28	29	29	31	32	34	35	36
36091 35 - 65°F (19 - 36°C)	Med-High ¹	Red	CFM	1425	1384	1339	1301	1254	1199	1151	1104
			WATTS	197	210	223	235	248	257	271	284
		BHP		0.21	0.23	0.24	0.25	0.27	0.28	0.29	0.30
		Heating Rise (°F)		48	49	51	52	54	57	59	62
		Heating Rise (°C)		27	27	28	29	30	32	33	34
	High	Orange	CFM	1582	1549	1509	1469	1433	1392	1346	1300
			WATTS	267	280	294	308	322	336	344	359
		BHP		0.29	0.30	0.32	0.33	0.35	0.36	0.37	0.38
		Heating Rise (°F)		43	44	45	46	47	49	51	52
		Heating Rise (°C)		24	24	25	26	26	27	28	29
High	Black	CFM		1775	1736	1696	1660	1622	1588	1557	1516
			WATTS	371	386	401	410	424	439	453	468
		BHP		0.40	0.41	0.43	0.44	0.45	0.47	0.49	0.50
		Heating Rise (°F)		38	39	40	41	42	43	44	45
	High	Heating Rise (°C)		21	22	22	23	23	24	24	25
											26

677C---B

Dry Coil Air Delivery CFM* - Downflow Discharge - 3 Phase Only (Cont)

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
Low ¹	Blue	CFM	1365	1324	1284	1233	1181	1127	1084	1039	984
			WATTS	177	189	201	210	222	236	248	261
		BHP	0.19	0.20	0.22	0.23	0.24	0.25	0.27	0.28	0.29
		Heating Rise (°F)	33	34	35	36	38	39	41	43	45
	Pink	CFM	1425	1384	1339	1301	1254	1199	1151	1104	1065
			WATTS	197	210	223	235	248	257	271	284
		BHP	0.21	0.23	0.24	0.25	0.27	0.28	0.29	0.30	0.32
		Heating Rise (°F)	31	32	33	34	35	37	39	40	42
Med-Low	Red	CFM	17	18	18	19	20	21	21	22	23
			WATTS	1582	1549	1509	1469	1433	1392	1346	1300
		BHP	0.29	0.30	0.32	0.33	0.35	0.36	0.37	0.38	0.40
		Heating Rise (°F)	28	29	29	30	31	32	33	34	36
	25 - 55°F (14 - 31°C)	CFM	16	16	16	17	17	18	18	19	20
			WATTS	1623	1586	1553	1511	1470	1433	1393	1350
		BHP	0.31	0.32	0.33	0.35	0.36	0.37	0.39	0.41	0.42
		Heating Rise (°C)	15	16	16	17	17	18	18	19	20
Med-High ²	Orange	CFM	1775	1736	1696	1660	1622	1588	1557	1516	1472
			WATTS	371	386	401	410	424	439	453	468
		BHP	0.40	0.41	0.43	0.44	0.45	0.47	0.49	0.50	0.52
		Heating Rise (°F)	25	26	26	27	27	28	29	30	31
	High	Black	CFM	14	14	15	15	15	16	16	17
			WATTS	371	386	401	410	424	439	453	468
		BHP	0.40	0.41	0.43	0.44	0.45	0.47	0.49	0.50	0.53
		Heating Rise (°C)	14	14	15	15	15	16	16	16	17

Dry Coil Air Delivery CFM* - Downflow Discharge - 3 Phase Only (Cont)

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
42090 35 - 65°F (19 - 36°C)	Low Blue	CFM WATTS BHP Heating Rise (°F) Heating Rise (°C)	1365	1324	1284	1233	1181	1127	1084	1039	984
			177	189	201	210	222	236	248	261	269
			0.19	0.20	0.22	0.23	0.24	0.25	0.27	0.28	0.29
			50	51	53	55	58	60	63	65	NA
			1425	1384	1339	1301	1254	1199	1151	1104	1065
	Med-Low Pink	CFM BHP Heating Rise (°F) Heating Rise (°C)	197	210	223	235	248	257	271	284	296
			0.21	0.23	0.24	0.25	0.27	0.28	0.29	0.30	0.32
			48	49	51	52	54	57	59	62	64
			27	27	28	29	30	32	33	34	35
			1582	1549	1509	1469	1433	1392	1346	1300	1249
42090 35 - 65°F (19 - 36°C)	Medium ¹ Red	CFM WATTS BHP Heating Rise (°F) Heating Rise (°C)	267	280	294	308	322	336	344	359	374
			0.29	0.30	0.32	0.33	0.35	0.36	0.37	0.38	0.40
			43	44	45	46	47	49	51	52	54
			24	24	25	26	26	27	28	29	30
			1623	1586	1553	1511	1470	1433	1393	1350	1309
	Med-High ² Orange	CFM WATTS BHP Heating Rise (°F) Heating Rise (°C)	285	299	312	324	335	349	363	378	393
			0.31	0.32	0.33	0.35	0.36	0.37	0.39	0.41	0.42
			42	43	44	45	46	47	49	50	52
			23	24	24	25	26	26	27	28	29
			1775	1736	1696	1660	1622	1588	1557	1516	1472
High Black	CFM WATTS BHP Heating Rise (°F) Heating Rise (°C)	371	386	401	410	424	439	453	468	483	497
		0.40	0.41	0.43	0.44	0.45	0.47	0.49	0.50	0.52	0.53
		38	39	40	41	42	43	44	45	46	48
		21	22	22	23	23	24	24	25	26	26

677C---B

Dry Coil Air Delivery CFM* - Downflow Discharge - 3 Phase Only (Cont)

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
48090 35 - 65°F (19 - 36°C)	Low	Blue	CFM	1491	1445	1403	1358	1306	1261	1199	1169
			WATTS	232	239	254	262	278	293	303	316
		BHP	0.25	0.26	0.27	0.28	0.30	0.31	0.32	0.34	0.35
		Heating Rise (°F)	46	47	48	50	52	54	57	58	61
		Heating Rise (°C)	25	26	27	28	29	30	32	32	34
	Med-Low ¹	Pink	CFM	1479	1436	1387	1346	1298	1253	1206	1160
			WATTS	224	239	247	262	270	284	300	307
		BHP	0.24	0.26	0.26	0.28	0.29	0.30	0.32	0.33	0.34
		Heating Rise (°F)	46	47	49	51	52	54	56	59	61
		Heating Rise (°C)	26	26	27	28	29	30	31	33	34
48090 35 - 65°F (19 - 36°C)	Med-High	Red	CFM	1813	1785	1745	1709	1663	1632	1592	1548
			WATTS	411	427	435	451	462	478	489	504
		BHP	0.44	0.46	0.47	0.48	0.50	0.51	0.52	0.54	0.56
		Heating Rise (°F)	38	38	39	40	41	42	43	44	45
		Heating Rise (°C)	21	21	22	22	23	23	24	24	25
	High	Orange	CFM	2178	2148	2105	2073	2036	2002	1967	1919
			WATTS	674	691	703	717	733	743	758	754
		BHP	0.72	0.74	0.75	0.77	0.79	0.80	0.81	0.81	0.79
		Heating Rise (°F)	NA	NA	NA	NA	NA	NA	NA	NA	NA
		Heating Rise (°C)	NA	NA	NA	NA	NA	NA	NA	NA	NA
48090 35 - 65°F (19 - 36°C)	High	Black	CFM	2480	2432	2375	2322	2236	2161	2085	2006
			WATTS	1029	1012	995	975	941	908	869	836
		BHP	1.10	1.09	1.07	1.05	1.01	0.97	0.93	0.90	0.85
		Heating Rise (°F)	NA	NA	NA	NA	NA	NA	NA	NA	NA
		Heating Rise (°C)	NA	NA	NA	NA	NA	NA	NA	NA	NA

Dry Coil Air Delivery CFM* - Downflow Discharge - 3 Phase Only (Cont)

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
48115 30 - 60°F (17 - 33°C)	Low	Blue	CFM	1491	1445	1403	1358	1306	1261	1199	1169
			WATTS	232	239	254	262	278	293	303	316
		BHP	0.25	0.26	0.27	0.28	0.30	0.31	0.32	0.34	0.35
		Heating Rise (°F)	58	60	NA						
		Heating Rise (°C)	32	33	NA						
	Med-Low	Pink	CFM	1479	1436	1387	1346	1298	1253	1206	1160
			WATTS	224	239	247	262	270	284	300	307
		BHP	0.24	0.26	0.26	0.28	0.29	0.30	0.32	0.33	0.34
		Heating Rise (°F)	59	NA	NA	NA	NA	NA	NA	NA	NA
		Heating Rise (°C)	33	NA	NA	NA	NA	NA	NA	NA	NA
48115 30 - 60°F (17 - 33°C)	Med-High ¹	Red	CFM	1813	1785	1745	1709	1663	1632	1592	1548
			WATTS	411	427	435	451	462	478	489	504
		BHP	0.44	0.46	0.47	0.48	0.50	0.51	0.52	0.54	0.56
		Heating Rise (°F)	48	49	50	51	52	53	55	56	58
		Heating Rise (°C)	27	27	28	28	29	30	30	31	32
	High	Orange	CFM	2178	2148	2105	2073	2036	2002	1967	1919
			WATTS	674	691	703	717	733	743	758	754
		BHP	0.72	0.74	0.75	0.77	0.79	0.80	0.81	0.81	0.79
		Heating Rise (°F)	40	40	41	42	43	43	44	45	47
		Heating Rise (°C)	22	22	23	23	24	24	25	25	26
High	Black	CFM	2480	2432	2375	2322	2236	2161	2085	2006	1917
			WATTS	1029	1012	995	975	941	908	869	836
		BHP	1.10	1.09	1.07	1.05	1.01	0.97	0.93	0.90	0.85
		Heating Rise (°F)	35	36	37	37	39	40	42	43	45
		Heating Rise (°C)	19	20	20	21	22	22	23	24	25

677C---B

Dry Coil Air Delivery CFM* - Downflow Discharge - 3 Phase Only (Cont)

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
48130 35 - 65°F (19 - 36°C)	Low	Blue	CFM	1491	1445	1403	1358	1306	1261	1199	1169
			WATTS	232	239	254	262	278	293	303	316
		BHP	0.25	0.26	0.27	0.28	0.30	0.31	0.32	0.34	0.35
		Heating Rise (°F)	65	NA	NA	NA	NA	NA	NA	NA	NA
		Heating Rise (°C)	36	NA	NA	NA	NA	NA	NA	NA	NA
	Med-Low	Pink	CFM	1479	1436	1387	1346	1298	1253	1206	1160
			WATTS	224	239	247	262	270	284	300	307
		BHP	0.24	0.26	0.26	0.28	0.29	0.30	0.32	0.33	0.34
		Heating Rise (°F)	65	NA	NA	NA	NA	NA	NA	NA	NA
		Heating Rise (°C)	36	NA	NA	NA	NA	NA	NA	NA	NA
48130 35 - 65°F (19 - 36°C)	Med-High ¹	Red	CFM	1813	1785	1745	1709	1663	1632	1592	1548
			WATTS	411	427	435	451	462	478	489	504
		BHP	0.44	0.46	0.47	0.48	0.50	0.51	0.52	0.54	0.56
		Heating Rise (°F)	53	54	55	56	58	59	60	62	64
		Heating Rise (°C)	30	30	31	31	32	33	34	35	36
	High	Black	CFM	2178	2148	2105	2073	2036	2002	1967	1919
			WATTS	674	691	703	717	733	743	758	754
		BHP	0.72	0.74	0.75	0.77	0.79	0.80	0.81	0.81	0.79
		Heating Rise (°F)	44	45	46	46	47	48	49	50	52
		Heating Rise (°C)	25	25	25	26	26	27	27	28	29
48130 35 - 65°F (19 - 36°C)	High	Orange	CFM	2480	2432	2375	2322	2236	2161	2085	2006
			WATTS	1029	1012	995	975	941	908	869	836
		BHP	1.10	1.09	1.07	1.05	1.01	0.97	0.93	0.90	0.85
		Heating Rise (°F)	39	40	41	41	43	45	46	48	50
		Heating Rise (°C)	22	22	23	23	24	25	26	27	28

Dry Coil Air Delivery CFM* - Downflow Discharge - 3 Phase Only (Cont)

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
60090 35 - 65°F (19 - 36°C)	Low ¹ Blue	CFM WATTS BHP Heating Rise (°F) Heating Rise (°C)	1479	1436	1387	1298	1253	1206	1160	1114	1061
			224	239	247	262	270	284	300	307	319
			0.24	0.26	0.26	0.28	0.29	0.30	0.32	0.33	0.34
			46	47	49	51	52	54	56	59	61
			26	26	27	28	29	30	31	33	34
	Med-Low Pink	CFM WATTS BHP Heating Rise (°F) Heating Rise (°C)	1841	1796	1761	1724	1690	1651	1616	1578	1527
			425	434	453	460	476	485	501	508	525
			0.46	0.47	0.49	0.49	0.51	0.52	0.54	0.54	0.58
			37	38	39	39	40	41	42	43	46
			21	21	21	22	22	23	23	24	25
60090 35 - 65°F (19 - 36°C)	Med-High Orange	CFM WATTS BHP Heating Rise (°F) Heating Rise (°C)	1944	1913	1872	1838	1801	1771	1731	1698	1655
			486	501	511	529	537	554	565	578	595
			0.52	0.54	0.55	0.57	0.58	0.59	0.61	0.62	0.64
			35	36	36	37	38	38	39	40	41
			19	20	20	21	21	21	22	22	23
	High Black	CFM WATTS BHP Heating Rise (°F) Heating Rise (°C)	2178	2148	2105	2073	2036	2002	1967	1919	1845
			674	691	703	717	733	743	758	754	734
			0.72	0.74	0.75	0.77	0.79	0.80	0.81	0.81	0.75
			NA	NA	NA	NA	NA	NA	35	35	39
			NA	NA	NA	NA	NA	NA	19	20	22
High Black	CFM WATTS BHP Heating Rise (°F) Heating Rise (°C)	2480	2432	2375	2322	2236	2161	2085	2006	1917	1808
		1029	1012	995	975	941	908	869	836	796	751
		1.10	1.09	1.07	1.05	1.01	0.97	0.93	0.90	0.85	0.81
		NA	NA	NA	NA	NA	NA	NA	NA	35	38
		NA	NA	NA	NA	NA	NA	NA	NA	20	21

677C---B

Dry Coil Air Delivery CFM* - Downflow Discharge - 3 Phase Only (Cont)

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
60115 30 - 60°F (17 - 33°C)	Low	Blue	CFM	1479	1436	1387	1346	1298	1253	1206	1160
			WATTS	224	239	247	262	270	284	300	307
		BHP	0.24	0.26	0.26	0.28	0.29	0.30	0.32	0.33	0.34
		Heating Rise (°F)	59	NA	NA	NA	NA	NA	NA	NA	NA
		Heating Rise (°C)	33	NA	NA	NA	NA	NA	NA	NA	NA
	Med-Low	Pink	CFM	1841	1796	1761	1724	1690	1651	1616	1578
			WATTS	425	434	453	460	476	485	501	508
		BHP	0.46	0.47	0.49	0.49	0.51	0.52	0.54	0.54	0.56
		Heating Rise (°F)	47	48	49	50	51	53	54	55	57
		Heating Rise (°C)	26	27	27	28	29	29	30	31	32
Med-High ¹	Medium ²	Red	CFM	1944	1913	1872	1838	1801	1771	1731	1698
			WATTS	486	501	511	529	537	554	565	578
		BHP	0.52	0.54	0.55	0.57	0.58	0.59	0.61	0.62	0.64
		Heating Rise (°F)	45	45	46	47	48	49	50	51	53
		Heating Rise (°C)	25	25	26	26	27	27	28	28	29
	High	Orange	CFM	2178	2148	2105	2073	2036	2002	1967	1919
			WATTS	674	691	703	717	733	743	758	754
		BHP	0.72	0.74	0.75	0.77	0.79	0.80	0.81	0.81	0.79
		Heating Rise (°F)	40	40	41	42	43	43	44	45	47
		Heating Rise (°C)	22	22	23	23	24	24	25	25	26
High	Black	CFM	2480	2432	2375	2322	2236	2161	2085	2006	1917
			WATTS	1029	1012	995	975	941	908	869	836
		BHP	1.10	1.09	1.07	1.05	1.01	0.97	0.93	0.90	0.85
		Heating Rise (°F)	35	36	37	37	39	40	42	43	45
		Heating Rise (°C)	19	20	20	21	22	22	23	24	25

Dry Coil Air Delivery CFM* - Downflow Discharge - 3 Phase Only (Cont)

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
60130 35 - 65°F (19 - 36°C)	Low	Blue	CFM	1479	1436	1387	1346	1298	1253	1206	1160
			WATTS	224	239	247	262	270	284	300	307
		BHP	0.24	0.26	0.26	0.28	0.29	0.30	0.32	0.33	0.34
		Heating Rise (°F)	65	NA	NA	NA	NA	NA	NA	NA	NA
		Heating Rise (°C)	36	NA	NA	NA	NA	NA	NA	NA	NA
	Med-Low	Pink	CFM	1841	1796	1761	1724	1690	1651	1616	1578
			WATTS	425	434	453	460	476	485	501	508
		BHP	0.46	0.47	0.49	0.49	0.51	0.52	0.54	0.54	0.56
		Heating Rise (°F)	52	54	55	56	57	58	60	61	63
Med-High ¹	Medium ²	Red	Heating Rise (°C)	29	30	30	31	32	32	33	34
			CFM	1944	1913	1872	1838	1801	1771	1731	1698
			WATTS	486	501	511	529	537	554	565	578
		BHP	0.52	0.54	0.55	0.57	0.58	0.59	0.61	0.62	0.64
		Heating Rise (°F)	50	50	51	52	53	54	56	57	58
		Heating Rise (°C)	28	28	29	29	30	30	31	32	33
		CFM	2178	2148	2105	2073	2036	2002	1967	1919	1845
		WATTS	674	691	703	717	733	743	758	754	734
High	Orange	Black	BHP	0.72	0.74	0.75	0.77	0.79	0.80	0.81	0.79
			Heating Rise (°F)	44	45	46	46	47	48	49	50
			Heating Rise (°C)	25	25	25	26	26	27	27	28
			CFM	2480	2432	2375	2322	2236	2161	2085	2006
		High	WATTS	1029	1012	995	975	941	908	869	836
			BHP	1.10	1.09	1.07	1.05	1.01	0.97	0.93	0.90
		Heating Rise (°F)	39	40	41	41	43	45	46	48	50
		Heating Rise (°C)	22	22	23	23	24	25	26	27	28

* Air delivery values are without air filter and are for dry coil (See Wet Coil Pressure Drop table).

¹ Factory-shipped heating speed² Factory-shipped cooling speed

NA – Not allowed for heating speed

Note: Deduct field-supplied air filter pressure drop and wet coil pressure drop to obtain external static pressure available for ducting.
Shaded areas indicate speed/static combinations that are not permitted for dehumidification speed.

Dry Coil Air Delivery CFM* - Horizontal Discharge 3-Phase

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (in. W.C.)								
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
24040 30 - 60°F (17 - 33°C)	Low	Blue	CFM	754	650	536	429	--	--	--	--	--
			Heating Rise (°F)	40	46	56	NA	NA	NA	NA	NA	NA
		Heating Rise (°C)	22	26	31	NA	NA	NA	NA	NA	NA	NA
	Med-Low	Pink	CFM	851	777	675	591	475	--	--	--	--
			Heating Rise (°F)	36	39	45	51	NA	NA	NA	NA	NA
		Heating Rise (°C)	20	22	25	28	NA	NA	NA	NA	NA	NA
	Medium ²	Red	CFM	941	851	774	684	576	479	--	--	--
			Heating Rise (°F)	32	36	39	44	52	NA	NA	NA	NA
		Heating Rise (°C)	18	20	22	25	NA	NA	NA	NA	NA	NA
	Med-High ¹	Orange	CFM	1009	917	840	759	667	577	447	--	--
			Heating Rise (°F)	30	33	36	40	45	52	NA	NA	NA
		Heating Rise (°C)	17	18	20	22	25	29	NA	NA	NA	NA
24060 25 - 55°F (14 - 31°C)	High	Black	CFM	1241	1167	1111	1036	969	881	818	731	640
			Heating Rise (°F)	NA	NA	NA	NA	31	34	37	41	47
		Heating Rise (°C)	NA	NA	NA	NA	NA	19	21	23	26	28
	Low	Blue	CFM	754	650	536	429	--	--	--	--	--
			Heating Rise (°F)	NA	NA	NA	NA	NA	NA	NA	NA	NA
		Heating Rise (°C)	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	Med-Low	Pink	CFM	851	777	675	591	475	--	--	--	--
			Heating Rise (°F)	52	NA	NA	NA	NA	NA	NA	NA	NA
		Heating Rise (°C)	29	NA	NA	NA	NA	NA	NA	NA	NA	NA
	Medium ²	Red	CFM	941	851	774	684	576	479	--	--	--
			Heating Rise (°F)	47	52	NA	NA	NA	NA	NA	NA	NA
		Heating Rise (°C)	26	29	NA	NA	NA	NA	NA	NA	NA	NA
30040 30 - 60°F (17 - 33°C)	Med-High	Orange	CFM	1009	917	840	759	667	577	447	--	--
			Heating Rise (°F)	44	48	53	NA	NA	NA	NA	NA	NA
		Heating Rise (°C)	24	27	29	NA	NA	NA	NA	NA	NA	NA
	High ¹	Black	CFM	1241	1167	1111	1036	969	881	818	731	640
			Heating Rise (°F)	36	38	40	43	46	50	54	NA	NA
		Heating Rise (°C)	20	21	22	24	25	28	30	NA	NA	NA
	Med-Low ¹	Pink	CFM	741	638	547	415	--	--	--	--	--
			Heating Rise (°F)	41	47	55	NA	NA	NA	NA	NA	NA
		Heating Rise (°C)	23	26	31	NA	NA	NA	NA	NA	NA	NA
	Medium	Red	CFM	973	887	783	733	665	538	451	--	--
			Heating Rise (°F)	31	34	37	41	45	56	NA	NA	NA
		Heating Rise (°C)	17	19	20	23	25	31	NA	NA	NA	NA
44	Med-High ²	Orange	CFM	1088	1023	954	881	800	723	658	563	461
			Heating Rise (°F)	28	30	32	34	38	42	46	54	NA
		Heating Rise (°C)	15	16	18	19	21	23	26	30	NA	NA
	High	Black	CFM	1140	1064	996	915	840	758	687	644	480
			Heating Rise (°F)	NA	NA	30	33	36	40	44	54	NA
		Heating Rise (°C)	NA	NA	17	18	20	22	24	30	NA	NA
		CFM	1202	1140	1082	1015	961	881	810	732	631	
		Heating Rise (°F)	NA	NA	30	31	34	37	41	48	NA	NA
		Heating Rise (°C)	NA	NA	17	17	19	21	23	27	NA	NA

Dry Coil Air Delivery CFM* - Horizontal Discharge 3-Phase (Cont)

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (in. W.C.)								
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
30060 25 – 55°F (14 – 31°C)	Med-Low	Low	Blue	CFM	741	638	547	415	—	—	—	—
			Heating Rise (°F)	NA	NA	NA	NA	NA	NA	NA	NA	NA
		Med	Heating Rise (°C)	NA	NA	NA	NA	NA	NA	NA	NA	NA
			CFM	973	887	823	733	685	598	451	—	—
	Med-High ²	Orange	CFM	46	50	54	NA	NA	NA	NA	NA	NA
			Heating Rise (°F)	25	28	30	NA	NA	NA	NA	NA	NA
			Heating Rise (°C)	39	42	45	49	53	NA	NA	NA	NA
		High ¹	CFM	41	43	47	50	NA	NA	NA	NA	NA
			Heating Rise (°F)	23	24	26	28	NA	NA	NA	NA	NA
			Heating Rise (°C)	1140	1064	996	915	840	758	687	564	480
36060 25 – 55°F (14 – 31°C)	Med-Low ¹	Black	CFM	1202	1140	1082	1015	961	881	810	732	631
			Heating Rise (°F)	37	39	41	44	46	50	55	NA	NA
			Heating Rise (°C)	21	22	23	24	26	28	30	NA	NA
		Blue	CFM	1176	1121	1079	1019	974	920	877	826	754
			Heating Rise (°F)	38	40	41	44	46	48	51	54	NA
	Med-High ²	Orange	CFM	1295	1234	1182	1126	1075	1016	955	898	857
			Heating Rise (°F)	34	36	38	39	41	44	47	49	52
		Pink	Heating Rise (°C)	19	20	21	22	23	24	26	27	29
			CFM	1345	1282	1235	1194	1140	1095	1027	974	921
		CFM	Heating Rise (°F)	33	35	36	37	39	41	43	46	48
36090 35 – 65°F (19 – 36°C)	Med-Low ¹	Red	Heating Rise (°C)	18	19	20	21	22	23	24	25	27
			CFM	1505	1452	1413	1358	1323	1282	1234	1169	1130
		Orange	Heating Rise (°F)	30	31	31	33	34	35	36	38	39
			CFM	1705	1643	1607	1568	1518	1483	1448	1404	1360
		High	Heating Rise (°F)	26	27	28	28	29	30	31	32	33
			Heating Rise (°C)	14	15	15	16	16	17	17	18	18
			CFM	1176	1121	1079	1019	974	920	877	826	754
	Med-High ²	Black	Heating Rise (°F)	58	61	63	NA	NA	NA	NA	NA	NA
			Heating Rise (°C)	32	34	35	NA	NA	NA	NA	NA	NA
		Blue	CFM	1295	1234	1182	1126	1075	1016	955	898	857
			Heating Rise (°F)	53	55	58	60	63	NA	NA	NA	NA
		CFM	Heating Rise (°C)	29	31	32	34	35	NA	NA	NA	NA
36090 35 – 65°F (19 – 36°C)	Med-High ¹	Red	Heating Rise (°F)	51	53	55	57	60	62	NA	NA	NA
			Heating Rise (°C)	28	29	31	32	33	35	NA	NA	NA
		CFM	Heating Rise (°F)	45	47	48	50	51	53	55	58	60
	Orange	Heating Rise (°C)	25	26	27	28	29	31	32	33	33	921
		CFM	1705	1643	1607	1568	1518	1483	1448	1404	1360	NA
	High	Black	Heating Rise (°F)	40	41	42	43	45	46	47	48	50
			Heating Rise (°C)	22	23	24	24	25	26	27	28	28

Dry Coil Air Delivery CFM* - Horizontal Discharge 3-Phase (Cont)

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (In. W.C.)								
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
42060 25 – 55°F (14 – 31°C)	Low ¹	Blue	CFM	1295	1234	1182	1126	1075	1016	955	898	857
			Heating Rise (°F)	34	36	38	39	41	44	47	49	52
			Heating Rise (°C)	19	20	21	22	23	24	26	27	29
	Med-Low	Pink	CFM	1345	1282	1235	1194	1140	1095	1027	974	921
			Heating Rise (°F)	33	35	36	37	39	41	43	46	48
			Heating Rise (°C)	18	19	20	21	22	23	24	25	27
	Med-High ²	Red	CFM	1505	1452	1413	1358	1323	1282	1234	1169	1130
			Heating Rise (°F)	30	31	31	33	34	35	36	38	39
			Heating Rise (°C)	16	17	17	18	19	19	20	21	22
42090 35 – 65°F (19 – 36°C)	Orange	CFM	1545	1492	1449	1411	1362	1313	1278	1231	1188	
			Heating Rise (°F)	29	30	31	31	33	34	35	36	37
			Heating Rise (°C)	16	17	17	17	18	19	19	20	21
	High	Black	CFM	1705	1643	1607	1568	1518	1483	1448	1404	1360
			Heating Rise (°F)	26	27	28	28	29	30	31	32	33
			Heating Rise (°C)	14	15	15	16	16	17	17	18	18
	Low	Blue	CFM	1295	1234	1182	1126	1075	1016	955	898	857
			Heating Rise (°F)	53	55	58	60	63	NA	NA	NA	NA
			Heating Rise (°C)	29	31	32	34	35	NA	NA	NA	NA
48090 35 – 65°F (19 – 36°C)	Med-Low	Pink	CFM	1345	1282	1235	1194	1140	1095	1027	974	921
			Heating Rise (°F)	51	53	55	57	60	62	NA	NA	NA
			Heating Rise (°C)	28	29	31	32	33	35	NA	NA	NA
	Medium ¹	Red	CFM	1505	1452	1413	1358	1323	1282	1234	1169	1130
			Heating Rise (°F)	45	47	48	50	51	53	55	58	60
			Heating Rise (°C)	25	26	27	28	29	29	31	32	33
	Med-High ²	Orange	CFM	1705	1643	1607	1568	1518	1483	1448	1404	1360
			Heating Rise (°F)	44	46	47	48	50	52	53	55	57
			Heating Rise (°C)	24	25	26	27	28	29	30	31	32
46	High	Black	CFM	1705	1643	1607	1568	1518	1483	1448	1404	1360
			Heating Rise (°F)	40	41	42	43	45	46	47	48	50
			Heating Rise (°C)	22	23	24	24	25	25	26	27	28
	Low	Blue	CFM	1430	1374	1327	1267	1223	1176	1127	1061	1016
			Heating Rise (°F)	48	49	51	54	56	58	60	64	NA
			Heating Rise (°C)	26	27	28	30	31	32	34	36	NA
	Med-Low ¹	Pink	CFM	1445	1389	1341	1281	1236	1189	1139	1072	1027
			Heating Rise (°F)	47	49	51	53	55	57	60	63	NA
			Heating Rise (°C)	26	27	28	29	31	32	33	35	NA
46	Medium ²	Red	CFM	1678	1635	1602	1558	1513	1474	1438	1404	1349
			Heating Rise (°F)	41	42	42	44	45	46	47	48	50
			Heating Rise (°C)	23	23	24	24	25	26	26	27	28
	Med-High	Orange	CFM	2131	2088	2065	2013	1982	1941	1888	1860	1785
			Heating Rise (°F)	NA	NA	NA	NA	NA	NA	NA	NA	NA
			Heating Rise (°C)	NA	NA	NA	NA	NA	NA	NA	NA	NA
	High	Black	CFM	2461	2409	2339	2286	2192	2140	2082	1968	1874
			Heating Rise (°F)	NA	NA	NA	NA	NA	NA	NA	NA	NA
			Heating Rise (°C)	NA	NA	NA	NA	NA	NA	NA	NA	NA

Dry Coil Air Delivery CFM* - Horizontal Discharge 3-Phase (Cont)

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (IN. W.C.)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
48115 30 – 60°F (17 – 33°C)	Low	Blue	CFM	1430	1374	1327	1267	1223	1176	1127	1061
			Heating Rise (°F)	61	NA						
		CFM	Heating Rise (°C)	34	NA						
	Med-Low	Pink	CFM	1445	1389	1341	1281	1236	1189	1139	1072
			Heating Rise (°F)	60	NA						
		CFM	Heating Rise (°C)	33	NA						
	Medium ²	Red	CFM	1678	1635	1602	1558	1513	1474	1438	1404
			Heating Rise (°F)	52	53	54	56	57	59	60	NA
		CFM	Heating Rise (°C)	29	30	30	31	32	33	34	NA
	Med-High ¹	Orange	CFM	2131	2088	2065	2013	1982	1941	1888	1860
			Heating Rise (°F)	41	42	42	43	44	45	46	47
		CFM	Heating Rise (°C)	23	23	23	24	24	25	26	27
48130 35 – 65°F (19 – 36°C)	High	Black	CFM	2461	2409	2399	2286	2192	2140	2062	1968
			Heating Rise (°F)	35	36	36	37	38	40	41	42
		CFM	Heating Rise (°C)	20	21	21	21	22	23	23	25
	Low	Blue	CFM	1430	1374	1327	1267	1223	1176	1127	1061
			Heating Rise (°F)	NA	NA	NA	NA	NA	NA	NA	NA
		CFM	Heating Rise (°C)	NA	NA	NA	NA	NA	NA	NA	NA
	Med-Low	Pink	CFM	1445	1389	1341	1281	1236	1189	1139	1072
			Heating Rise (°F)	NA	NA	NA	NA	NA	NA	NA	NA
		CFM	Heating Rise (°C)	NA	NA	NA	NA	NA	NA	NA	NA
	Medium ²	Red	CFM	1678	1635	1602	1558	1513	1474	1438	1404
			Heating Rise (°F)	57	59	60	62	64	65	NA	NA
		CFM	Heating Rise (°C)	32	33	33	34	35	36	NA	NA
48190 35 – 65°F (19 – 36°C)	Med-High ¹	Orange	CFM	2131	2088	2065	2013	1982	1941	1888	1860
			Heating Rise (°F)	45	46	47	48	49	50	51	52
		CFM	Heating Rise (°C)	25	26	26	27	27	28	28	30
	High	Black	CFM	2461	2409	2339	2286	2192	2140	2062	1968
			Heating Rise (°F)	39	40	41	42	44	45	47	49
		CFM	Heating Rise (°C)	22	22	23	23	24	25	26	27
	Med-Low	Blue	CFM	1445	1389	1341	1281	1236	1189	1139	1072
			Heating Rise (°F)	47	49	51	53	55	57	60	63
		CFM	Heating Rise (°C)	26	27	28	29	31	32	33	NA
	Medium ²	Red	CFM	1678	1635	1602	1558	1513	1474	1438	1404
			Heating Rise (°F)	41	42	42	44	45	46	47	48
		CFM	Heating Rise (°C)	23	23	24	24	25	26	26	28
60090 35 – 65°F (19 – 36°C)	Med-High	Orange	CFM	1962	1915	1880	1843	1794	1753	1711	1675
			Heating Rise (°F)	35	36	36	37	38	39	40	41
		CFM	Heating Rise (°C)	19	20	20	20	21	22	22	23
	High	Black	CFM	2131	2088	2065	2013	1982	1941	1888	1860
			Heating Rise (°F)	NA	NA	NA	NA	NA	NA	NA	NA
		CFM	Heating Rise (°C)	NA	NA	NA	NA	NA	NA	NA	NA

677C---B

Dry Coil Air Delivery CFM* - Horizontal Discharge 3-Phase (Cont)

Unit	Heating Rise Range	Motor Speed	Wire Color	External Static Pressure (In. W.C.)								
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
60115 30 – 60°F (17 – 33°C)	Med-Low	Low	Blue	CFM	1445	1389	1341	1281	1236	1189	1139	1072
			Heating Rise (°F)	60	NA	1027						
		CFM	Heating Rise (°C)	33	NA							
	Medium ²	Red	CFM	1678	1635	1602	1558	1513	1474	1438	1404	1349
			Heating Rise (°F)	52	53	54	56	57	59	60	NA	NA
		CFM	Heating Rise (°C)	29	30	30	31	32	33	34	NA	NA
	Med-High ¹	Orange	CFM	1962	1915	1880	1843	1794	1753	1711	1675	1628
			Heating Rise (°F)	44	45	46	47	48	50	51	52	53
		CFM	Heating Rise (°C)	25	25	26	26	27	28	28	29	30
60130 35 – 65°F (19 – 36°C)	High	Black	CFM	2131	2088	2065	2013	1982	1941	1888	1860	1785
			Heating Rise (°F)	41	42	42	43	44	45	46	47	49
		CFM	Heating Rise (°C)	23	23	23	24	24	25	26	26	27
	Med-Low	Blue	CFM	2461	2409	2339	2286	2192	2140	2062	1968	1874
			Heating Rise (°F)	35	36	37	38	40	41	42	44	46
		CFM	Heating Rise (°C)	20	20	21	21	22	23	23	25	26
	Medium ²	Red	CFM	1445	1389	1341	1281	1236	1189	1139	1072	1027
			Heating Rise (°F)	NA	NA	NA	NA	NA	NA	NA	NA	NA
		CFM	Heating Rise (°C)	1678	1635	1602	1558	1513	1474	1438	1404	1349
	Med-High ¹	Orange	CFM	57	59	60	62	64	65	NA	NA	NA
			Heating Rise (°F)	32	33	33	34	35	36	NA	NA	NA
		CFM	Heating Rise (°C)	1962	1915	1880	1843	1794	1753	1711	1675	1628
	High	Black	CFM	2131	2088	2065	2013	1982	1941	1888	1860	1785
			Heating Rise (°F)	49	50	51	52	54	55	56	57	59
		CFM	Heating Rise (°C)	27	28	28	29	30	31	32	33	33

* Air delivery values are without air filter and are for dry coil (See Wet Coil Pressure Drop table).

¹ Factory-shipped gas heating speed² Factory-shipped heat pump speed

NA – Not allowed for gas heating speed

Note: Duct field-supplied air filter pressure drop and wet coil pressure drop to obtain external static pressure available for ducting.

Shaded areas indicate speed/static combinations that are not permitted for dehumidification speed.

Note: Deduct 10% for 208 volt operation.

Filter Pressure Drop Table (IN. W.C.)

FILTER SIZE IN. (MM)	COOLING TONS	STANDARD CFM (SCFM)															
		600	700	800	900	1000	1100	1200	1300	1400	1500	1600	1700	1800	1900	2000	2100
600-1400 CFM 12x20x1+12x20x1 (305x508x25+305x508x25)	2.0, 2.5, 3.0	0.03	0.04	0.05	0.06	0.06	0.07	0.07	0.08	0.08	0.09	0.10	0.11	0.12	-	-	-
1200-1800 CFM 16x2x1+14x2x1 (406x610x25+356x610x25)	3.5, 4.0	-	-	-	0.04	0.05	0.06	0.07	0.08	0.09	0.09	0.10	0.11	0.12	-	-	-
1500-2200 CFM 16x2x1+18x2x1 (406x610x25+457x356x25)	5.0	-	-	-	-	-	-	-	-	0.04	0.06	0.08	0.10	0.11	0.13	0.14	0.15


Wet Coil Pressure Drop (IN. W.C.)

UNIT SIZE	600	STANDARD CFM (SCFM)															
		700	800	900	1000	1100	1200	1300	1400	1500	1600	1700	1800	1900	2000	2100	2200
24	0.03	0.04	0.04	0.05	0.06	0.07	0.08	0.11									
30				0.05	0.06	0.07	0.08	0.11									
36				0.06	0.06	0.09	0.10	0.11	0.14								
42				0.05	0.05	0.06	0.07	0.08	0.08	0.09	0.09	0.11					
48						0.04	0.06	0.09	0.10	0.10	0.11	0.12	0.13	0.14			
60								0.06	0.07	0.07	0.08	0.09	0.10	0.12	0.13		


Economizer with 1-in. Filter Pressure Drop (IN. W.C.)

FILTER SIZE IN. (MM)	COOLING TONS	STANDARD CFM (SCFM)															
		600	700	800	900	1000	1100	1200	1300	1400	1500	1600	1700	1800	1900	2000	2100
600-1400 CFM 12x20x1+12x20x1 (305x508x25+305x508x25)	2.0, 2.5, 3.0	-	-	0.08	0.09	0.10	0.11	0.13	0.14	-	-	-	-	-	-	-	-
1200-1800 CFM 16x2x1+14x2x1 (406x610x25+356x610x25)	3.5, 4.0	-	-	-	-	0.09	0.09	0.10	0.12	0.13	0.15	0.17	0.17	0.19	0.21	-	-
1500-2200 CFM 16x2x1+18x2x1 (406x610x25+457x356x25)	5.0	-	-	-	-	-	-	-	-	0.15	0.17	0.18	0.20	0.21	0.22	0.23	0.23

TYPICAL PIPING AND WIRING

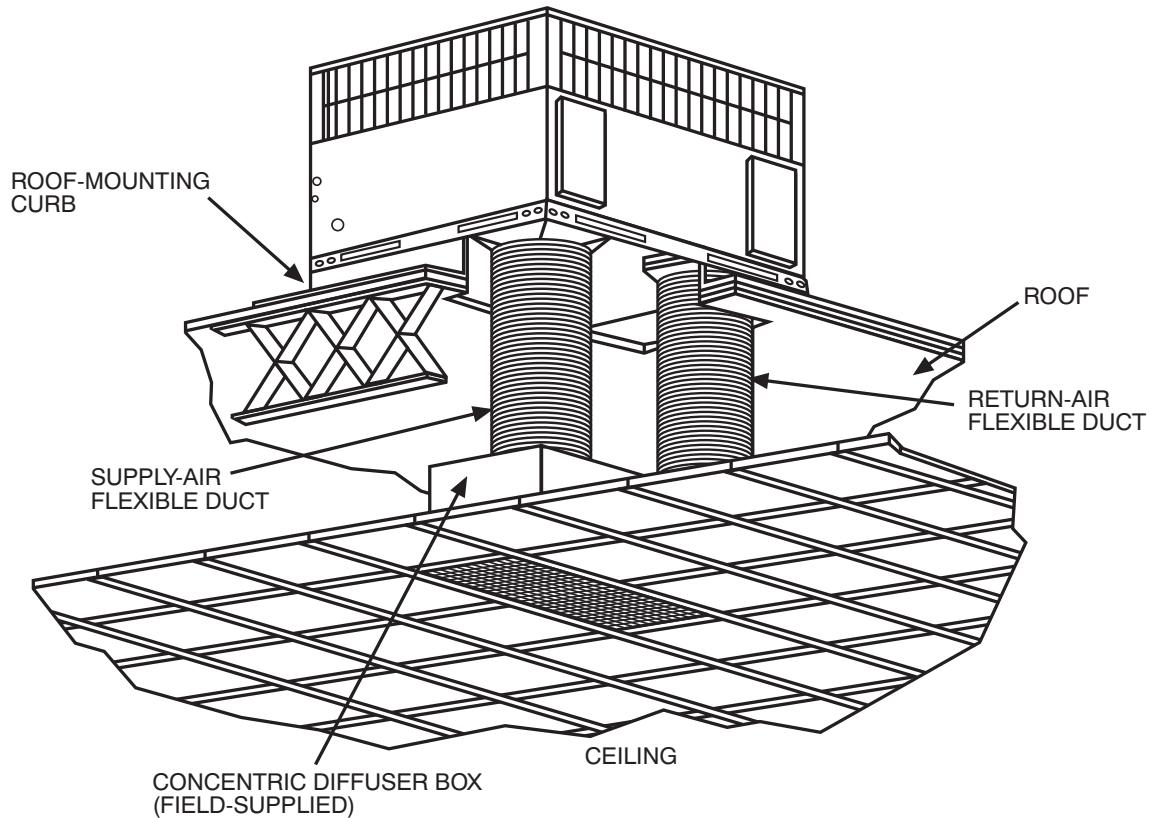

A09230

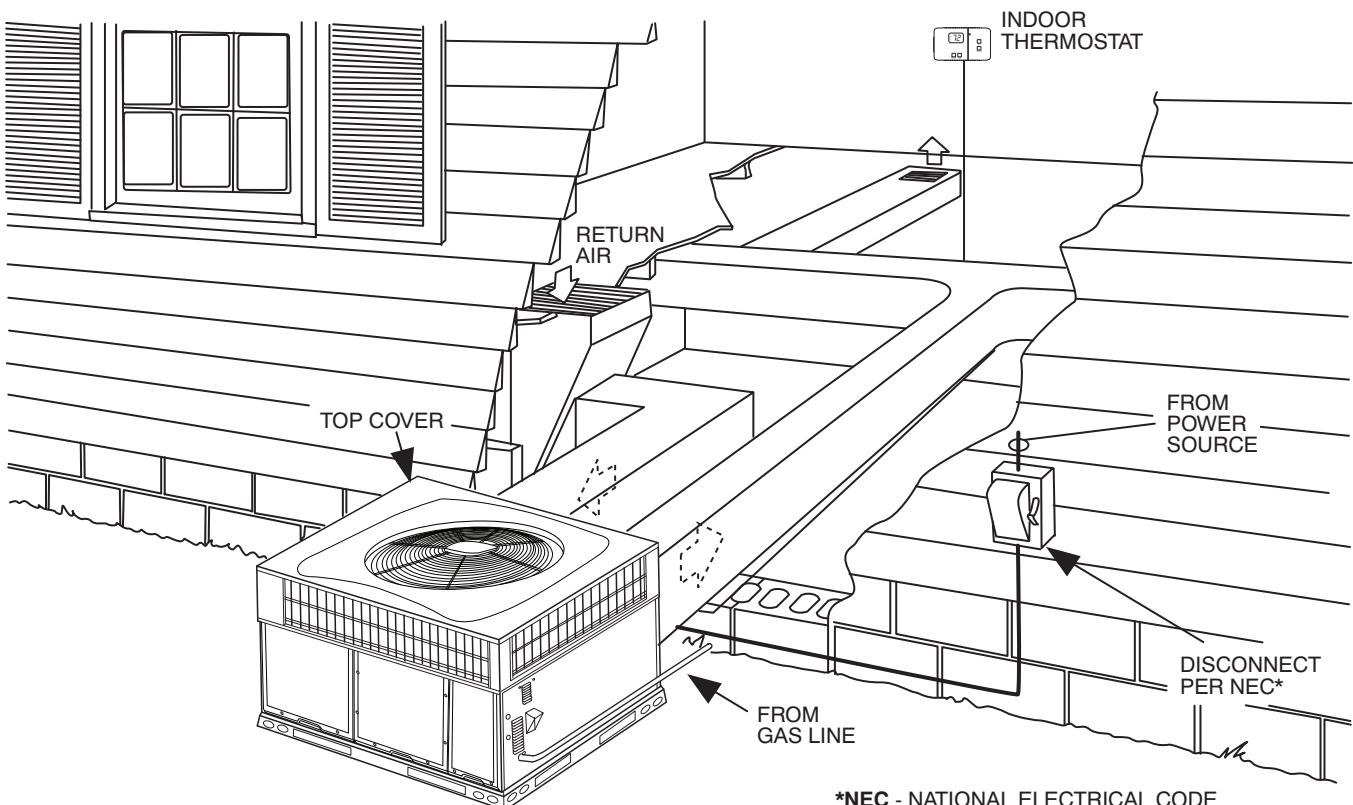

APPLICATION DATA

Condensate trap — A 2-in. (51 mm) condensate trap must be field supplied.

Ductwork — Secure downflow discharge ductwork to roof curb. For horizontal discharge applications, attach ductwork to unit with flanges.

To convert a unit to downflow discharge — Units are equipped with factory-installed inserts in the down-flow openings. Removal of the inserts is similar to removing an electrical knock-out. The unit is factory equipped with duct covers to seal the horizontal discharge openings in the unit. Units installed in horizontal discharge orientation do not require duct covers.

Maximum cooling airflow — To minimize the possibility of condensate blow-off from the evaporator, airflow through the units should not exceed 450 cfm per ton.

Minimum cooling airflow — Minimum cooling airflow is 350 cfm per ton in cooling mode. Airflow can be lower in certain modes when humidity removal is an issue.


Minimum ambient cooling operation temperature — All standard units have a minimum ambient cooling operating temperature of 40°F (4.4°C). With accessory low ambient temperature kit, units can operate at temperatures down to 0°F (-17.8°C).

Maximum operating outdoor air temperature for cooling is 125°F (51.7°C).

BALANCE POINT WORKSHEET

BALANCE POINT WORKSHEET

677C--B

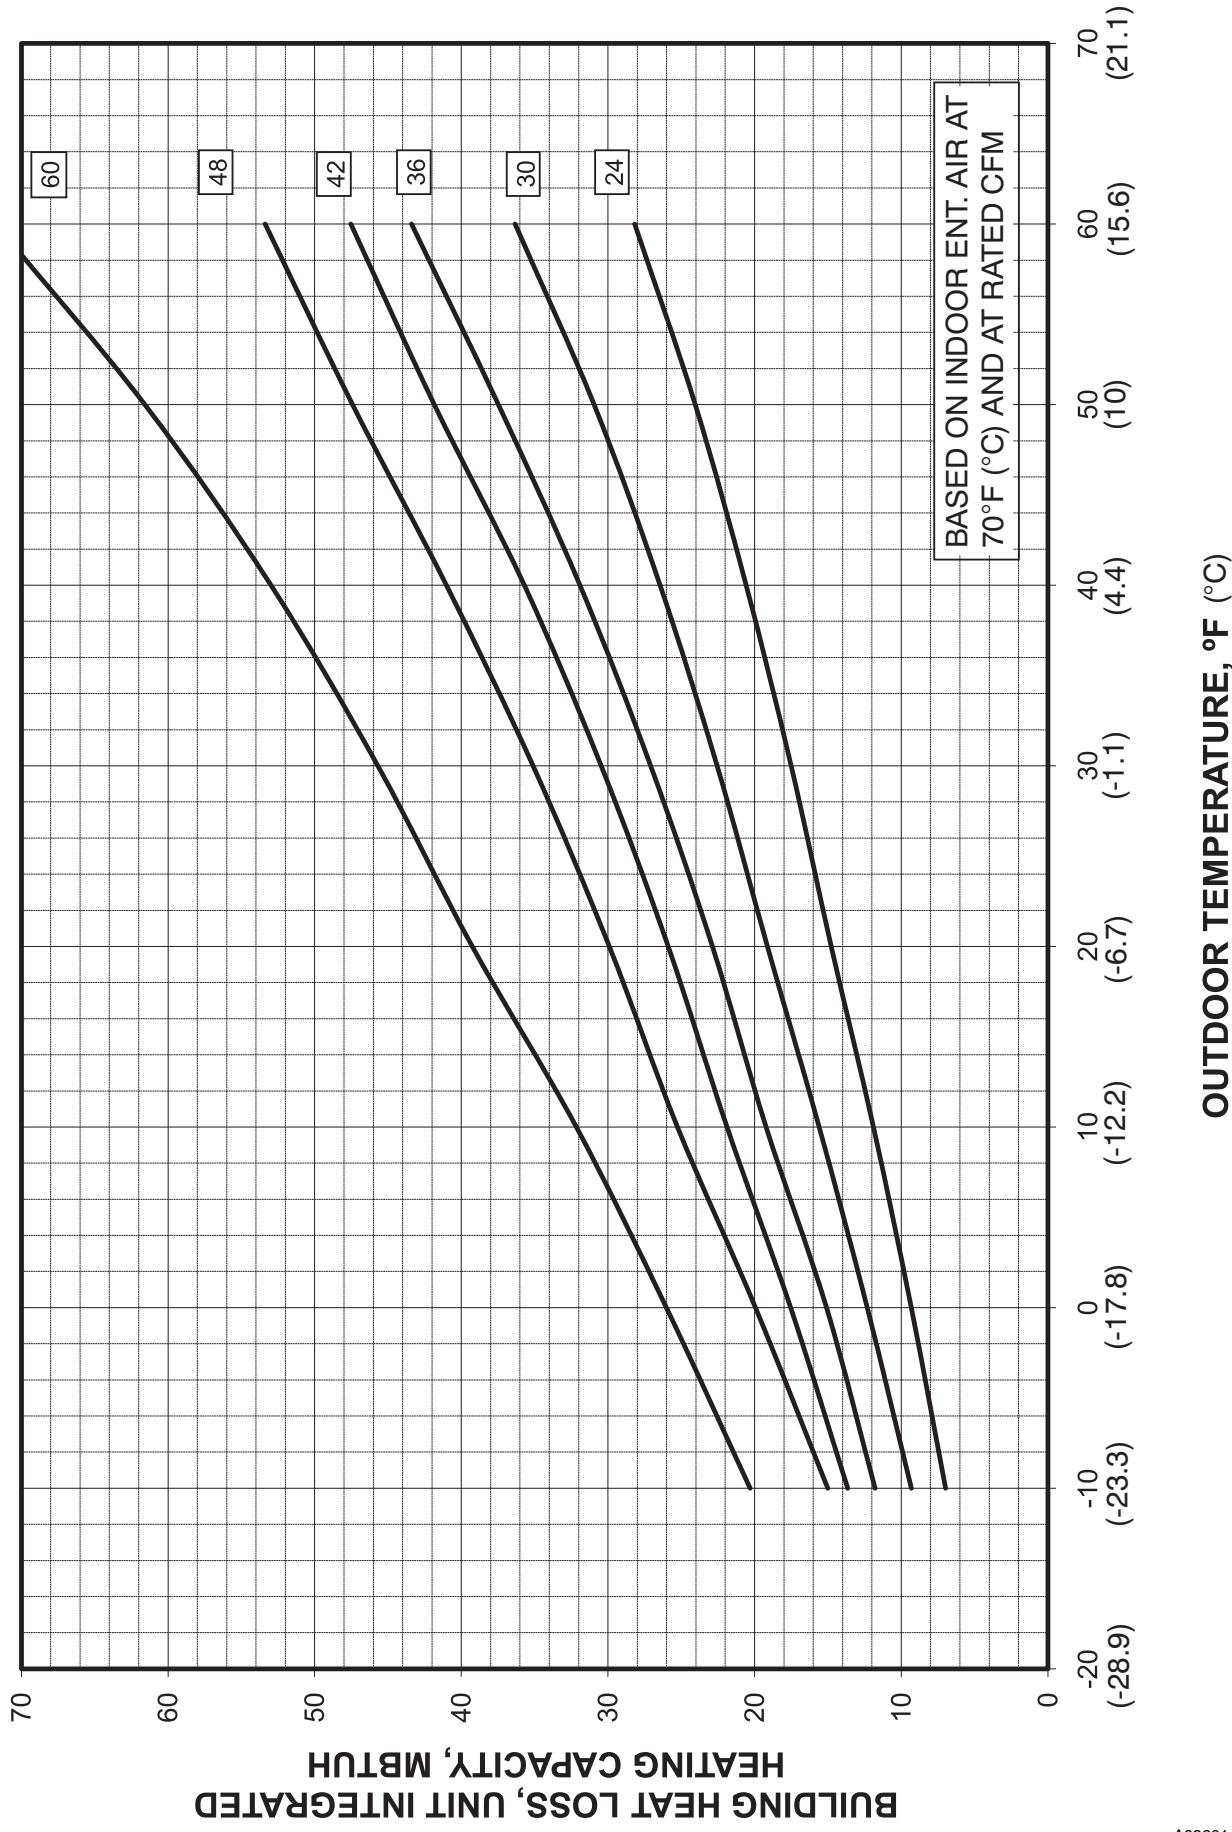

BUILDING HEAT LOSS, UNIT INTEGRATED
HEATING CAPACITY, MBTUH

A09601

ELECTRICAL DATA

MODEL SIZE	NOMINAL V-PH-HZ	VOLTAGE RANGE		COMPRESSOR		OFM	IFM	IDM	POWER SUPPLY	
		MIN	MAX	RLA	LRA	FLA	FLA	FLA	MCA	MOCP
24040	208/230-1-60	187	253	13.5	58.3	0.7	4.1	0.65	21.7	30
24060				13.5	58.3	0.7	4.1	0.65	21.7	30
30040				14.1	73	1.2	4.1	0.65	22.9	35
30060				14.1	73	1.2	4.1	0.65	22.9	35
36060				17.1	79	1.2	6	0.65	28.6	40
36090				17.1	79	1.2	6	0.65	28.6	40
42060				20.6	112	1.2	6	0.65	33.0	50
42090				20.6	112	1.2	6	0.65	33.0	50
48090				20.6	109	1.2	7.6	0.65	34.6	50
48115				20.6	109	1.2	7.6	0.65	34.6	50
48130				20.6	109	1.2	7.6	0.75	34.6	50
60090				26.4	134	1.2	7.6	0.65	41.8	60
60115				26.4	134	1.2	7.6	0.65	41.8	60
60130				26.4	134	1.2	7.6	0.75	41.8	60
30040	208/230-3-60	187	253	9	58	1.2	4.1	0.65	16.6	25
30060				9	58	1.2	4.1	1.65	16.6	25
36060				11.5	88	1.2	6	1.65	21.6	30
36090				11.5	88	1.2	6	0.65	21.6	30
42060				13.5	88	1.2	6	1.65	24.1	35
42090				13.5	88	1.2	6	0.65	24.1	35
48090				16	83	1.2	7.6	0.65	28.8	40
48115				16	83	1.2	7.6	1.65	28.8	40
48130				16	83	1.2	7.6	0.52	28.8	40
60090				19.9	110	1.2	7.6	0.65	33.7	50
60115				19.9	110	1.2	7.6	1.65	33.7	50
60130				19.9	110	1.2	7.6	0.52	33.7	50

LEGEND

FLA - Full Load Amps
 IDM - Inducer Motor
 IFM - Indoor Fan Motor
 LRA - Locked Rotor Amps
 MCA - Minimum Circuit Amps
 MOCP - Maximum Over Current Protection
 OFM - Outdoor Fan Motor
 RLA - Rated Load Amps


NOTES:

- In compliance with NEC (National Electrical Code) requirements for multimotor and combination load equipment (refer to NEC Articles 430 and 440), the overcurrent protective device for the unit shall be Power Supply fuse or circuit breaker.
- Minimum wire size is based on 60 C copper wire. If other than 60 C wire is used, or if length exceeds wire length in table, determine size from NEC.
- Unbalanced 3-Phase Supply Voltage
Never operate a motor where a phase imbalance in supply voltage is greater than 2%. Use the following formula to determine the percentage of voltage imbalance

% Voltage imbalance

$$= 100 \times \frac{\text{max voltage deviation from average voltage}}{\text{average voltage}}$$

EXAMPLE: Supply voltage is 230-3-60.



$$\begin{aligned} AB &= 228 \text{ v} \\ BC &= 231 \text{ v} \\ AC &= 227 \text{ v} \end{aligned}$$

$$\begin{aligned} \text{Average Voltage} &= \frac{228 + 231 + 227}{3} \\ &= \frac{686}{3} \\ &= 229 \end{aligned}$$

Determine maximum deviation from average voltage.

$$\begin{aligned} (AB) 229 - 228 &= 1 \text{ v} \\ (BC) 231 - 229 &= 2 \text{ v} \\ (AC) 229 - 227 &= 2 \text{ v} \end{aligned}$$

Maximum deviation is 2 v.

Determine percent of voltage imbalance

$$\begin{aligned} \% \text{ Voltage Imbalance} &= 100 \times \frac{2}{229} \\ &= 0.8\% \end{aligned}$$

This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%.

IMPORTANT: If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.


A06564

677C -- B

TYPICAL CONNECTION WIRING SCHEMATIC - 208/230-1-60

CONNECTION WIRING DIAGRAM

DANGER: ELECTRICAL SHOCK HAZARD DISCONNECT POWER BEFORE SERVICING

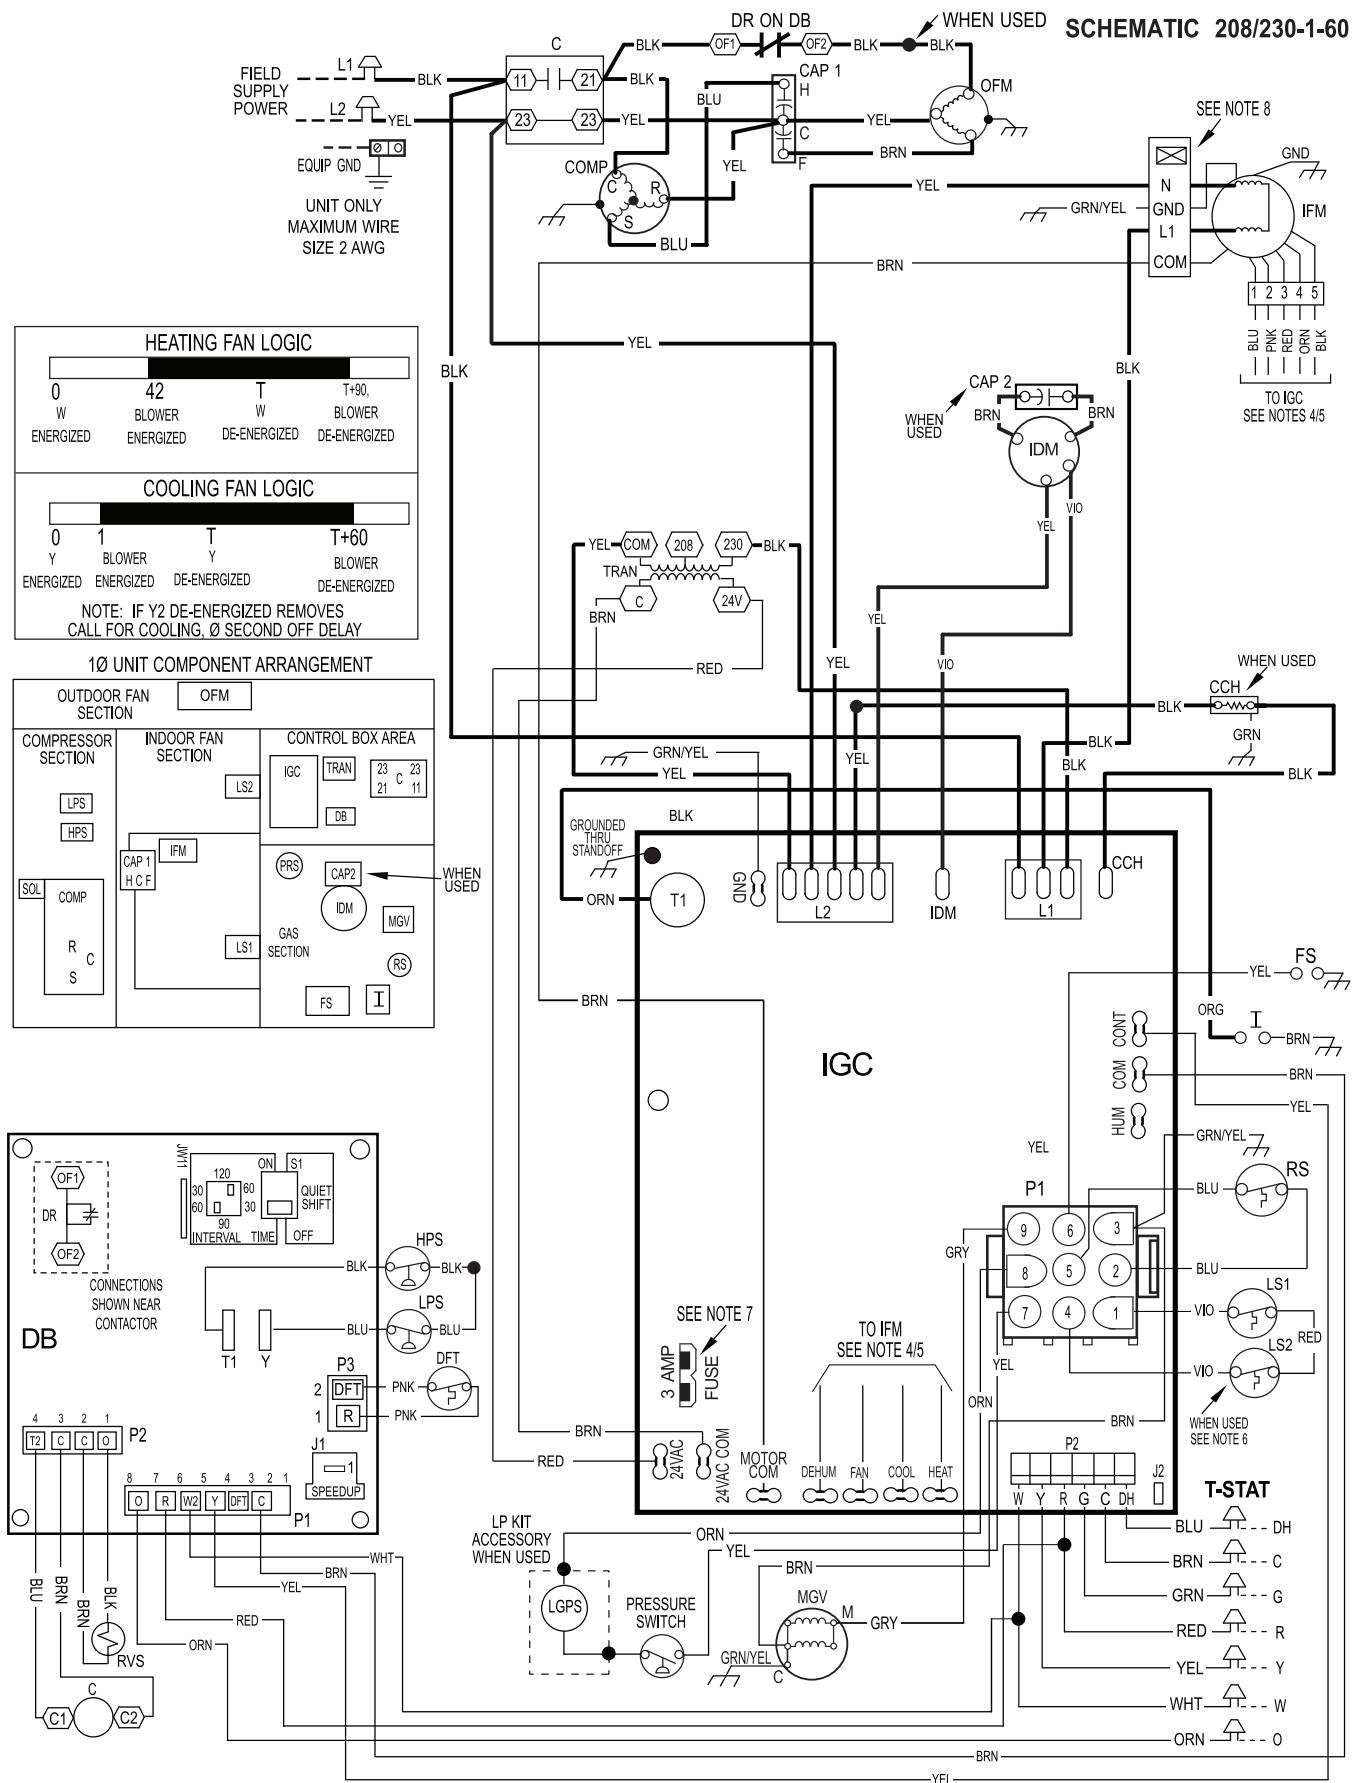

TYPICAL LADDER WIRING SCHEMATIC - 208/230-1-60


LADDER WIRING DIAGRAM

DANGER: ELECTRICAL SHOCK HAZARD DISCONNECT POWER BEFORE SERVICING

LEGEND

△ FIELD SPLICE	DFT DEFROST TEMPERATURE SWITCH
□ TERMINAL (MARKED)	DR DEFROST BOARD RELAY
○ TERMINAL (UNMARKED)	EQUIP EQUIPMENT
● SPLICE	FS FLAME SENSOR
◇ SPLICE (MARKED)	GND GROUND
— FACTORY LO VOLTAGE	HPS HIGH PRESSURE SWITCH
— FIELD CONTROL WIRING	I IGNITOR
— FIELD POWER WIRING	IDM INDUCED DRAFT MOTOR
- - - ACCESSORY OR OPTIONAL	IDR INDUCER RELAY
WIRING	IFM INDOOR FAN MOTOR
— FACTORY HI VOLTAGE	IGC INTEGRATED GAS UNIT CONTROLLER
C CONTACTOR	LGP5 LOW GAS PRESSURE SWITCH (WHEN USED)
CAP1 CAPACITOR, COMP	LPS LOW PRESSURE SWITCH
CAP2 CAPACITOR, INDUCER	LS1 PRIMARY LIMIT SWITCH
CCH CRANKCASE HEATER	LS2 SECONDARY LIMIT SWITCH
COMP COMPRESSOR MOTOR	MGV MAIN GAS VALVE
DB DEFROST BOARD	OFM OUTDOOR FAN MOTOR
	OT QUADRUPLE TERMINAL
	RS ROLLOUT SWITCH
	TRAN TRANSFORMER
	T-STAT THERMOSTAT

DIP SWITCH SETTINGS

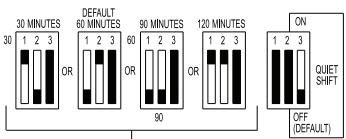


FIELD SELECTABLE OPTIONS FOR TIME PERIOD BETWEEN DEFROST CYCLES (MINUTES)

SPEED UP (OFF) JUMPERED TEST PINS (USE METAL OBJECT) FIELD SPEED UP CYCLE

- 1) MOMENTARILY SHORT PINS AND RELEASE TO BYPASS COMPRESSOR OFF DELAY.
- 2) SHORT FOR 5 SEC. AND RELEASE FOR FORCED DEFROST.
- 3) PERMANENT SHORT WILL BE IGNORED.


DEFROST WILL TERMINATE IN 30 SEC. IF DFT OPEN.
DEFROST WILL TERMINATE NORMALLY IF DFT IS CLOSED.
THE COMPRESSOR WILL SHUT OFF FOR 30 SEC. ON DEFROST INITIATION AND TERMINATION IN THE QUIET SHIFT POSITION.

T-STAT

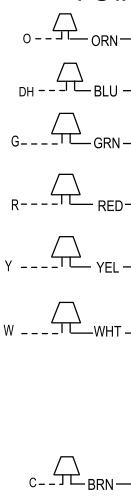

NOTES:

1. IF ANY OF THE ORIGINAL WIRES FURNISHED ARE REPLACED THEY MUST BE REPLACED WITH THE SAME WIRE OR ITS EQUIVALENT.
2. SEE PRE-SALE LITERATURE FOR THERMOSTATS.
3. USE 75 DEGREES C COPPER CONDUCTORS FOR FIELD INSTALLATION.
4. REFER TO INSTALLATION INSTRUCTIONS FOR CORRECT SPEED SELECTION FOR IFM.
5. SEE INSTALLATION INSTRUCTIONS FOR PROPER HEATING AND COOLING CONNECTIONS FOR YOUR UNIT.
6. ON SOME MODELS LS1 AND LS2 ARE WIRED IN SERIES. ON OTHER MODELS ONLY LS1 IS USED.
7. THIS FUSE IS MANUFACTURED BY LITTLE FUSE, P/N 257003.
8. DO NOT DISCONNECT PLUG UNDER LOAD.
9. N.E.C. CLASS 2, 24V.

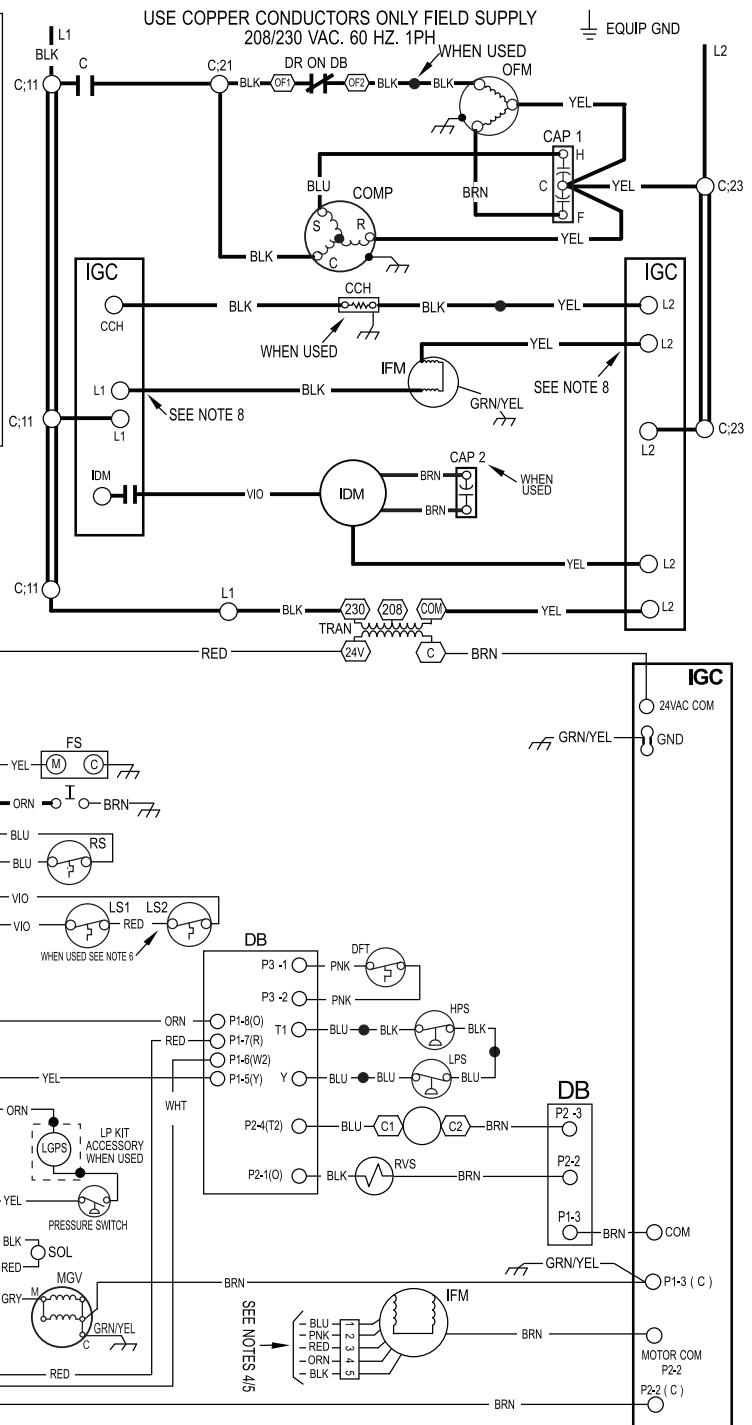

48VT500091 REV. -

A14418

677C --B

TYPICAL CONNECTION WIRING SCHEMATIC - 208/230-3-60

CONNECTION WIRING DIAGRAM


DANGER: ELECTRICAL SHOCK HAZARD DISCONNECT POWER BEFORE SERVICING

SCHEMATIC
208/230-3-60


- NOTES:
1. IF ANY OF THE ORIGINAL WIRES FURNISHED ARE REPLACED, THEY MUST BE REPLACED WITH THE SAME WIRE OR ITS EQUIVALENT.
 2. SEE PRICE PAGES FOR THERMOSTATS.
 3. USE 75 DEG. COPPER CONDUCTORS FOR FIELD INSTALLATION.
 4. SEE INSTALLATION INSTRUCTIONS FOR PROPER HEATING AND COOLING CONNECTIONS FOR YOUR UNIT, MOTOR OR FAN MOTOR PLUGS
 - DO NOT DISCONNECT UNDER LOAD.
 5. THIS FUSE IS MANUFACTURED BY LITTELFUSE, P/N 257003.
 6. THIS FUSE IS MANUFACTURED BY LITTELFUSE, P/N 257005.
 7. INDUCER CAPACITOR AND WIRING ON CERTAIN MODELS ONLY.
 - IF CAP2 IS PRESENT, YELLOW WIRES FROM IGC AND IDM CONNECT ON SAME SIDE OF CAP2.
 8. REMOVE YELLOW SPICE WIRE WHEN ECONOMIZER AND ECONOMIZER RELAYS ARE USED AND CONNECT TO RELAY R1 AS SHOWN.
 9. WHEN ECONOMIZER AND ECONOMIZED RELAYS ARE USED, CONNECT THE YELLOW AND BLACK WIRES TO RELAY R AS SHOWN. RELAY KIT REQUIRED WITH ECONOMIZER AND HEAT PUMP/DUAL FUEL UNITS.
 10. WHEN ECONOMIZER AND ECONOMIZED RELAYS ARE USED, INSTALL WIRES AS SHOWN ONTO THE COILS OF RELAY R AND RELAY R1.
 11. DEHUMIDIFICATION FEATURE CANNOT BE USED WHEN ECONOMIZER IS INSTALLED.

LEGEND

◊ FIELD SPLICE	ECON	ECONOMIZER
◊ TERMINAL (MARKED)	EQUIP	EQUIPMENT
◊ TERMINAL (UNMARKED)	FS	FLAME SENSOR
● SPLICE (IF USED)	GND	GROUND
— SPLICE (MARKED)	HPS	HIGH PRESSURE SWITCH
— FACTORY WIRING	IGC	INTEGRATED GAS UNIT CONTROLLER
-- FIELD CONTROL WIRING	IFB	INDOOR FAN BOARD
-- FIELD POWER WIRING	IDM	INDUCED DRAFT MOTOR
--- ACCESSORY OR OPTIONAL WIRING	IFM	INDOOR FAN MOTOR
CAP 1	LGP5	LOW GAS PRESSURE SWITCH (WHEN USED)
CAP 2	LPS	LOW PRESSURE SWITCH
CAPACITOR, COMP	LS1	PRIMARY LIMIT SWITCH
CAPACITOR, INDUCER	LS2	SECONDARY LIMIT SWITCH
CRANK CASE HEATER	MGV	MAIN GAS VALVE
COMPRESSOR MOTOR	OFM	OUTDOOR FAN MOTOR
COMBUSTION RELAY	PRS	PRESSURE SWITCH
DB	R5	ROLLOUT SWITCH
DFT	RVS	REVERSING VALVE
DEFOST TEMPERATURE SWITCH	SAT	SUPPLY AIR TEMPERATURE
DH	TRAN	TRANSFORMER
DR	DEFROST BOARD RELAY	DEFROST BOARD
DH	R	R
DR	R1	ECON RELAY

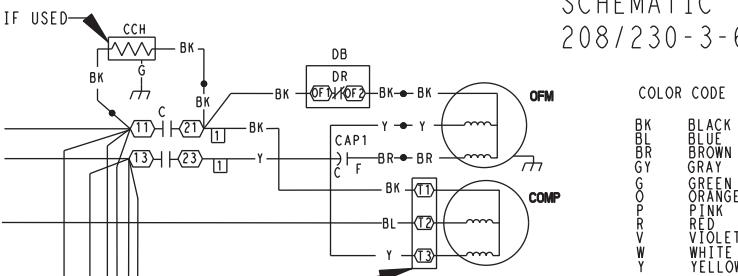

COLOR CODE	
BK	BLACK
BL	BLUE
BR	BROWN
GY	GRAY
G	GREEN
O	ORANGE
P	PINK
R	RED
V	VIOLET
W	WHITE
Y	YELLOW

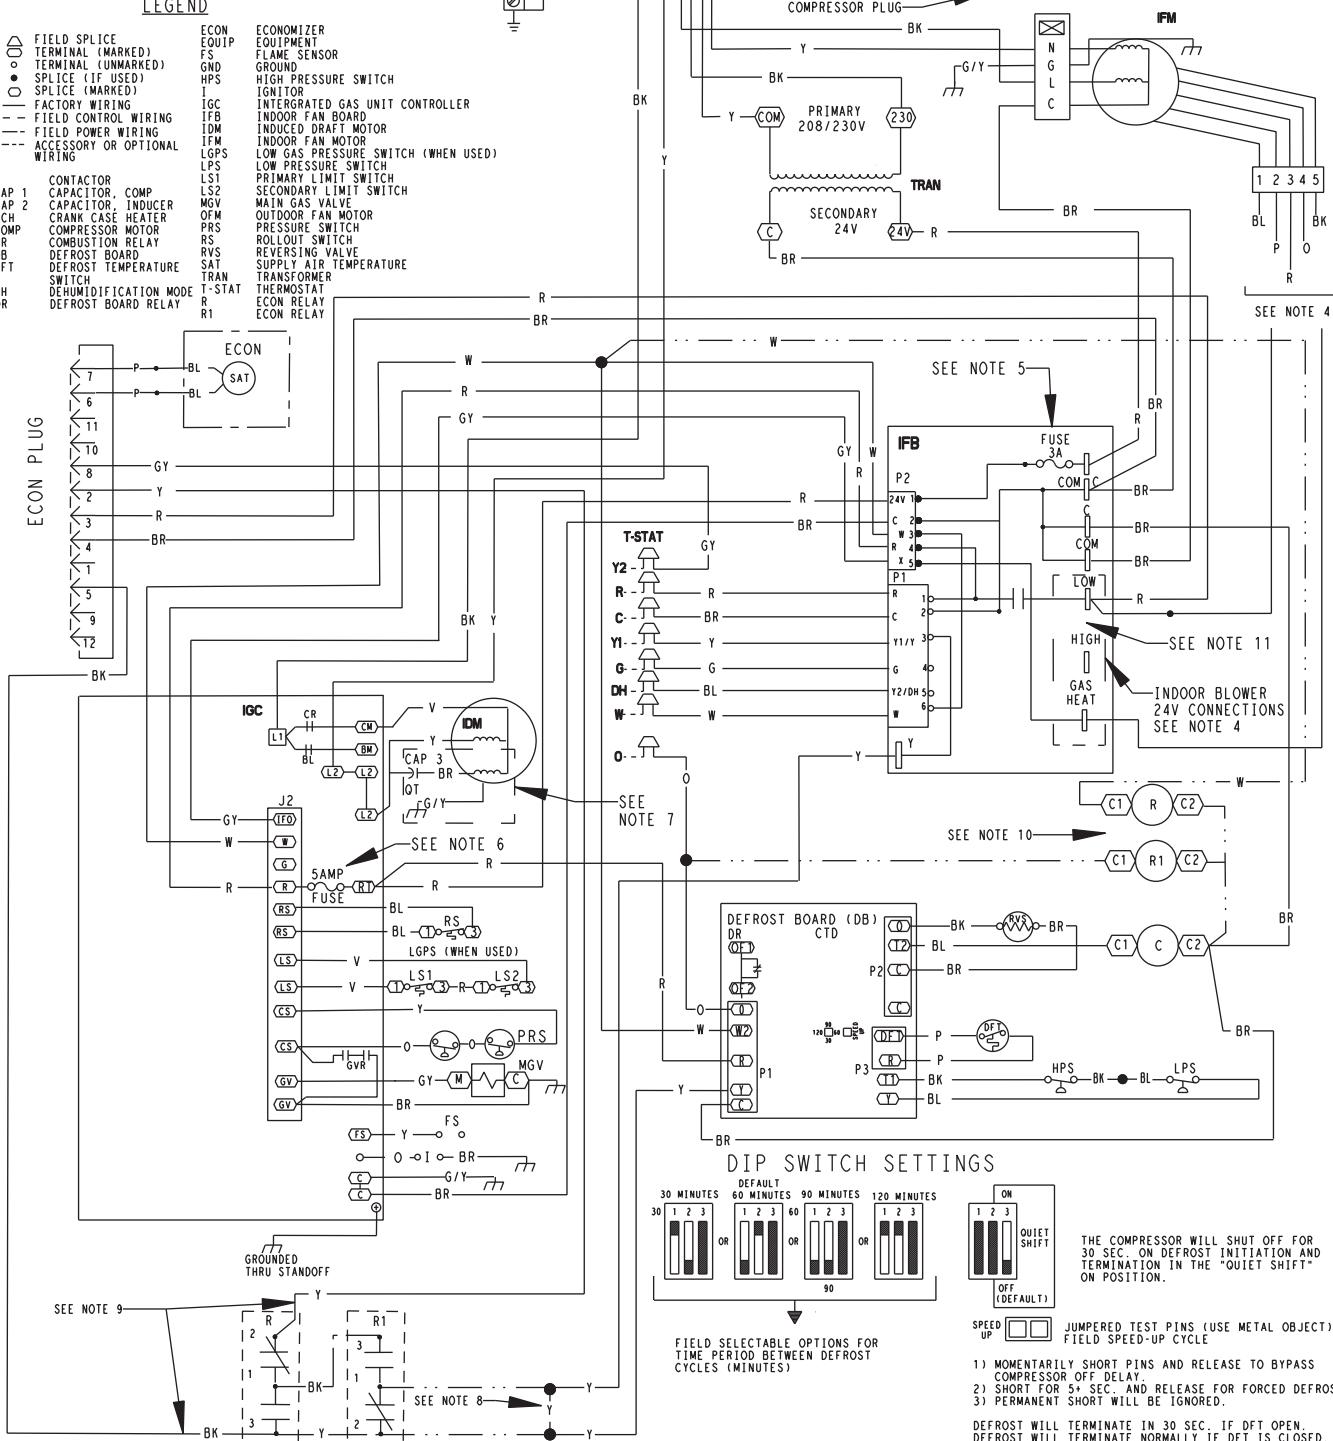

THE COMPRESSOR WILL SHUT OFF FOR 30 SEC. ON DEFROST INITIATION AND TERMINATION IN THE "QUIET SHIFT" POSITION.


- 1) MOMENTARILY SHORT PINS AND RELEASE TO BYPASS COMPRESSOR OFF DELAY.
 2) SHORT FOR 5+ SEC. AND RELEASE FOR FORCED DEFROST.
 3) PERMANENT SHORT WILL BE IGNORED.
 DEFROST WILL TERMINATE IN 30 SEC. IF DFT OPEN.
 DEFROST WILL TERMINATE NORMALLY IF DFT IS CLOSED.

A10208C

TYPICAL LADDER WIRING SCHEMATIC - 208/230-3-60

LADDER WIRING DIAGRAM

DANGER: ELECTRICAL SHOCK HAZARD DISCONNECT POWER BEFORE SERVICING

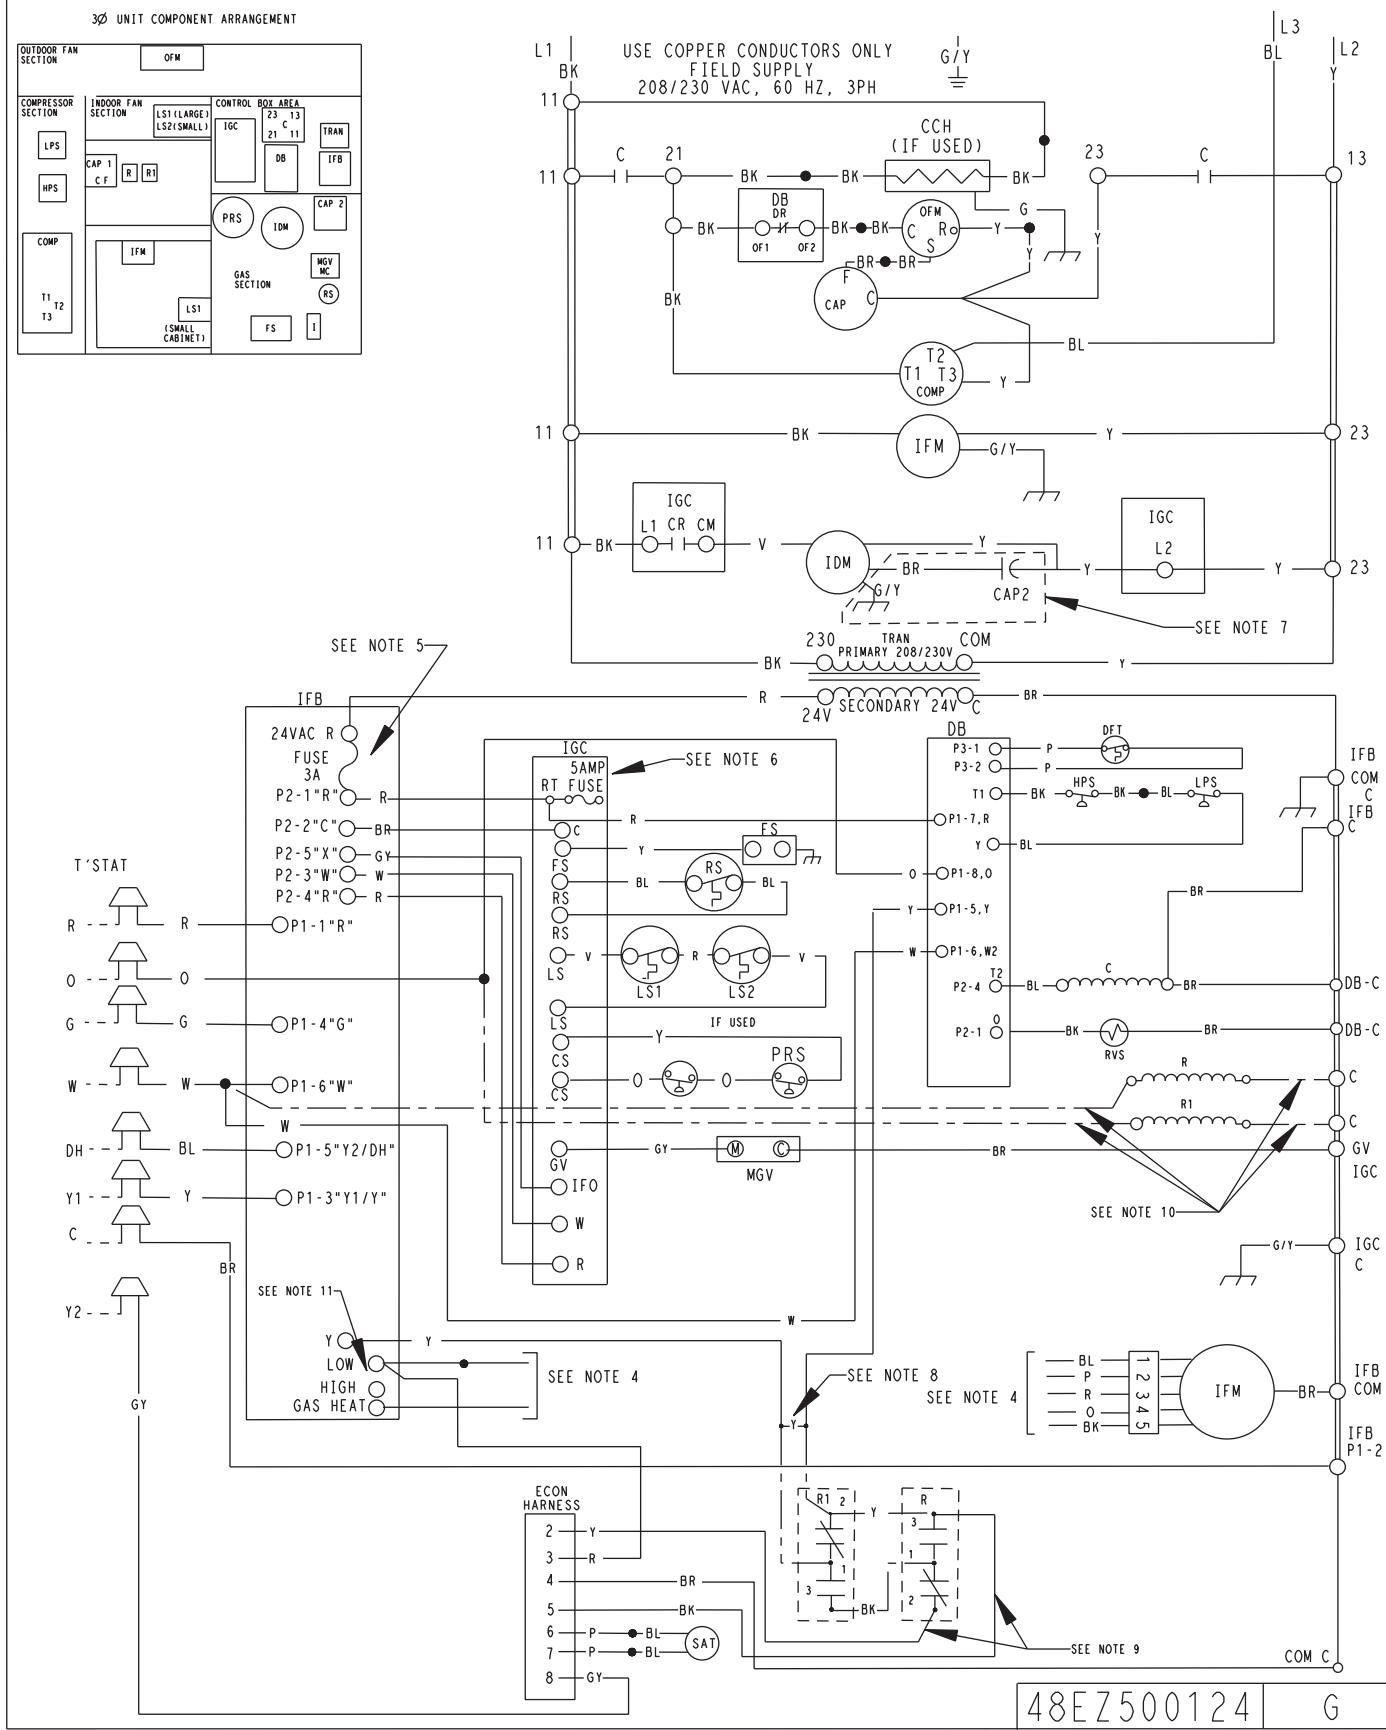

677C -- B

CONTROLS

Operating sequence

When power is supplied to unit, the transformer (TRAN) is energized.

On units with crankcase heater, heater is also energized.

Cooling — With the thermostat subbase in the cooling position, the thermostat makes circuit "R" to "O". This energizes the reversing valve solenoid (RVS) and places the unit in standby condition for cooling.

As the space temperature rises, the thermostat closes circuit "R" to "Y1/Y". A circuit is made to contactor (C), starting the compressor (COMP) and outdoor-fan motor (OFM). Circuit "R" to "G" is made at the same time and starts the indoor-fan motor (IFM).

On the loss of the thermostat call for cooling, 24 V is removed from both the "Y1/Y" and "G" terminals (provided the fan switch is in the "AUTO" position) de-energizing the compressor contactor and opening the contacts supplying power to compressor/OFM. After a 60-second delay (1phase models) or 90 second delay (3 phase models), the IFM shuts off. If the thermostat fan selector switch is in the "ON" position, the IFM will run continuously.

Heating (Single Phase Models)

On a call for heating, terminal W of the thermostat is energized, starting the induced-draft motor for a 5 second pre-purge. When the pressure switch senses that the induced-draft motor is moving sufficient combustion air, the burner sequence begins. This function is controlled by the integrated gas unit controller (IGC). The indoor (evaporator) -fan motor is energized 30 seconds after flame is established. When the thermostat is satisfied and W is de-energized, the burners stop firing and the indoor (evaporator) fan motor shuts off after a 90 second time-off delay. Please note that the IGC has the capability to automatically reduce the indoor fan motor on delay and increase the indoor fan motor off delay in the event of high duct static and/or a partially-clogged filter.

Heating (3-Phase Models)

On a call for heating, terminal W of the thermostat is energized, starting the induced-draft motor. When the pressure switch senses that the induced-draft motor is moving sufficient combustion air, the burner sequence begins. This function is performed by the integrated gas unit controller (IGC). The indoor (evaporator)-fan motor is energized 45 sec after flame is established. When the thermostat is satisfied and W is de-energized, the burners stop firing and the indoor (evaporator) fan motor shuts off after a 45-sec time-off delay. Please note that the IGC has the capability to automatically reduce the indoor fan motor on delay and increase the indoor fan motor off delay in the event of high duct static and/or partially-clogged filter.

Heat Pump Heating — On a call for heat, thermostat makes circuits "R" to "Y1/Y" and "R" to "G".

A circuit is made to C, starting COMP and OFM. Circuit "R" to "G" is also completed, starting IFM.

Defrost — Defrost board (DB) is a time and temperature control, which includes a field-selectable time period (dip switch 1 and 2 on the board) between checks for defrost (30, 60, 90, or 120 minutes). Electronic timer and defrost cycle start only when contactor is energized and defrost thermostat (DFT) is closed.

The defrost board is also equipped with a third dip switch for selecting Quiet Shift operation. The Quiet Shift operation turns compressor off at defrost initiation and termination. Unit is factory shipped with quiet shift turned off.

Defrost mode is identical to cooling mode, except outdoor fan motor stops and gas heat turns on to warm air supplying the conditioned space. After defrost cycle, gas heat stays on to meet the demand cycle.

NOTE:

1. Compressor time delay occurs through the defrost control board.
2. Defrost control board has built in 5 minute compressor delay; once the compressor has started and then stopped, it cannot be restarted again until 5 minutes have elapsed.

GUIDE SPECIFICATIONS

Packaged HYBRID HEAT Dual Fuel Units

HVAC Guide Specifications

Size Range: **2 to 5 Tons, Nominal Cooling
40,000 to 127,000 Btuh,
Nominal Heating Input**

Part 1—General

SYSTEM DESCRIPTION

Outdoor, packaged, air-to-air heat pump unit utilizing a hermetic scroll compressor for cooling duty and optional electric heating. Unit shall discharge supply air vertically or horizontally as shown on contract drawings. Outdoor fan/coil section shall have a draw-thru design with vertical discharge for minimum sound levels.

QUALITY ASSURANCE

- A. Unit shall be rated in accordance with AHRI Standards 210/240 and 270-1995.
- B. Unit shall be designed in accordance with UL Standard 1995 and ANSI Z21.47.
- C. Unit shall be manufactured in a facility registered to ISO 9001 manufacturing quality standard.
- D. Unit shall be UL listed and c-UL certified as a total package for safety requirements.
- E. Roof curb shall be designed to conform to NRCA Standards.
- F. Insulation and adhesives shall meet NFPA 90A requirements for flame spread and smoke generation.
- G. Cabinet insulation shall meet ASHRAE Standard 62P.

DELIVERY, STORAGE AND HANDLING

Unit shall be stored and handled per manufacturer's recommendations.

Part 2 — Products

EQUIPMENT

A. General:

Factory-assembled, single-piece, heat pump unit. Contained within the enclosure shall be all factory wiring, piping, controls, refrigerant charge (R-410A), and special features required prior to field start-up.

B. Unit Cabinet:

1. Unit cabinet shall be constructed of phosphated, zinc-coated, pre-painted steel capable of withstanding 500 hours of salt spray.
2. Normal service shall be through a single removable cabinet panel.
3. The unit shall be constructed on a rust proof unit base that has an externally trapped, integrated sloped drain.
4. Indoor fan compartment top surface shall be insulated with a minimum 1/2-in. (13 mm) thick, flexible fiberglass insulation, coated on the air side and retained by adhesive and mechanical means. The indoor wall sections will be insulated with a minimum semi-rigid, foil-faced board capable of being wiped clean. Aluminum foil-faced fiberglass insulation shall be used in the entire indoor air cavity section.
5. Unit shall have a field-supplied condensate trap.
6. Metal Insulated Duct Covers for side discharge will be standard on all sizes.
7. Unit insulation conforms to ASHRAE 62P.

C. Fans:

1. The evaporator fan motor shall be a ECM Motor.
2. Fan wheel shall be made from steel, be double-inlet type with forward curved blades with corrosion resistant finish. Fan wheel shall be dynamically balanced.
3. Condenser fan shall be direct drive propeller type with aluminum blades riveted to corrosion resistant steel spiders, be dynamically balanced, and discharge air vertically.

D. Compressor:

1. Fully hermetic compressors with factory-installed vibration isolation.
2. Scroll compressors shall be standard on all units.
3. Compressor Protection:
Defrost control shall protect compressor by preventing "short cycling."

E. Coils:

Indoor and outdoor coils shall have aluminum plate fins mechanically bonded to seamless copper tubes with all joints brazed. Tube sheet openings shall be belled to prevent tube wear.

F. Refrigerant Metering Device:

Refrigerant metering device shall be thermostatic expansion valve for cooling, and fixed orifice for heating.

G. Filters:

Filter section shall consist of field-installed, throwaway, 1-in. (25 mm)- thick fiberglass filters of commercially available sizes.

H. Controls and Safeties:

1. Unit controls shall be complete with a self-contained, low-voltage control circuit.
2. Units shall incorporate an internal compressor protector that provides reset capability.

I. Operating Characteristics:

1. Unit shall be capable of starting and running at 125°F (51.7°C) ambient outdoor temperature.
2. Compressor with standard controls shall be capable of operation down to 40°F (4.4°C) ambient outdoor temperature in cooling mode.
3. Unit shall be provided with 60-second fan time (single phase), 90-second fan time delay (three phase) after the thermostat is satisfied.

J. Electrical Requirements:

All unit power wiring shall enter the unit cabinet at a single location.

K. Motors:

1. Compressor motors shall be of the refrigerant-cooled type with line-break thermal and current overload protection.
2. All fan motors shall have permanently lubricated bearings, and inherent, automatic reset, thermal overload protection.
3. Condenser fan motor shall be totally enclosed.
4. Evaporator Fan Motor to be ECM Motor.

GUIDE SPECIFICATIONS (CONT)

L. Compressor Protection:

Solid-state control shall protect compressor by preventing "short cycling."

M. Low NOx:

Shall provide NOx reduction to values below 40 nanograms/joule to meet California's and other localities' emission requirements as shipped from factory.

N. Special Features Available:

1. Coil Options

Base unit with tin plated indoor coil hairpins available as a factory installed option.

2. Compressor Start Kit

Shall provide additional starting torque for single-phase compressors.

3. Thermostat:

To provide for HYBRID HEAT two stage heating and one stage cooling in addition manual or automatic changeover and indoor fan control.

4. Crankcase Heater:

Shall provide anti-floodback protection for lowload cooling applications.

5. Economizer:

(Horizontal - Field installed accessory)

(Vertical - Field installed accessory or factory installed option)

a. Economizer controls capable of providing free cooling using outside air.

b. Equipped with low leakage dampers not to exceed 3% leakage, at 1.0 IN. W.C. pressure differential.

c. Spring return motor shuts off outdoor damper on power failure.

6. Filter Rack Kit:

Shall provide filter mounting for downflow applications. Offered as an accessory or as a factory installed option.

7. Flat Roof Curb:

Curbs shall have seal strip and a wood nailing for flashing and shall be installed per manufacturer's instructions.

8. Flue Discharge Deflector

Directs flue gas exhaust 90 degrees upward from current discharge.

9. Heat Exchanger

Stainless Steel Heat Exchanger available as a factory installed option.

10. High Altitude Propane conversion Kit

Shall consist of all required hardware to convert to propane gas heat operation at 2001 to 6000 ft (611 to 1829 m) above sea level.

11. Low Ambient Package:

Shall consist of a solid-state control and outdoor coil temperature sensor for controlling outdoor-fan motor operation, which shall allow unit to operate down to 0°F (17.7°C) outdoor ambient temperature.

12. Manual Outdoor Air Damper:

Package shall consist of damper, birdscreens, and rainhood which can be preset to admit outdoor air for year-round ventilation.

13. Natural-to-Propane Conversion Kit:

Shall be complete with all required hardware to convert to propane gas operation at standard altitude (0 to 2000 ft [0-610 m] above sea level).

14. Propane-to-Natural Conversion Kit:

Shall be complete with all hardware to convert to natural gas at standard altitude (0 to 2000 ft [0 to 610 m] above sea level).

15. Square-To-Round Duct Transitions (24-48 models):

Shall have the ability to convert the supply and return openings from rectangular to round.