


# Cambridgeport

## SUBMITTAL

SUBMITTED TO \_\_\_\_\_  
COMPANY \_\_\_\_\_  
JOB NAME \_\_\_\_\_  
EQUIPMENT \_\_\_\_\_  
SIGNATURE \_\_\_\_\_  
DATE \_\_\_\_\_

**Part # 2000071  
(2000CP)**

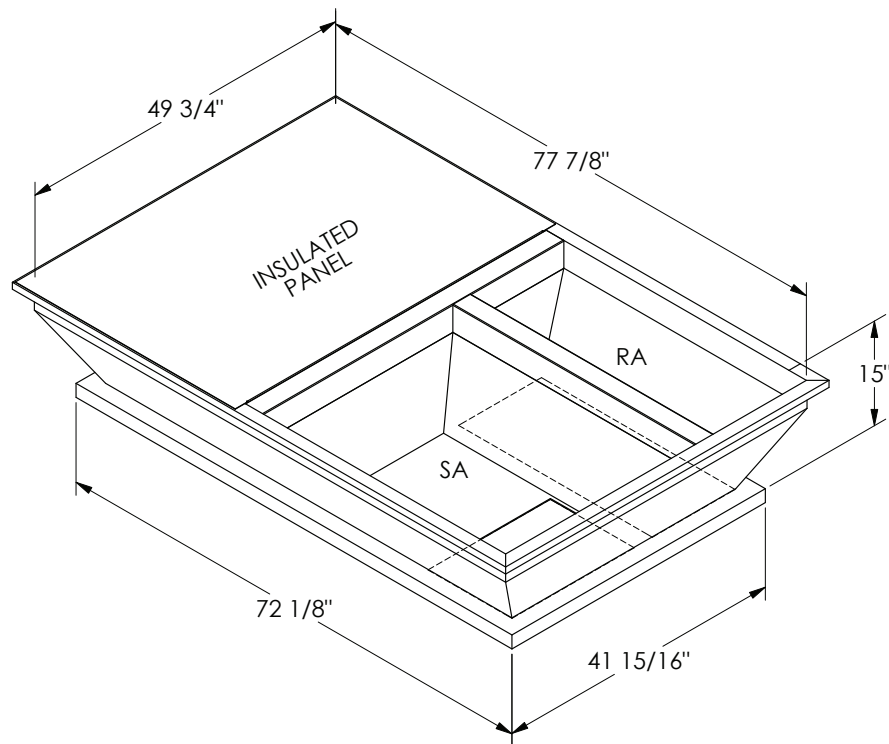

## FEATURES

ONE-PIECE WELDED CONSTRUCTION  
ALL WELDS SPRAYED WITH GALVANIZING COMPOUND  
FACTORY INSTALL SUPPLY TRANSITION  
FULLY INSULATED WITH 1" - 1 1/2 LB DENSITY INSULATION  
FABRICATED OF HEAVY GAUGE GALVANIZED STEEL  
SLOPE DESIGN FOR EVEN WEIGHT DISTRIBUTION TO EXISTING CURB  
GASKET PROVIDED FOR UNIT TO ADAPTER SEALING

### Existing Unit(s)

#### Carrier:

48/50 DJ,HJ,HM,LJ,QJ,TF,TJ,GJ 004-007  
48/50 TC 04-07

#### Bryant:

548C, 551A, B 558C, D 036-072  
580C, D 581 A, B 036-072

### New Unit(s)

#### CARRIER:

48/50 GJ, HJ, TJ, TF, TM 008-014;  
48/50 TC 08, 09, 12, 14 ; 50 TCQ 08, 09, 12  
48/50 HC 07, 08, 09, 12, 50 HCQ 07, 08, 09

#### BRYANT:

548C,D,F ; 551A, B; 558C, D, F;  
580C, D, F; 581A, B; 549B 090-150  
558J, 580J 08, 09, 12, 14 ; 551J, 581J 07, 08, 09, 12  
548J 08, 09, 12 ; 549J 07, 08, 09