


Cambridgeport

**Part # 2000089
(2200CP)**

SUBMITTAL

SUBMITTED TO _____
COMPANY _____
JOB NAME _____
EQUIPMENT _____
SIGNATURE _____
DATE _____

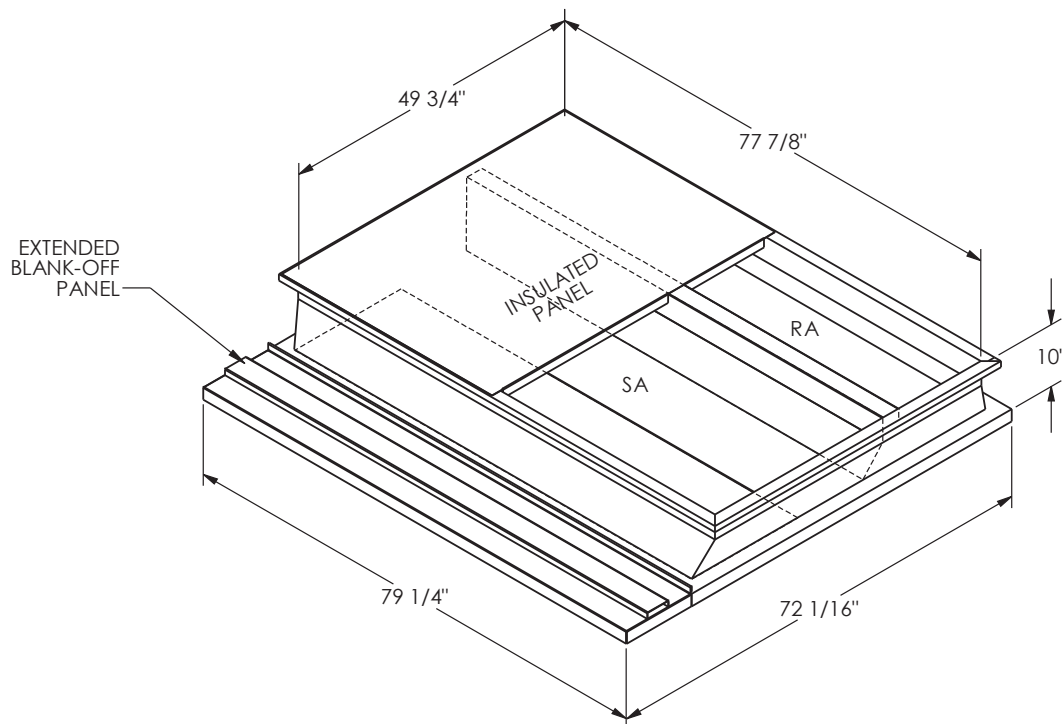

FEATURES

ONE-PIECE WELDED CONSTRUCTION
ALL WELDS SPRAYED WITH GALVANIZING COMPOUND
FACTORY INSTALL SUPPLY TRANSITION
FULLY INSULATED WITH 1"- 1 1/2 LB DENSITY INSULATION
FABRICATED OF HEAVY GAUGE GALVANIZED STEEL
SLOPE DESIGN FOR EVEN WEIGHT DISTRIBUTION TO EXISTING CURB
GASKET PROVIDED FOR UNIT TO ADAPTER SEALING

Existing Unit(s)

Bryant:

542F, 559D, 579D 120-180, 559C, 579C, 599C 090-150,
559E, 579E 180-240, 559F 180-300, 579D E 216, 579F
180, 216, 579F 240275, 300275, 579F-V 240360, 300360,
581A 155, 180, 240275, 300275, 581A-V 240360, 300360

Carrier:

48 HJD, HJF 025, 48 TJ 016, 020
48 TJD, TJF 024, 028, 48/50 DP, DR, PQ 012-020
48/50 HJ 015-025, 50 TJ 016-028

New Unit(s)

CARRIER:

48/50 GJ, HJ, TJ, TF, TM 008-014;
48/50 TC 08, 09, 12, 14 ; 50 TCQ 08, 09, 12
48/50 HC 07, 08, 09, 12, 50 HCQ 07, 08, 09, 12

BRYANT:

548C, D, F ; 551A, B ; 558C, D, F;
580C, D, F ; 581A, B ; 549B 090-150
558J, 580J 08, 09, 12, 14 ; 551J, 581J 07, 08, 09, 12
548J 08, 09, 12 ; 549J 07, 08, 09