48KC
Gas Heat/Electric Cooling
Single Packaged Rooftop
14 SEER
3 to 5 Nominal Tons



# **Product Data**





C08613





# TABLE OF CONTENTS

PAGE	PAGE
FEATURES AND BENEFITS	APPLICATION DATA
MODEL NUMBER NOMENCLATURE 4	COOLING TABLES
FACTORY OPTIONS AND/OR ACCESSORIES 5	STATIC PRESSURE ADDERS
AHRI COOLING RATING TABLES 8	FAN PERFORMANCE
HEAT RATING TABLE 8	ELECTRICAL INFORMATION
SOUND PERFORMANCE TABLE 9	SEQUENCE OF OPERATION
PHYSICAL DATA	GUIDE SPECIFICATIONS
CLIDES WEIGHTS & DIMENSIONS 14	



# Turn to the Experts.

The Carrier rooftop unit (RTU) was designed by customers for customers. With "no-strip screw" collars, handled access panels, and more we've made your unit easy to install, easy to maintain and easy to use.

# Easy to install:

All WeatherMaker® units are field-convertible to horizontal air flow which makes it easy to adjust to unexpected job site complications. Lighter units make easy replacement. Carrier 48KC rooftops fit on existing Carrier curbs dating back to 1989. Also, our large control box gives you room to work and room to mount Carrier accessory controls.

#### Easy to maintain:

Easy access handles by Carrier provide quick and easy access to all normally serviced components. Our "no-strip" screw system has superior holding power and guides screws into position while preventing the screw from stripping the unit's metal. Take accurate pressure readings by reading condenser pressure with panels on. Simply remove the black, composite plug, route your gauge line(s) through the hole, and connect them to the refrigeration service valve(s).

#### Easy to use:

The newly designed, central terminal board by Carrier puts all your connections and troubleshooting points in one convenient place, standard. Most low voltage connections are made to the same board and make it easy to find what you're looking for and easy to access it. Carrier rooftops have high and low pressure switches, a filter drier, and 2-in (51mm) filters standard.

### FEATURES AND BENEFITS

- Single cooling stage models are available from 3 5 ton.
- SEER up to 14.1.
- EER's up to 12.0.
- Up to 28% lighter than similar industry units. Lighter rooftops make easier replacement jobs.
- Utility connections are the same because 3 5 ton units fit on existing Carrier rooftop curbs. This saves time and money on replacement jobs.
- Standardized components and layout. Standardized components and controls make service and stocking parts easier.
- Scroll compressors on all units. This makes service, stocking parts, replacement, and troubleshooting easier.
- Field convertible airflow. Being able to convert a unit from vertical airflow to horizontal makes it easy to overcome job site complications.
- Standard Direct Drive ECM indoor motor with optional belt drive system to meet nearly all applications.
- Provisions for bottom or side condensate drain.
- Capable of thru-the-base or thru-the-curb gas line routing.
- Single-point gas / electrical connection.
- Sloped, composite drain pan sheds water; and won't rust.
- Standardized controls & control box layout. Standardized components & controls make stocking parts & service easier.
- Tool-less filter access door.
- Clean, large, easy to use control box.
- Color-coded wiring.
- Large, laminated wiring and power wiring drawings which are affixed to unit make troubleshooting easy.
- Single, central terminal board for test and wiring connections.
- Fast-access, handled, panels for easy access on normally accessed service panels.
- "No-strip" screw system guides screws into the panel & captures them tightly without stripping the screw, the panel, or the unit.
- Mechanical cooling (115°F to 40°F or 46°C to 4°C) standard on all models. Winter Start Kit allows cooling operation down to 25°F (-4°C) and MotorMaster to -20°F (-29°C).
- High efficiency, gas heat with induced-draft flue exhaust design.
- Induced draft motor ensures no flue gas can escape into the indoor air stream.
- Carrier designed naturally draining heat exchanger, unlike positive pressure heat exchangers, do not need to be periodically, manually drained. This saves labor and maintenance expense.
- 2-in (51mm) disposable filters on all units.
- Refrigerant filter-drier on each circuit.
- Each circuit is protected with a high and low pressure switch.
- Many factory-installed options ranging from air management economizers, 2 position dampers, plus convenience outlets, disconnect switches and smoke detectors.
- Standard (parts only) Warranty: 15 yr. Stainless steel, 10 yr. aluminized heat exchanger, 5 yr. compressor, 1 yr. parts.
- Factory-installed Humidi-MiZer® adaptive dehumidification system on all sizes with round tube / plate fin condenser coils, includes MotorMaster I controller.

#### MODEL NUMBER NOMENCLATURE

Position:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18
Example:	4	8	K	C	D	Α	0	4	Α	0	Α	5	_	0	Α	0	Α	0

#### **Unit Heat Type**

48 - Gas Heat Packaged Rooftop

#### Model Series - WeatherMaker®

KC - Standard 14 SEER Efficiency

#### **Heat Options**

- D = Low Gas Heat
- E = Medium Gas Heat
- F = High Gas Heat
- L = Low Nox Low Gas Heat
- M = Low Nox Medium Gas Heat
- N = Low Nox High Gas Heat
- S = Low Heat w/ Stainless Steel Exchanger
- R = Medium Heat w/ Stainless Steel Exchanger
- T = High Heat w/ Stainless Steel Exchanger
- (Low Nox models include Stainless Steel HX)

#### Refrig. Systems Options

- A = Standard One Stage Cooling Models
- B = Standard One Stage Cooling Models with Humidi-MiZer®

#### **Cooling Tons**

- 04 3 ton
- 05 4 ton
- 06 5 ton

#### **Sensor Options**

- A = None
- B = RA Smoke Detector
- C = SA Smoke Detector
- D = RA + SA Smoke Detector
- $E = CO_2$
- F = RA Smoke Detector and CO<sub>2</sub>
- G = SA Smoke Detector and CO<sub>2</sub>
- H = RA + SA Smoke Detector and CO<sub>2</sub>

#### **Indoor Fan Options**

- 0 = Direct Drive ECM
- 2 = Medium Static Option
- 3 = High Static Option

# Coil Options - Round Tube/Plate Fin Condenser Coil (Outdoor - Indoor - Hail Guard)

- $\dot{A} = AI/Cu AI/Cu$
- B = Precoat Al/Cu Al/Cu
- C = E-coat Al/Cu Al/Cu
- D = E-coat Al/Cu E-coat Al/Cu
- E = Cu/Cu Al/Cu
- F = Cu/Cu Cu/Cu
- M = Al/Cu -Al/Cu Louvered Hail Guard
- N = Precoat Al/Cu Al/Cu Louvered Hail Guard
- P = E-coat Al/Cu Al/Cu Louvered Hail Guard
- Q = E-coat Al/Cu E-coat Al/Cu Louvered Hail Guard
- R = Cu/Cu Al/Cu Louvered Hail Guard
- S = Cu/Cu Cu/Cu Louvered Hail Guard

#### **Factory Assigned**

0 = Standard

1 = LTL

#### **Electrical Options**

- A = None
- C = Non-Fused Disconnect
- D = Thru-The-Base Connections
- F = Non-Fused Disconnect and Thru-The-Base Connections

#### **Service Options**

- 0 = None
- 1 = Unpowered Convenience Outlet
- 2 = Powered Convenience Outlet
- 3 = Hinged Access Panels
- 4 = Hinged Access Panels and Unpowered Convenience Outlet
- 5 = Hinged Panels and

Powered Convenience Outlet

#### Intake / Exhaust Options

- A = None
- B = Temperature Economizer w/ Barometric Relief
- F = Enthalpy Economizer w/ Barometric Relief
- K = 2-Position Damper
- U = Temperature Ultra Low Leak Economizer w/ Barometric Relief
- W= Enthalpy Ultra Low Leak Economizer w/ Barometric Relief

#### **Base Unit Controls**

- 0 = Electro-mechanical Controls can be used with W7212 EconoMi\$er IV (Non-Fault Detection and Diagnostic
- 1 = PremierLink Controller
- 2 = RTU Open Multi-Protocol Controller
- 6 = Electro-mechanical with W7220 Economizer controller Controls. Can be used with W7220 EconoMi\$er X (with Fault Detection and Diagnostic)

## **Design Revision**

- = Factory Design Revision

# Voltage

- 1 = 575/3/60
- 3 = 208-230/1/60
- 5 = 208-230/3/60
- 6 = 460/3/60

# Note: On single phase (-3 voltage code) models, the following are not available as a factory installed option:

- Humidi-MiZer
- Coated Coils or Cu Fin Coils
- Louvered Hail Guards
- Economizer or 2 Position Damper
- Powered 115 Volt Convenience Outlet

C14312

Table 1 – FACTORY-INSTALLED OPTIONS AND FIELD-INSTALLED ACCESSORIES

CATEGORY	ITEM	FACTORY INSTALLED OPTION	FIELD INSTALLED ACCESSORY
Oakinat	Thru-the-base electrical or gas-line connections	Х	Х
Cabinet	Hinged Access Panels	Х	
	Cu/Cu indoor and/or outdoor coils 5	Х	
Coil Options	Pre-coated outdoor coils 5	Х	
	Premium, E-coated outdoor coils <sup>5</sup>	Х	
Humidity Control	Humidi-MiZer Adaptive Dehumidification System <sup>5</sup>	Х	
Condenser Protection	Condenser coil hail guard (louvered design) <sup>5</sup>	Х	X
	Thermostats, temperature sensors, and subbases		X
	PremierLink DDC communicating controller	Х	Х
	RTU Open multi – protocol controller	Х	
Controls	Smoke detector (supply and/or return air)	X	
	Time Guard II compressor delay control circuit		Х
	Phase Monitor		Х
	EconoMi\$er IV for electro – mechanical controls – Non FDD (Standard air leak damper models) <sup>5, 6</sup>	Х	Х
Economico vo	EconoMi\$er2 for DDC controls, complies with FDD (Standard and Ultra Low Leak air damper models) 5, 7	Х	Х
Economizers & Outdoor Air	Motorized 2 position outdoor air damper <sup>5</sup>	Х	Х
Dampers	Manual outdoor air damper (25% and 50%)		X
	Barometric relief <sup>1</sup>	Х	Х
	Power exhaust		Х
	EconoMi\$er X for electro-mechanical controls, complies with FDD. (Standard and Ultra Low Leak air damper models) <sup>5, 6</sup>	х	Х
	Single dry bulb temperature sensors <sup>2</sup>	Х	Х
Faanamisaa	Differential dry bulb temperature sensors <sup>2</sup>		Х
Economizer Sensors	Single enthalpy sensors <sup>2</sup>	Х	Х
&	Differential enthalpy sensors <sup>2</sup>		Х
IAQ Devices	Wall or duct mounted CO <sub>2</sub> sensor <sup>2</sup>		Х
	Unit mounted CO <sub>2</sub> sensor <sup>2</sup>	X	
	Propane conversion kit		Х
	Stainless steel heat exchanger	Х	
Gas Heat	High altitude conversion kit		Х
	Flue Shield		Х
	Flue Discharge Deflector		Х
Indoor Motor & Drive	Multiple motor and drive packages	Х	
Low Ambient	Winter start kit <sup>3</sup>		Х
Control	Motormaster® head pressure controller <sup>3</sup>		X
	Convenience outlet (powered) <sup>5</sup>	Х	
Power	Convenience outlet (un-powered)	X	
Options	Non-fused disconnect 4	X	
	Roof curb 14-in (356mm)		Х
Roof Curbs	Roof curb 24–in (610mm)		X
	, ,	1	1

#### NOTES:

- 1. Included with economizer.
- 2. Sensors used to optimize economizer performance.
- 3. See application data for assistance.
- 4. Available on units with MOCP's of 80 amps or less.
- 5. Not available as factory installed option on single phase (208/230/1/60) models. Use field installed accessory where available.
- 6. FDD (Fault Detection and Diagnostic) capability per California Title 24 section 120.2.
- 7. Models with RTU Open DDC controls comply with California Title 24 Fault Detection and Diagnostic (FDD). PremierLink is non FDD.

## FACTORY OPTIONS AND/OR ACCESSORIES

#### **Economizer**

Economizers save energy, money and improve comfort levels in the conditioned space. They bring in fresh, outside air for ventilation; and provide cool outside air to cool your building. This also is the preferred method of low ambient cooling. When integrated with CO<sub>2</sub> sensors, economizers can provide even more savings by coupling the ventilation air to only that amount required based on space occupancy. Economizers are available, installed and tested by the factory, with either enthalpy or temperature drv-bulb inputs. There are also models electromechanical direct and digital controllers. Additional sensors are available as accessories to optimize the economizer. Economizers include gravity controlled barometric relief that helps equalize building pressure and ambient air pressures. This can be a cost effective solution to prevent building pressurization. Economizers are available in Ultra Low Leak and standard low leak versions.

## CO<sub>2</sub> Sensor

Improves productivity and saves money by working with the economizer to intake only the correct amount of outside air for ventilation. As occupants fill your building, the  $\mathrm{CO}_2$  sensor detects their presence through increasing  $\mathrm{CO}_2$  levels, and opens the economizer appropriately.

When the occupants leave, the CO<sub>2</sub> levels decrease, and the sensor appropriately closes the economizer. This intelligent control of the ventilation air, called Demand Control Ventilation (DCV) reduces the overall load on the rooftop, saving money.

#### **Smoke Detectors**

Trust the experts. Smoke detectors make your application safer and your job easier. Carrier smoke detectors immediately shut down the rooftop unit when smoke is detected. They are available, installed by the factory, for supply air, return air, or both.

#### **Louvered Hail Guards**

Sleek, louvered panels protect the condenser coil from hail damage, foreign objects, and incidental contact.

#### **Convenience Outlet (powered or un-powered)**

Reduce service and/or installation costs by including a convenience outlet in your specification. Carrier will install this service feature at our factory. Provides a convenient, 15 amp, 115v GFCI receptacle with "Wet in Use" cover. The "powered" option allows the installer to power the outlet from the line side of the disconnect or load side as required by code. The "un-powered" option is to be powered from a separate 115/120v power source.

#### **Non-fused Disconnect**

This OSHA-compliant, factory installed, safety switch allows a service technician to locally secure power to the rooftop.

#### Power Exhaust with Barometric Relief

Superior internal building pressure control. This field installed accessory may eliminate the need for costly, external pressure control fans.

# PremierLink, DDC Controller

This CCN controller regulates your rooftop's performance to tighter tolerances and expanded limits, as well as facilitates zoning systems and digital accessories. It also unites your Carrier HVAC equipment together on one, coherent CCN network. The PremierLink can be factory installed, or easily field installed.

# RTU Open, Multi-Protocol Controller

Connect the rooftop to an existing BAS without needing complicated translators or adapter modules using the RTU Open controller. This new controller speaks the 4 most common building automation system languages (Bacnet, Modbus, N2, and Lonworks). Use this controller when you have an existing BAS.

#### **Time Guard II Control Circuit**

This accessory protects your compressor by preventing short-cycling in the event of some other failure, prevents the compressor from restarting for 30 seconds after stopping. Not required with PremierLink, RTU Open, or authorized commercial thermostats.

# **Motorized 2-Position Damper**

The new Carrier 2-position, motorized outdoor air damper admits up to 100% outside air. Using reliable, gear-driven technology, the 2-position damper opens to allow ventilation air and closes when the rooftop stops, stopping unwanted infiltration.

#### **Manual OA Damper**

Manual outdoor air dampers are an economical way to bring in ventilation air. The dampers are available in 25% and 50% versions.

# Optional Humidi-MiZer Adaptive Dehumidification System

Carrier's Humidi-MiZer Adaptive Dehumidification System is an all-inclusive factory installed option that can be ordered with any WeatherMaker 48KC\*B04-06 rooftop unit.

This system expands the envelope of operation of Carrier's WeatherMaker rooftop products to provide unprecedented flexibility to meet year round comfort conditions.

The Humidi-MiZer adaptive dehumidification system has the industry's only dual dehumidification mode setting. The Humidi-MiZer system includes two new modes of operation.

# FACTORY OPTIONS AND/OR ACCESSORIES (cont.)

# Opt. Humidi-MiZer Adap. Dehum. Sys. (cont.)

The WeatherMaker 48KC\*B04-06 rooftop coupled with the Humidi-MiZer system is capable of operating in normal design cooling mode, subcooling mode, and hot gas reheat mode. Normal design cooling mode is when the unit will operate under its normal sequence of operation by cycling compressors to maintain comfort conditions.

Subcooling mode will operate to satisfy part load type conditions when the space requires combined sensible and a higher proportion of latent load control. Hot Gas Reheat mode will operate when outdoor temperatures diminish and the need for latent capacity is required for sole humidity control. Hot Gas Reheat mode will provide neutral air for maximum dehumidification operation.

#### **Motormaster Head Pressure Controller**

The Motormaster motor controller is a low ambient, head pressure controller kit that is designed to maintain the unit's condenser head pressure during periods of low ambient cooling operation. This device should be used as an alternative to economizer free cooling when economizer usage is either not appropriate or desired. The Motormaster will either cycle the outdoor fan motors or operate them at reduced speed to maintain the unit operation, depending on the model.

#### Winter Start Kit

The winter start kit by Carrier extends the low ambient limit of your rooftop to 25°F (-4°C). The kit bypasses the low pressure switch, preventing nuisance tripping of the low pressure switch. Other low ambient precautions may still be prudent.

#### **Propane Heating**

Convert your gas heat rooftop from standard natural gas operation to propane using this field installed kit.

# **High Altitude Heating**

High altitudes have less oxygen, which means heat exchangers need less fuel. The new gas orifices in this field installed kit make the necessary adjustment for high altitude applications. They restore the optimal fuel to air mixture and maintain healthy combustion at altitudes above 2000 ft (610m). Kits may not be required in all areas.

# **Hinged Access Panels**

Allows access to unit's major components with specifically designed hinged access panels. Panels are: filter, control box, fan motor, and compressor.

# Flue Discharge Deflector

The flue discharge deflector is a useful accessory when flue gas recirculation is a concern. By venting the flue discharge upwards, the deflector minimizes the chance for a neighboring unit to intake the flue exhaust.

### **Optional Stainless Steel Heat Exchanger**

The stainless steel heat exchanger option provides the tubular heat exchanger be made out of a minimum 20 gauge type 409 stainless steel for applications where the mixed air to the heat exchanger is expected to drop below 45°F (7°C). Stainless steel may be specified on applications where the presence of airborne contaminants require its use (applications such as paper mills) or in areas with very high outdoor humidity that may result in severe condensation in the heat exchanger during cooling operation.

# Flue Discharge Heat Shield

The flue discharge heat shield keeps people from touching the rooftop unit's potentially hot flue discharge. This is especially useful for ground level applications, where more, untrained people could have access to the unit's exterior.

#### **Alternate Motors and Drives**

Some applications need larger horsepower motors, some need more airflow, and some need both. Regardless of the case, your Carrier expert has a factory installed combination to meet your application. A wide selection of motors and pulleys (drives) are available, factory installed, to handle nearly any application.

# **Thru-the-Base Connections**

Thru-the-base connections, available as either an accessory or as a factory option, are necessary to ensure proper connection and seal when routing wire and piping through the rooftop's basepan and curb. These couplings eliminate roof penetration and should be considered for gas lines, main power lines, as well as control power.

**Table 2 – AHRI COOLING RATING TABLE** 

UNIT	COOLING STAGES	NOM. CAPACITY (TONS)	NET COOLING CAPACITY (MBH)	TOTAL POWER (KW)	SEER	EER
48KC**04	1	3	35.4	3.0	14.0	12.00
48KC**05	1	4	47.5	4.0	14.0	12.00
48KC**06	1	5	58.5	4.9	14.1	12.00

**LEGEND** 

**EER** 

AHRI – Air Conditioning, Heating and Refrigeration

Institute Test Standard

ASHRAE - American Society of Heating, Refrigerating

and Air Conditioning, Inc.Energy Efficiency Ratio

SEER - Seasonal Energy Efficiency Ratio







Use of the AHRI Certified TM Mark indicates a manufacturer's participation in the program For verification of certification for individual products, go to www.ahridirectory.org.

#### NOTES:

- 1. Rated in accordance with AHRI Standard 210/240.
- 2. Ratings are based on:
- Cooling Standard: 80°F (27°C) db, 67°F (19°C) wb indoor air temp and 95°F (35°C) db outdoor air temp.
- All 48KC units comply with ASHRAE 90.1 and Department of Energy (DOE) Energy Standard for minimum SEER and EER requirements.
- 48KC units comply with US Energy Policy Act (2005). To evaluate code compliance requirements, refer to state and local codes.

Table 3 - HEATING RATING TABLE - NATURAL GAS & PROPANE

			AL/SS HEAT	EXCHANGER	TEMP RISE	THERMAL	AFUE
UN	ITS	GAS HEAT	INPUT / OUTPUT STAGE 1 (MBH)	INPUT / OUTPUT STAGE 2 (MBH)	(DEG F)	EFFICIENCY (%)	(%)
		LOW	-	65 / 50	25 – 55	82.0%	81.0%
	04	MED	-	90 / 73	45 – 85	82.0%	81.2%
ø.		HIGH	-	_	_	-	_
Single Phase		LOW	-	65 / 50	20 - 55	82.0%	81.0%
e Pl	05	MED	-	90 / 73	30 - 65	82.0%	81.2%
ingl		HIGH	-	130 / 105	45 - 80	82.0%	81.0%
S		LOW		65 / 50	15 - 55	82.0%	81.0%
	06	MED	-	90 / 73	25 - 65	82.0%	81.2%
		HIGH	-	130 / 105	35 - 80	82.0%	81.0%
		LOW	-	72 / 56	25 - 55	82.0%	N/A
	04	MED	82 / 66	115 / 89	55 - 85	80.0%	N/A
•		HIGH	-	_	_	-	-
Phase		LOW		72 / 56	25 - 55	82.0%	N/A
급	05	MED	-	115 / 90	35 – 65	81.0%	N/A
Three I		HIGH	120 / 96	150 / 117	50 - 80	80.0%	N/A
-		LOW	-	72 / 56	20 - 55	82.0%	N/A
	06	MED	-	115 / 90	30 - 65	81.0%	N/A
		HIGH	120 / 96	150 / 117	40 - 80	80.0%	N/A

#### NOTES:

Heat ratings are for natural gas heat exchangers operated at or below 2000 ft (610 m). For information on propane or altitudes above 2000 ft (610 m), see the Application Data section of this book. Accessory Propane/High Altitude kits are also available.

In the USA the input rating for altitudes above 2000 ft (610m) must be derated by 4% for each 1000 ft (305 m) above sea level. In Canada, the input rating must be derated by 10% for altitudes of 2000 ft (610 m) to 4500 ft (1372 m) above sea level.

Table 4 – HEATING RATING TABLE - LOW NOX1

	UNIT GAS		LOW NOx HEA	T EXCHANGER	TEMP DICE	THEDMAN	A = 1.1 =
UI			INPUT / OUTPUT STAGE 1 (MBH) INPUT / OUTPUT STAGE 2 (MBH)		TEMP RISE (DEG F)	THERMAL EFFICIENCY (%)	AFUE (%)
		LOW	-	60 / 47	20 – 50	82.0%	81.3%
	04	MED	-	90 / 72	30 – 60	82.0%	81.5%
Phase		HIGH	-	-	_	_	-
e Ph		LOW	-	60 / 47	20 – 50	82.0%	81.3%
/Three	05	MED	-	90 / 72	30 - 60	82.0%	81.5%
L		HIGH	-	120 / 97	40 – 70	82.0%	81.3%
Single		LOW	-	60 / 47	15 – 50	82.0%	81.3%
0	06	MED	-	90 / 72	25 – 60	82.0%	81.5%
		HIGH	-	120 / 97	35 – 70	82.0%	81.3%

#### NOTE

- Units meet California's South Coast Air Quality Management District (SCAQMD) Low-NO<sub>x</sub> emissions requirement of 40 nanograms per joule or less.
- Not Applicable

Table 5 - SOUND PERFORMANCE TABLE

UNIT	COOLING	OUTDOOR SOUND (dB) @60HZ									
STAGES	A-WEIGHTED	63	125	250	500	1000	2000	4000	8000		
A04	1	76	78.2	78.0	74.2	73.3	70.6	66.0	62.4	56.9	
A05	1	81	90.9	84.6	79.5	77.9	76.5	71.1	66.9	62.5	
A06	1	77	87.5	82.5	76.1	73.6	71.3	67.1	64.1	60.0	

#### **LEGEND**

dB - Decibel



#### NOTES:

- Outdoor sound data is measure in accordance with AHRI standard 270.
- Measurements are expressed in terms of sound power. Do not compare these values to sound pressure values because sound pressure depends on specific environmental factors which normally do not match individual applications. Sound power values are independent of the environment and therefore more accurate.
- 3. A-weighted sound ratings filter out very high and very low frequencies, to better approximate the response of "average" human ear. A-weighted measurements for Carrier units are taken in accordance with AHRI standard 270.9

Table 6 – MINIMUM - MAXIMUM AIRFLOW RATINGS - NATURAL GAS & PROPANE

VOLTACE	LINUT	HEAT	coo	LING	AL HX H	IEATING	SS HX F	IEATING
VOLTAGE	UNIT	LEVEL	MINIMUM	MAXIMUM	MINIMUM	MAXIMUM	MINIMUM	MAXIMUM
		LOW			900	1970	900	1970
	48KC**04	MED	900	1500	800	1520	800	1520
		HIGH			-	_	_	-
		LOW			900	2470	900	2470
SINGLE PHASE	48KC**05	MED	1200	2000	1050	2280	1050	2280
		HIGH			1230	2190	1230	2190
	48KC**06	LOW	1500	2500	900	3290	900	3290
		MED			1050	2730	1050	2730
		HIGH			1230	2820	1230	2820
		LOW		1500	990	2190	990	2190
	48KC**04	MED	900		1000	1550	1000	1550
		HIGH			-	_	_	-
		LOW			990	2190	990	2190
THREE PHASE	48KC**05	MED	1200	2000	1330	2460	1330	2460
FIIASE		HIGH	1		1390	2220	1390	2220
		LOW			990	2730	990	2730
	48KC**06	MED	1500	2500	1330	2880	1330	2880
		HIGH	1		1390	2780	1390	2780

Table 7 – PHYSICA	L DATA (COO)	LING)	3 - 5 TO			
Dofrigorotion Contact		48KC*A/B04	48KC*A/B05	48KC*A/B06		
Refrigeration System	# Circuits / # Comp. / Type Puron® refrig. (R-410A) 1 phase (lbs-oz) Puron® refrig. (R-410A) 3 phase (lbs-oz) Humidi-MiZer Puron® refrig. charge (lbs - oz) Metering Device (A) Humidi-MiZer Metering Device (B) High-press. Trip / Reset (psig) Low-press. Trip / Reset (psig) Compressor Capacity Staging (%)	1 / 1 / Scroll 7-2 7-2 10-6 Acutrol Acutrol + TXV 630 / 505 54 / 117 100%	1 / 1 / Scroll 10 – 8 10 – 8 15 – 5 Acutrol Acutrol + TXV 630 / 505 54 / 117 100%	1 / 1 / Scroll 16-0 14-8 26-0 Acutrol + TXV 630 / 505 54 / 117 100%		
Evap. Coil	Compressor Supporty Staging (70)	10070	10070	10070		
Humidi – MiZer <sup>®</sup> Coil	Material (Tube/Fin) Coil type Rows / FPI Total Face Area (ft²) Condensate Drain Conn. Size  Material (Tube/Fin) Coil type Rows / FPI	Cu / Al 3/8-in RTPF 3 / 15 5.5 3/4-in Cu / Al 3/8-in RTPF 1 / 17	Cu / Al 3/8-in RTPF 3 / 15 5.5 3/4-in  Cu / Al 3/8-in RTPF 2 / 17	Cu / Al 3/8 – in RTPF 4 / 15 7.3 3/4 – in Cu / Al 3/8 – in RTPF 2 / 17		
Evap. Fan and Motor	Total Face Area (ft <sup>2</sup> )	3.9	3.9	5.2		
Standard Static 1 phase	Motor Qty / Drive Type Max BHP RPM Range Motor Frame Size Fan Qty / Type Fan Diameter (in)	1/ Direct 1 600-1200 48 1 / Centrifugal 10 x 10	1/ Direct 1 600 – 1200 48 1 / Centrifugal 10 x 10	1/ Direct 1 600 –1200 48 1 / Centrifugal 10 x 10		
Medium Static 1 phase	Motor Qty / Drive Type Max BHP RPM Range Motor Frame Size Fan Qty / Type Fan Diameter (in)	1/ Belt 1.2 770-1175 48 1 / Centrifugal 10 x 10	1/ Belt 1.2 770-1175 48 1 / Centrifugal 10 x 10	1/ Belt 1.5 1035–1466 56 1 / Centrifugal 10 x 10		
High Static 1 phase	Motor Qty / Drive Type Max BHP RPM Range Motor Frame Size Fan Qty / Type Fan Diameter (in)	1/ Belt 1.5 1035-1466 56 1 / Centrifugal 10 x 10	1/ Belt 1.5 1035 – 1466 56 1 / Centrifugal 10 x 10	N/A N/A N/A N/A N/A		
Standard Static 3 phase	Motor Qty / Drive Type Max BHP RPM Range Motor Frame Size Fan Qty / Type Fan Diameter (in)	1/ Direct 1 600-1200 48 1 / Centrifugal 10 x 10	1/ Direct 1 600-1200 48 1 / Centrifugal 10 x 10	1/ Direct 1 600-1200 48 1 / Centrifugal 11 x 10		
Medium Static 3 phase	Motor Qty / Drive Type Max BHP RPM Range Motor Frame Size Fan Qty / Type Fan Diameter (in)	1/ Belt 1.7 770–1175 48 1 / Centrifugal 10 x 10	1/ Belt 1.7 920-1303 56 1 / Centrifugal 10 x 10	1/ Belt 2.9 1035–1466 56 1 / Centrifugal 10 x 10		
High Static 3 phase	Motor Qty / Drive Type Max BHP RPM Range Motor Frame Size Fan Qty / Type Fan Diameter (in)	1/ Belt 2.9 1035 – 1466 56 1 / Centrifugal 10 x 10	1/ Belt 2.9 1208 – 1639 56 1 / Centrifugal 10 x 10	1/ Belt 2.9 1303–1687 56 1 / Centrifugal 10 x 10		
Cond. Coil 1 phase	Material (Tube/Fin) Coil type Rows / FPI Total Face Area (tt²)	Cu / Al 3/8-in RTPF 1 / 17 16.5	Cu / Al 3/8-in RTPF 2 / 17 16.5	Cu / Al 3/8 – in RTPF 2 / 17 21.3		
3 phase	Material (Tube/Fin) Coil type RowsFins/in. Total Face Area (ft²)	Cu / Al 3/8-in RTPF 1 / 17 16.5	Cu / Al 3/8-in RTPF 2 / 17 14.6	Cu / Al 3/8 – in RTPF 2 / 17 18.8		
Cond. fan / motor	Qty / Motor Drive Type Motor HP / RPM Fan diameter (in)	1/ Direct 1/8 / 825 22	1/ Direct 1/4 / 1100 22	1/ Direct 1/4 / 1100 22		
riners	RA Filter # / Size (in) OA inlet screen # / Size (in)	2 / 16 x 25 x 2 1 / 20 x 24 x 1	2 / 16 x 25 x 2 1 / 20 x 24 x 1	4 / 16 x 16 x 2 1 / 20 x 24 x 1		

11

N/A - Not Available

917

	·	48KC**04	48KC**05	48KC**06
	<u> </u>		.5.1.5	.5.10 00
ectrical		0: 1 5:	0: 1 5:	0: : 5:
as Connection		Single Phase	Single Phase	Single Phase
as Connection	# of Gas Valves	1	1	1
Not goo oupp				
	ly line press (in. w.g.)/ (PSIG)	4 -13 / 0.18 - 0.47	4 -13 / 0.18 - 0.47	4 -13 / 0.18 - 0.47
LP supply	y line press (in. w.g.) / (PSIG)	11 -13 / 0.40 - 0.47	11 -13 / 0.40 - 0.47	11 -13 / 0.40 - 0.47
eat Anticipator se	tting (Amps)			
	1st stage	0.14	0.14	0.14
	2nd stage	0.14	0.14	0.14
atural Gas Heat				
	<i>" " " " " " " " " " "</i>	4.10	4.40	1/0
	# of stages / # of burners (total)	1/2	1/2	1/2
LOW	Connection Size	1/2-in NPT	1/2-in NPT	1/2-in NPT
	Rollout switch opens / closes	195 / 115	195 / 115	195 / 115
	Temperature Rise	25 – 55	20 – 55	15 – 55
	# of stages / # of burners (total)	1 or 2 / 3	1 / 3	1/3
	Connection Size	1/2-in NPT	1/2-in NPT	1/2-in NPT
MED	Rollout switch opens / closes	195 / 115	195 / 115	195 / 115
	•	195 / 115 45 – 85		
	Temperature Rise	45 – 85	30 – 65	25 – 65
	# of stages / # of burners (total)	_	1 or 2 / 3	1 or 2 / 3
	Connection Size	_	1/2-in NPT	1/2-in NPT
HIGH	Rollout switch opens / closes	_	195 / 115	195 / 115
	Temperature Rise	_	45 – 80	35 – 80
	remperature ruse		45 - 60	35 – 60
uid Propane Hea	at			
	# of stages / # of burners (total)	1 / 2	1/2	1/2
	Connection Size	1/2-in NPT	1/2-in NPT	1/2-in NPT
LOW	Rollout switch opens / closes	195 / 115	195 / 115	195 / 115
	Temperature Rise	25 – 55	20 – 55	15 – 55
	# of stages / # of burning (total)	1 0 1 0 1 0	1/0	1/0
	# of stages / # of burners (total)	1 or 2 / 3	1/3	1/3
MED	Connection Size	1/2-in NPT	1/2-in NPT	1/2-in NPT
WILD	Rollout switch opens / closes	195 / 115	195 / 115	195 / 115
	Temperature Rise	45 – 85	30 – 65	25 – 65
	# of stages / # of burners (total)	_	1 or 2 / 3	1 or 2 / 3
	Connection Size	_	1/2-in NPT	1/2-in NPT
HIGH	Rollout switch opens / closes		195 / 115	195 / 115
	Temperature Rise	_	45 – 80	35 – 80
	·			
w NOx Gas Heat				
	# of stages / # of burners (total)	1/2	1/2	1/2
LOW	Connection Size	1/2-in NPT	1/2-in NPT	1/2-in NPT
LOVV	Rollout switch opens / closes	195 / 115	195 / 115	195 / 115
	Temperature Rise	20 – 50	20 – 50	15 – 50
	# of stages / # of burners (total)	1/3	1/3	1/3
	Connection Size	1/2-in NPT	1/2-in NPT	1/2-in NPT
MED		195 / 115	•	·
	Rollout switch opens / closes		195 / 115	195 / 115
	Temperature Rise	30 – 60	30 – 60	25 – 60
	# of stages / # of burners (total)	_	1/3	1/3
	Connection Size	_	1/2-in NPT	1/2-in NPT
HIGH		_	· ·	· ·
HIGH	Rollout switch opens / closes Temperature Rise	_	195 / 115 40 – 70	195 / 115 35 — 70

<sup>-</sup> Not applicable

ible 9 – PH	YSICAL DATA (HEA	TING - THREE PHAS	3 - 5 TON		
		48KC**04	48KC**05	48KC**06	
Electrical					
iecuicai		Three Phase	Three Phase	Three Phase	
as Connection		THISS THASS	Third Thad	THICO T HACO	
	# of Gas Valves	1	1	1	
Nat. gas su	ipply line press (in. w.g.)/ (PSIG)	4 -13 / 0.18 - 0.47	4 -13 / 0.18 - 0.47	4 -13 / 0.18 - 0.47	
	pply line press (in. w.g.) / (PSIG)	11 -13 / 0.40 - 0.47	11 -13 / 0.40 - 0.47	11 -13 / 0.40 - 0.47	
eat Anticipator	setting (Amps)				
	1st stage	0.14	0.14	0.14	
	2nd stage	0.14	0.14	0.14	
atural Gas Hea	t				
	# of stages / # of burners (total)	1/2	1 / 2	1/2	
1 1	Connection Size	1/2-in NPT	1/2-in NPT	1/2-in NPT	
LOW	Rollout switch opens / closes	195 / 115	195 / 115	195 / 115	
	Temperature Rise	25 – 55	25 – 55	20 – 55	
	# of stages / # of burners (total)	1 or 2 / 3	1/3	1/3	
	Connection Size	1/2-in NPT	1/2-in NPT	1/2-in NPT	
MED	Rollout switch opens / closes	195 / 115	195 / 115	195 / 115	
	Temperature Rise	55 – 85	35 – 65	30 – 65	
	# of stages / # of burners (total)		1 or 2 / 3	1 or 2 / 3	
	Connection Size	_	1/2-in NPT	1/2-in NPT	
HIGH		_	· · · · · · · · · · · · · · · · · · ·	·	
	Rollout switch opens / closes	_	195 / 115	195 / 115	
	Temperature Rise	-	50 – 80	40 – 80	
quid Propane I	Heat				
	# of stages / # of burners (total)	1/2	1/2	1/2	
	Connection Size	1/2-in NPT	1/2-in NPT	1/2-in NPT	
LOW	Rollout switch opens / closes	195 / 115	195 / 115	195 / 115	
	Temperature Rise	25 – 55	25 – 55	20 – 55	
	# of stages / # of burners (total)	1 or 2 / 3	1/3	1/3	
	Connection Size	1/2-in NPT	1/2-in NPT	1/2-in NPT	
MED	Rollout switch opens / closes	195 / 115	195 / 115	195 / 115	
	Temperature Rise	55 – 85	35 – 65	30 – 65	
	# of stages / # of burners (total)	_	1 or 2 / 3	1 or 2 / 3	
	Connection Size	_	1/2-in NPT	1/2-in NPT	
HIGH	Rollout switch opens / closes	_	195 / 115	195 / 115	
	Temperature Rise	-	50 – 80	40 – 80	
w NOx Gas He	eat				
	# of stages / # of burners (total)	1 / 2	1/2	1 / 2	
	Connection Size	1/2—in NPT	1/2-in NPT	1/2-in NPT	
LOW	Rollout switch opens / closes	195 / 115	195 / 115	195 / 115	
	Temperature Rise	20 – 50	20 – 50	15 – 50	
	# of stages / # of burners (total)	1 / 3	1/3	1/3	
	Connection Size	1/2-in NPT	1/2-in NPT	1/2–in NPT	
MED	Rollout switch opens / closes	195 / 115	195 / 115	195 / 115	
	Temperature Rise	30 – 60	30 – 60	25 – 60	
_	# of stages / # of burners (total)	_	1/2	1/2	
	# or stages / # or burriers (total)	_	1/3	1/3	
	Connection O!		1/O in NIDT	1/0 :- NDT	
HIGH	Connection Size	-	1/2-in NPT	1/2 – in NPT	
HIGH	Connection Size Rollout switch opens / closes Temperature Rise	<del>-</del> -	1/2-in NPT 195 / 115 40 - 70	1/2-in NPT 195 / 115 35 - 70	

Not applicable

# **CURBS, WEIGHTS & DIMENSIONS**

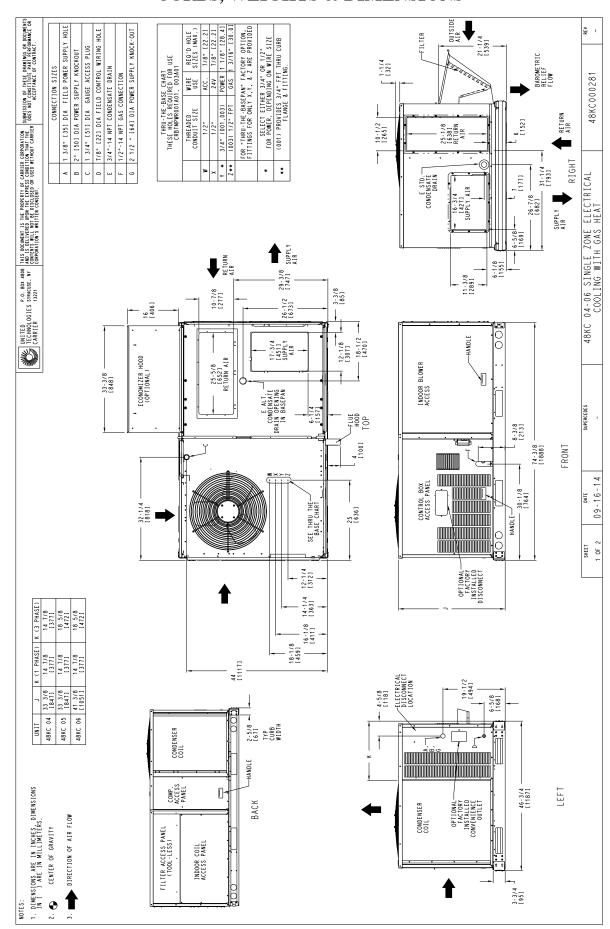


Fig. 1 - Dimensions 48KC 04-06 (sheet 1 of 2)

# **CURBS, WEIGHTS & DIMENSIONS (cont.)**


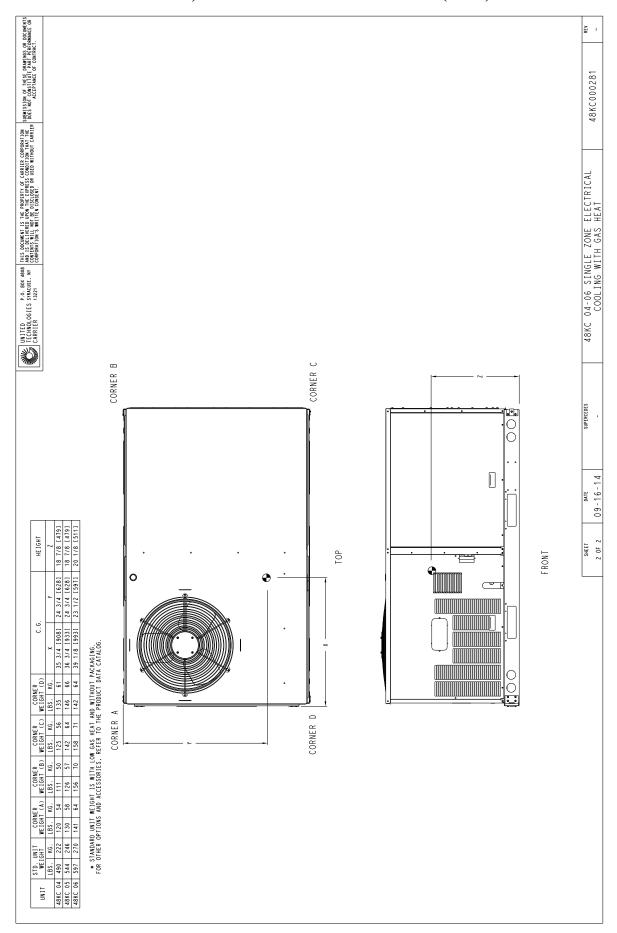


Fig. 2 - Dimension 48KC 04-06 (sheet 2 of 2)

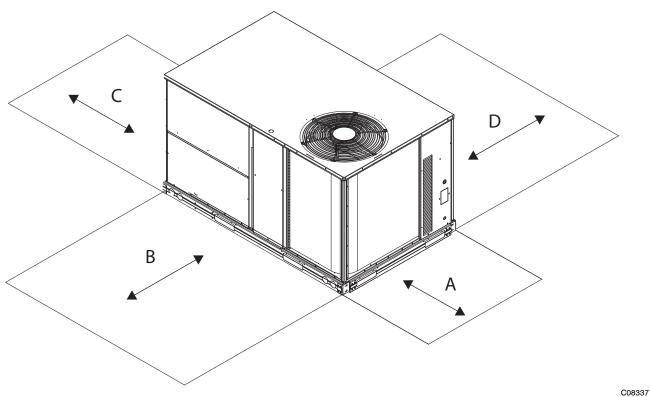

LOCATION CONDITION **DIMENSION** 48-in (1219 mm) Unit disconnect is mounted on panel 18-in (457 mm) No disconnect, convenience outlet option Α 18-in (457) mm Recommended service clearance 12-in (305 mm) Minimum clearance 42-in (1067 mm) Surface behind servicer is grounded (e.g., metal, masonry wall) В 36-in (914 mm) Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass) Special Check sources of flue products within 10-ft of unit fresh air intake hood 36-in (914 mm) Side condensate drain is used С 18-in (457 mm) Minimum clearance 48-in (1219 mm) No flue discharge accessory installed, surface is combustible material 42-in (1067 mm) Surface behind servicer is grounded (e.g., metal, masonry wall, another unit) D Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass) 36-in (914 mm) Special Check for adjacent units or building fresh air intakes within 10-ft (3 m) of this unit's flue outlet

**NOTE:** Unit not designed to have overhead obstruction. Contact Application Engineering for guidance on any application planning overhead obstruction or for vertical clearances.

Fig. 3 - Service Clearance Dimensional Drawing

# **CURBS, WEIGHTS & DIMENSIONS (cont.)**

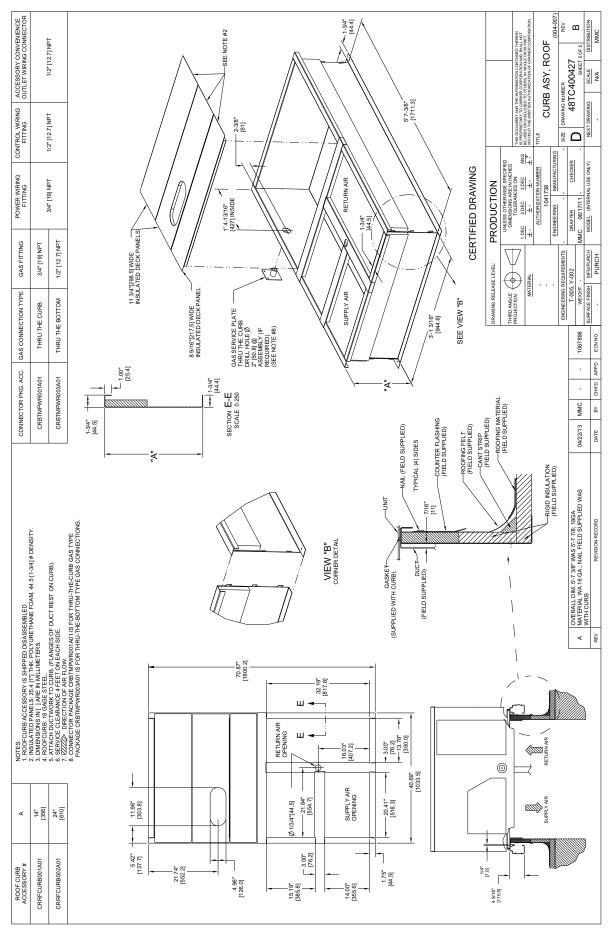


Fig. 4 - Roof Curb Details - 48TC 04-06

# **OPTIONS & ACCESSORY WEIGHTS**

		0	PTION / ACCES	SORY WEIGH	rs	
OPTION / ACCESSORY	C	)4	0	5	0	6
	lb	kg	lb	kg	lb	kg
Humidi-MiZer <sup>1</sup>	50	23	50	23	55	25
Power Exhaust - vertical	45	20	45	20	45	20
Power Exhaust - horizontal	30	14	30	14	30	14
EconoMi\$er (IV, X or 2)	35	16	35	16	35	16
Two Position damper	39	18	39	18	39	18
Manual Dampers	12	5	12	5	12	5
Medium Gas Heat	12	5	9	4	9	4
High Gas Heat	_	_	17	8	17	8
Hail Guard (louvered)	13	6	13	6	17	8
Cu/Cu Condenser Coil <sup>2</sup>	37	17	74	34	95	43
Cu/Cu Condenser and Evaporator Coils <sup>2</sup>	75	34	112	51	165	75
Roof Curb (14-in. curb)	115	52	115	52	115	52
Roof Curb (24-in. curb)	197	89	197	89	197	89
CO <sub>2</sub> sensor	2	1	2	1	2	1
Flue Discharge Deflector	7	3	7	3	7	3
Optional Indoor Motor/Drive	6	3	6	3	17	8
Motor Master Controller	9	4	9	4	9	4
Return Smoke Detector	7	3	7	3	7	3
Supply Smoke Detector	7	3	7	3	7	3
Non-Fused Disconnect	5	2	5	2	5	2
Powered Convenience outlet	36	16	36	16	36	16
Non-Powered Convenience outlet	4	2	4	2	4	2
Enthalpy Sensor	2	1	2	1	2	1
Differential Enthalpy Sensor	3	1	3	1	3	1

NOTE: Where multiple variations are available, the heaviest combination is listed.

Not Available

For Humidi-MiZer add MotorMaster Controller.

Where available.

## APPLICATION DATA

# Min operating ambient temp (cooling):

In mechanical cooling mode, your Carrier rooftop unit can safely operate down to an outdoor ambient temperature of 40°F (4°C) and 25°F (-4°C), with an accessory winter start kit. It is possible to provide cooling at lower outdoor ambient temperatures by using less outside air, economizers, and/or accessory low ambient kits.

# Max operating ambient temp (cooling):

The maximum operating ambient temperature for cooling mode is 115°F (46°C). While cooling operation above 115°F (46°C) may be possible, it could cause either a reduction in performance, reliability, or a protective action by the unit's internal safety devices.

### Min mixed air temp (heating):

Using the factory settings, the minimum temperatures for the mixed air (the combined temperature of the warm return air and the cold outdoor air) entering the dimpled, gas heat exchangers are:

<u>Aluminized</u>	Stainless Steel
50°F (10°C) continuous	40°F (4°C) continuous
45°F (7°C) intermittent	35°F (2°C) intermittent

Operating at lower mixed-air temperatures may be possible, if a field supplied, outdoor air thermostat initiates both heat stages when the temperature is less than the minimum temperatures listed above. Please contact your local Carrier representative for assistance.

#### Min and max airflow (heating and cooling):

To maintain safe and reliable operation of your rooftop, operate within the heating airflow limits during heating mode and cooling airflow limits during cooling mode. Operating above the max may cause blow-off, undesired airflow noise, or airflow related problems with the rooftop unit. Operating below the min may cause problems with coil freeze-up and unsafe heating operation. Heating and cooling limitations differ when evaluating operating cfm, the minimum value is the HIGHER of the cooling and heating minimum cfm values published in Table 6 and the maximum values published in Table 6.

## Heating-to-cooling changeover:

Your unit will automatically change from heating to cooling mode when using a thermostat with an auto-changeover feature.

#### Airflow:

All units are draw-through in cooling mode and blow-through in heating mode.

# **Outdoor air application strategies:**

Economizers reduce operating expenses and compressor run time by providing a free source of cooling and a means of ventilation to match application changing needs. In fact, they should be considered for most applications. Also, consider the various economizer control methods and their benefits, as well as sensors required to accomplish your application goals. Please contact your local Carrier representative for assistance.

# Motor limits, Brake horsepower (BHP):

Due to internal design of Carrier units, the air path, and specially designed motors, the full horsepower (maximum continuous BHP) band, as listed in Table 8 and 10, can be used with the utmost confidence. There is no need for extra safety factors, as Carrier motors are designed and rigorously tested to use the entire, listed BHP range without either nuisance tripping or premature motor failure.

# **Propane heating:**

Propane has different physical qualities than natural gas. As a result, propane requires different fuel to air mixture. To optimize the fuel/air mixture for propane, Carrier sells different burner orifices in an easy to install accessory kit. To select the correct burner orifices or determine the heat capacity for a propane application, use either the selection software, or the unit's service manual.

# **High altitude heating:**

High altitudes have less oxygen, which affects the fuel/air mixture in heat exchangers. In order to maintain a proper fuel/air mixture, heat exchangers operating in altitudes above 2000 ft (610 m) require different orifices. To select the correct burner orifices or determine the heat capacity for a high altitude application, use either the selection software, or the unit's service manual.

High altitudes have less oxygen, which means heat exchangers need less fuel. The new gas orifices in this field installed kit make the necessary adjustment for high altitude applications. They restore the optimal fuel to air mixture and maintain healthy combustion on altitudes above 2000 ft (610 m).

**NOTE**: Typical natural gas heating value ranges from 975 to 1050 Btu/ft<sup>3</sup> at sea level nationally. The heating value goes down approximately 1.7% per every thousand feet elevation. Standard factory orifices can typically be used up to 2000 ft (610m) elevation without any operational issues.

**NOTE**: For installations in Canada, the input rating should be derated by 10% for altitudes from 2000 ft (610m) to 4500 ft (1372m) above sea level.

# **APPLICATION DATA (cont.)**

# Sizing a rooftop

Bigger isn't necessarily better. While an air conditioner needs to have enough capacity to meet the design loads, it doesn't need excess capacity. In fact, excess capacity typically results in very poor part load performance and humidity control.

Using higher design temperatures than ASHRAE recommends for your location, adding "safety factors" to the calculated load, are all signs of oversizing air conditioners. Oversizing the air conditioner leads to poor humidity control, reduced efficiency, higher utility bills, larger indoor temperature swings, excessive noise, and increased wear and tear on the air conditioner.

Rather than oversizing an air conditioner, engineers should "right size" or even slightly undersize air conditioners. Correctly sizing an air conditioner controls humidity better; promotes efficiency; reduces utility bills; extends equipment life, and maintains even, comfortable temperatures. Please contact your local Carrier representative for assistance.

# Low ambient applications

The optional Carrier economizer can adequately cool your space by bringing in fresh, cool outside air. In fact, when so equipped, accessory low ambient kit may not be necessary. In low ambient conditions, unless the outdoor air is excessively humid or contaminated, economizer based "free cooling" is the preferred less costly and energy conscious method.

In low ambient applications where outside air might not be desired (such as contaminated or excessively humid outdoor environments), your Carrier rooftop can operate at ambient temperatures down to -20°F (-29°C) using the recommended accessory Motormaster low ambient controller.

								An	nbient Te	mperatu	re				
		-1/O+4			85			95		·	105			115	
	48	BKC*A	04		EA (dB)										
				75	80	85	75	80	85	75	80	85	75	80	85
			TC	28.7	28.7	32.6	25.1	25.1	28.6	22.2	22.2	25.3	19.5	19.5	22.2
		58	SHC	24.8	28.7	32.6	21.7	25.1	28.6	19.1	22.2	25.3	16.7	19.5	22.2
		60	TC	31.8	31.8	32.4	26.0	26.0	29.5	22.3	22.3	26.4	19.5	19.5	23.2
_		62	SHC	23.3	27.9	32.4	20.6	25.0	29.5	18.1	22.3	26.4	15.8	19.5	23.2
Çţ	(wp	67	TC	36.5	36.5	36.5	34.2	34.2	34.2	29.2	29.2	29.2	23.7	23.7	23.7
900 Cfm	EAT (wb)	07	SHC	19.4	24.0	28.5	18.4	22.9	27.4	16.2	20.8	25.3	14.1	18.6	23.1
0	E	72	TC	40.3	40.3	40.3	38.2	38.2	38.2	35.6	35.6	35.6	32.4	32.4	32.4
		12	SHC	14.9	19.5	24.1	13.9	18.5	23.1	12.9	17.4	22.0	11.6	16.2	20.7
		76	TC	-	43.1	43.1	-	41.0	41.0	-	38.6	38.6	_	35.9	35.9
			SHC	-	15.7	20.6		14.8	19.8	-	13.9	18.8	-	12.8	17.6
		58	TC	31.8	31.8	36.2	28.3	28.3	32.1	24.9	24.9	28.4	21.9	21.9	24.9
			SHC	27.5	31.8	36.2	24.4	28.3	32.1	21.5	24.9	28.4	18.8	21.9	24.9
		62	TC	33.8	33.8	36.1	28.9	28.9	33.4	25.0	25.0	29.6	21.9	21.9	26.0
ĘΕ	<u> </u>		SHC	25.7	30.9	36.1	23.2	28.3	33.4	20.4	25.0	29.6	17.8	21.9	26.0
1050 Cfm	(wp)	67	TC	37.8	37.8	37.8	35.5	35.5	35.5	31.7	31.7	31.7	25.8	25.8	26.2
050	EAT		SHC	20.7	25.9	31.1	19.7	24.9	30.1	18.1	23.3	28.6	15.8	21.0	26.2
-	Ш	72	TC	41.5	41.5	41.5	39.3	39.3	39.3	36.8	36.8	36.8	33.6	33.6	33.6
			SHC	15.4	20.6	25.8	14.5	19.7	24.9	13.5	18.7	23.9	12.2	17.5	22.7
		76	TC	-	44.2	44.2	-	42.0	42.0	-	39.6	39.6	_	36.9	36.9
			SHC		16.4	22.1		15.5	21.1		14.5	20.0	-	13.5	18.9
		58	TC	34.1	34.1	38.8	31.3	31.3	35.6	27.5	27.5	31.2	24.1	24.1	27.4
			SHC	29.5	34.1	38.8	27.0	31.3	35.6	23.7	27.5	31.2	20.7	24.1	27.4
		62	TC	34.9	34.9	39.1	32.9	32.9	35.5	27.5	27.5	32.6	24.1	24.1	28.6
Ę	(q		SHC	27.5	33.3	39.1	25.2	30.3	35.5	22.5	27.5	32.6	19.6	24.1	28.6
၁၀	.≥	67	TC	38.8	38.8	38.8	36.4	36.4	36.4	33.3	33.3	33.3	27.7	27.7	29.2
1200 Cfm	EAT (wb)		SHC TC	21.9 42.4	27.7 42.4	33.5 42.4	20.9 40.1	26.7 40.1	32.6 40.1	19.6 37.7	25.5 37.7	31.4 37.7	17.4 34.5	23.3 34.5	29.2 34.5
'	_	72	SHC	15.8	21.6	27.4	14.9	20.7	26.5	13.9	19.8	25.6	12.7	18.7	24.6
			TC	13.0	44.9	44.9	14.5	42.7	42.7		40.3	40.3	-	37.7	37.7
		76	SHC	_	16.8	23.1	_	15.9	22.1	_	15.0	21.1	_	14.0	20.1
			TC	35.6	35.6	40.4	33.6	33.6	38.1	29.8	29.8	33.9	26.2	26.2	29.8
		58	SHC	30.8	35.6	40.4	29.0	33.6	38.1	25.7	29.8	33.9	22.5	26.2	29.8
			TC	36.3	36.3	39.9	33.7	33.7	39.7	29.9	29.0	35.3	26.2	26.2	31.0
_		62	SHC	28.2	34.1	39.9	27.6	33.7	39.7	24.4	29.9	35.3	21.4	26.2	31.0
Cfm.	vb)		TC	39.5	39.5	39.5	37.2	37.2	37.2	34.0	34.0	34.0	29.3	29.3	32.0
1350 CI	EAT (wt	67	SHC	22.9	29.4	35.8	22.0	28.5	34.9	20.8	27.3	33.9	18.9	25.4	32.0
138	EA		TC	43.0	43.0	43.0	40.7	40.7	40.7	38.3	38.3	38.3	35.2	35.2	35.2
		72	SHC	16.2	22.5	28.9	15.3	21.7	28.1	14.3	20.8	27.2	13.2	19.7	26.3
			TC	_	45.5	45.5		43.3	43.3		40.8	40.8	-	38.1	38.1
		76	SHC	-	17.3	24.0		16.4	23.1		15.4	22.1	-	14.5	21.1
			TC	36.8	36.8	41.8	34.8	34.8	39.5	32.0	32.0	36.4	28.1	28.1	31.9
		58	SHC	31.9	36.8	41.8	30.1	34.8	39.5	27.7	32.0	36.4	24.2	28.1	31.9
		60	TC	36.9	36.9	43.5	35.4	35.4	38.8	32.1	32.1	37.9	28.1	28.1	33.3
۽		62	SHC	30.2	36.9	43.5	27.4	33.1	38.8	26.2	32.1	37.9	22.9	28.1	33.3
Ş	w.	67	TC	40.1	40.1	40.1	37.7	37.7	37.7	34.7	34.7	36.2	30.7	30.7	34.6
1500 Cfm	EAT (wb)	07	SHC	23.9	31.0	38.0	23.0	30.1	37.2	21.9	29.0	36.2	20.3	27.5	34.6
7	Ē	72	TC	43.6	43.6	43.6	41.3	41.3	41.3	38.7	38.7	38.7	35.7	35.7	35.7
		12	SHC	16.5	23.4	30.2	15.6	22.5	29.5	14.7	21.7	28.6	13.6	20.8	27.9
		76	TC	-	46.0	46.0	_	43.7	43.7	_	41.2	41.2	_	38.5	38.5
		, 0	SHC	-	17.6	24.8	-	16.7	23.9	-	15.8	22.9	-	14.8	22.0

## LEGEND:

Do not operateCubic feet per minute (supply air) Cfm EAT(db) - Entering air temperature (dry bulb) Entering air temperature (wet bulb)Sensible heat capacity EAT(wb)

SHC

TC - Total capacity

TEN	ID (E)			A	IR ENTERIN	G EVAPORA	TOR - SCF	М		
	IP (F) ENT		900			1200			1500	
COND	ENSER				Air Entering	Evaporator	Ewb (F)	•		
(E	db)	72	67	62	72	67	62	72	67	62
	TC	30.9	32.0	31.9	30.7	33.5	34.3	34.8	31.8	27.6
75	SHC	15.1	20.0	26.3	25.1	20.4	15.4	14.0	18.2	21.9
	kW	2.51	2.49	2.42	2.82	2.74	2.68	3.09	3.01	2.88
	TC	32.8	28.4	23.4	18.7	23.8	29.3	24.5	18.8	13.6
85	SHC	11.0	14.6	17.9	13.4	10.3	7.1	2.6	5.6	8.6
	kW	3.36	3.23	3.06	3.62	3.41	3.24	3.79	3.58	3.39
	TC	31.3	32.0	31.9	30.7	33.5	34.3	34.8	31.8	27.6
95	SHC	15.3	20.0	26.3	25.1	20.4	15.4	14.0	18.2	21.9
	kW	2.53	2.49	2.41	2.82	2.74	2.68	3.09	3.01	2.88
	TC	32.8	28.4	23.4	18.7	23.8	29.3	24.5	18.8	13.6
105	SHC	11.0	14.6	17.9	13.4	10.3	7.1	2.6	5.6	8.6
	kW	3.36	3.23	3.06	3.62	3.41	3.24	3.79	3.58	3.39
	TC	31.3	32.0	31.9	30.7	33.5	34.3	34.8	31.8	27.6
115	SHC	15.3	20.0	26.3	25.1	20.4	15.4	14.0	18.2	21.9
	kW	2.53	2.49	2.41	2.82	2.74	2.68	3.09	3.01	2.88

	48	BKC*B04 (3	TONS) – UN	IT WITH HUI	MIDI-MIZEF	SYSTEM IN	HOT GAS R	EHEAT MOI	DE	
				Al	R ENTERING	G EVAPORA	ΓOR – Ewb (	(F)		
AIR	IP (F) ENT ENSER		75 Dry Bulb 62.5 Wet Bul 50% Relative	b	(	75 Dry Bulb 64 Wet Bulb 56% Relative			75 Dry Bulb 55.3 Wet Bul 60% Relative	b
(E	db)				Air Enter	ing Evaporat	or – Cfm			
		Air Entering Evaporator – Cfm           900         1200         1500         900         1200         1500         900         1200           12.26         13.13         13.65         13.53         14.48         15.00         14.73         15.63								
	TC	12.26	13.13	13.65	13.53	14.48	15.00	14.73	15.63	16.20
80	SHC	1.76	3.87	6.09	0.75	2.48	4.33	-0.06	1.30	2.81
	kW	1.92	1.93	1.94	1.96	1.98	2.00	2.00	2.01	2.02
	TC	14.64	15.64	16.30	15.84	16.73	17.32	16.80	17.38	17.91
75	SHC	3.87	6.09	8.38	2.88	4.59	6.29	2.03	3.14	4.39
	kW	1.87	1.88	1.88	1.89	1.90	1.91	1.91	1.92	1.93
	TC	16.72	17.62	18.01	17.42	18.17	18.62	18.02	18.69	18.87
70	SHC	5.89	7.85	9.40	4.65	6.08	7.35	3.71	5.09	5.59
	kW	1.78	1.80	1.82	1.81	1.83	1.84	1.82	1.82	1.86
	TC	17.43	18.50	18.28	18.09	19.03	19.41	18.32	18.29	19.33
60	SHC	7.75	10.06	9.51	7.08	8.34	9.60	6.29	6.94	7.88
	kW	1.66	1.62	1.70	1.67	1.69	1.68	1.69	1.70	1.71
	TC	17.82	18.59	19.72	18.31	19.73	20.26	18.76	20.21	20.73
50	SHC	6.40	7.99	10.05	4.79	6.71	7.97	3.40	5.11	6.16
	kW	1.98	2.03	1.94	2.01	1.94	1.97	2.03	1.96	1.99
	TC	17.70	19.38	19.85	19.10	20.30	20.34	19.53	20.76	21.26
40	SHC	6.30	8.74	10.17	5.54	7.26	8.05	4.13	5.64	6.67
	kW	2.07	1.95	1.99	1.93	1.91	2.02	1.96	1.94	1.97

#### **LEGEND**

Edb - Entering Dry-Bulb Ewb - Entering Wet-Bulb

kW - Compressor Motor Power Input Idb - Leaving Dry-Bulb

lwb - Leaving Wet-Bulb

SHC - Sensible Heat Capacity (1000 Btuh) Gross

TC - Total Capacity (1000 Btuh) Gross

## NOTES:

- 1. Direct interpolation is permissible. Do not extrapolate.
- 2. The following formulas may be used:

 $t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \text{ x cfm}}$ 

 $t_{lwb}=\mbox{Wet-bulb}$  temperature corresponding to enthalpy of air leaving evaporator coil  $(h_{lwb})$ 

 $h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \text{ x cfm}}$ 

Where:  $h_{\text{ewb}} = \text{Enthalpy of air entering evaporator coil}$ 

			LING CAI				SIAGE			mperatu	ire				1 10116
	4	BKC*A	25		85			95			105			115	
	40	ONC A	Jo		EA (dB)										
				75	80	85	75	80	85	75	80	85	75	80	85
		58	TC	41.5	41.5	47.0	38.9	38.9	44.0	36.2	36.2	41.0	33.4	33.4	37.8
		30	SHC	36.1	41.5	47.0	33.8	38.9	44.0	31.4	36.2	41.0	28.9	33.4	37.8
		62	TC	44.9	44.9	44.9	41.4	41.4	42.6	37.8	37.8	40.8	34.0	34.0	38.8
Ē	6		SHC	32.6	38.5	44.3	30.9	36.8	42.6	29.2	35.0	40.8	27.3	33.1	38.8
1200 Cfm	(wp)	67	TC	49.7	49.7	49.7	46.8	46.8	46.8	43.1	43.1	43.1	39.2	39.2	39.2
20	EAT		SHC	26.5	32.4	38.2	25.3	31.1	37.0	23.7	29.6	35.5	22.1	27.9	33.8
_	ш	72	TC	53.4	53.4	53.4	51.3	51.3	51.3	48.5	48.5	48.5	44.7	44.7	44.7
			SHC	19.8	25.7	31.6	19.0	24.8	30.7	17.8	23.7	29.6	16.4	22.3	28.1
		76	TC	_	55.3	55.3	_	53.3	53.3	_	51.6	51.6		48.6	48.6
			SHC	-	20.1	26.7		19.4	26.0		18.7	25.3		17.5	23.8
		58	TC	44.4	44.4	50.2	41.6	41.6	47.0	38.7	38.7	43.8	35.7	35.7	40.5
			SHC	38.6	44.4	50.2	36.1	41.6	47.0	33.6	38.7	43.8	31.0	35.7	40.5
		62	TC SHC	46.6	46.6	48.6 48.6	43.1	43.1 40.2	46.9 46.9	39.4	39.4 38.3	44.9 44.9	35.8	35.8 35.8	42.1
Ë	(wb)		TC	35.2 51.2	41.9 51.2	48.6 51.2	33.5 48.5	40.2	46.9	31.7 44.7	38.3 44.7	44.9 44.7	29.4 40.7	35.8 40.7	42.1 40.7
1400 Cfm	٤	67	SHC	28.0	34.6	41.2	26.9	33.6	40.3	25.4	32.2	38.9	23.8	30.6	37.3
140	EAT		TC	54.4	54.4	54.4	52.3	52.3	52.3	49.9	49.9	49.9	46.2	46.2	46.2
	_	72	SHC	20.2	26.7	33.2	19.4	25.9	32.5	18.5	25.2	31.9	17.1	23.8	30.6
			TC	-	55.9	55.9	-	53.9	53.9	-	52.1	52.1	-	49.7	49.7
		76	SHC	_	20.8	28.5	_	20.0	27.6	_	19.2	26.5		18.1	25.3
			TC	46.6	46.6	52.7	43.8	43.8	49.6	40.8	40.8	46.2	37.7	37.7	42.7
		58	SHC	40.5	46.6	52.7	38.1	43.8	49.6	35.4	40.8	46.2	32.7	37.7	42.7
			TC	47.9	47.9	52.3	44.6	44.6	50.7	40.9	40.9	48.1	37.8	37.8	44.4
_		62	SHC	37.5	44.9	52.3	35.9	43.3	50.7	33.7	40.9	48.1	31.1	37.8	44.4
Ę	(dv		TC	51.5	51.5	51.5	48.7	48.7	48.7	44.9	44.9	44.9	40.7	40.7	42.0
1600 Cfm	EAT (wb)	67	SHC	30.9	38.3	45.7	30.0	37.5	45.0	28.5	36.1	43.7	26.9	34.5	42.0
16	EA		TC	55.0	55.0	55.0	52.9	52.9	52.9	50.9	50.9	50.9	47.3	47.3	47.3
		72	SHC	20.4	27.5	34.6	19.6	26.8	33.9	18.9	26.3	33.8	17.6	25.2	32.7
			TC	_	56.3	56.3	_	54.3	54.3	_	52.3	52.3		50.3	50.3
		76	SHC	_	21.1	29.4	_	20.2	28.3	-	19.4	27.3		18.6	26.5
			TC	48.4	48.4	54.7	45.7	45.7	51.7	42.7	42.7	48.3	39.4	39.4	44.6
		58	SHC	42.1	48.4	54.7	39.7	45.7	51.7	37.0	42.7	48.3	34.2	39.4	44.6
		62	TC	49.1	49.1	55.6	45.9	45.9	53.7	42.7	42.7	50.2	39.5	39.5	46.4
Ē		02	SHC	39.5	47.6	55.6	37.8	45.8	53.7	35.2	42.7	50.2	32.5	39.5	46.4
5	(w	67	TC	53.0	53.0	53.0	50.6	50.6	50.6	47.0	47.0	47.0	42.7	42.7	43.7
1800 CI	EAT (wb)	- O1	SHC	30.2	38.2	46.1	29.5	37.7	45.8	28.5	36.8	45.2	26.9	35.3	43.7
<b>~</b>	Щ	72	TC	55.5	55.5	55.5	53.4	53.4	53.4	51.5	51.5	51.5	48.1	48.1	48.1
			SHC	20.6	28.2	35.7	19.8	27.5	35.2	19.2	27.3	35.4	18.1	26.4	34.6
		76	TC	-	56.6	56.6	_	54.6	54.6	-	52.5	52.5	-	50.8	50.8
			SHC	_	21.2	29.9	-	20.4	28.9	-	19.6	28.0	-	18.9	27.4
		58	TC	49.9	49.9	56.4	47.4	47.4	53.6	44.3	44.3	50.1	40.9	40.9	46.3
			SHC	43.4	49.9	56.4	41.2	47.4	53.6	38.4	44.3	50.1	35.5	40.9	46.3
		62	TC	50.1	50.1	58.3	47.5	47.5	55.7	44.3	44.3	52.1	41.0	41.0	48.2
Ē	Q		SHC	41.1	49.7	58.3	39.2	47.5	55.7	36.5	44.3	52.1	33.8	41.0	48.2
၁	<u>≷</u>	67	TC	53.5	53.5	53.5	51.3	51.3	51.3	47.8	47.8	48.1	43.5	43.5	46.6
2000 Cfm	EAT (wb)		SHC	31.2	39.7	48.3	30.6	39.4	48.1	29.9	39.0	48.1	28.3	37.5	46.6
(4		72	TC	55.8	55.8	55.8	53.7	53.7	53.7	51.9	51.9	51.9	48.8	48.8	48.8
			SHC TC	20.7	28.7	36.7	19.9	28.1	36.2	19.4	28.0	36.7	18.5	27.4	36.4
		76		_	56.9	56.9 30.4	-	54.8 20.5	54.8	-	52.7	52.7 28.6		51.1	51.1
			SHC	_	21.3	30.4	-	20.5	29.4		19.7	28.6	-	19.1	28.2

## LEGEND:

- Do not operate

Cfm - Cubic feet per minute (supply air)

EAT(db) - Entering air temperature (dry bulb)

EAT(wb) - Entering air temperature (wet bulb)

SHC - Sensible heat capacity

TC - Total capacity

		48KC^B05 (	4 IONS) – (			ER SYSTEM G EVAPORA				
	IP (F) ENT		1200	A	IR ENTERIN	1600	IIOR - SCF	IVI	2000	
	ENSER				Air Entering	Evaporator	Ewb (F)			
(E	db)	72	67	62	72	67	62	72	67	62
	TC	35.4	37.1	41.2	40.7	43.2	41.0	44.3	42.2	35.7
75	SHC	16.4	21.6	31.5	31.3	24.3	16.9	16.0	22.4	26.9
	kW	3.06	3.07	3.06	3.44	3.43	3.41	3.84	3.82	3.72
	TC	43.4	36.8	29.6	22.8	30.1	37.9	31.0	23.1	15.6
85	SHC	13.0	17.6	21.5	15.5	11.7	7.8	2.0	5.7	9.2
	kW	4.28	4.20	4.05	4.77	4.57	4.42	5.17	4.99	4.81
	TC	34.5	34.9	35.6	42.8	40.4	37.8	42.4	43.8	39.3
95	SHC	16.3	20.9	27.7	36.7	23.8	16.2	16.4	26.1	34.3
	kW	3.25	3.25	3.24	3.63	3.63	3.61	4.04	4.02	4.00
	TC	44.0	40.3	33.3	26.2	33.7	41.0	34.2	26.1	18.6
105	SHC	15.1	22.9	28.9	22.6	17.2	11.1	5.0	10.6	15.8
	kW	4.49	4.47	4.32	4.99	4.87	4.69	5.50	5.28	5.09
	TC	33.2	33.5	38.3	39.8	37.3	35.4	40.3	42.0	41.3
115	SHC	15.6	20.3	31.2	34.7	22.3	15.3	15.9	26.2	39.6
	kW	3.53	3.51	3.46	3.89	3.89	3.88	4.31	4.30	4.26

	48	8KC*B05 (4	TONS) – UN	IT WITH HUI	MIDI-MIZEF	SYSTEM IN	HOT GAS R	EHEAT MOI	DE	
				Al	R ENTERING	G EVAPORA	ΓOR – Ewb (	(F)		
AIR	IP (F) ENT ENSER		75 Dry Bulb 62.5 Wet Bul 50% Relative	b	(	75 Dry Bulb 64 Wet Bulb 56% Relative	ı		75 Dry Bulb 55.3 Wet Bul 60% Relative	b
(E	db)				Air Enter	ing Evaporat	or – Cfm			
		Air Entering Evaporator – Cfm           1200         1600         2000         1200         1600         2000         1200         1600           15.33         16.26         16.40         17.32         18.21         18.24         18.97         19.72								
	TC	15.33	16.26	16.40	17.32	18.21	18.24	18.97	19.72	19.66
80	SHC	0.84	3.06	4.94	-0.09	1.62	2.93	-0.90	0.33	1.18
	kW	2.41	2.42	2.42	2.43	2.43	2.43	2.44	2.44	2.44
	тс	19.17	20.36	20.57	20.97	21.94	21.95	22.30	23.03	22.88
75	SHC	4.46	6.89	8.60	3.50	5.31	6.45	2.61	3.93	4.64
	kW	2.76	2.75	2.75	2.76	2.75	2.74	2.76	2.76	2.75
	TC	22.63	23.67	23.55	23.97	24.55	24.19	24.87	25.09	24.52
70	SHC	7.91	10.13	11.21	6.83	8.40	9.04	5.88	7.04	7.39
	kW	2.80	2.78	2.77	2.80	2.77	2.76	2.81	2.80	2.78
	тс	27.32	28.34	21.46	27.68	16.17	25.05	28.38	18.51	20.56
60	SHC	13.66	15.45	13.04	11.75	4.46	12.58	11.21	10.82	10.87
	kW	2.85	2.86	2.86	2.89	2.80	2.91	2.88	2.84	2.88
	тс	11.00	11.31	12.76	14.48	13.83	13.72	15.32	15.18	17.14
50	SHC	7.10	9.20	11.20	5.13	6.46	9.10	4.21	4.49	6.19
	kW	2.95	2.94	2.93	2.94	2.92	2.92	2.94	2.93	2.92
	TC	9.73	9.83	9.75	12.40	12.60	12.20	15.23	15.45	15.13
40	SHC	8.46	9.50	9.20	7.57	8.47	9.50	7.64	8.14	8.80
	kW	3.04	3.04	3.03	3.03	3.01	3.01	3.03	3.02	3.02

#### **LEGEND**

Edb - Entering Dry-Bulb Ewb - Entering Wet-Bulb

kW - Compressor Motor Power Input Idb - Leaving Dry-Bulb

lwb - Leaving Wet-Bulb

SHC - Sensible Heat Capacity (1000 Btuh) Gross

TC - Total Capacity (1000 Btuh) Gross

#### NOTES:

- 1. Direct interpolation is permissible. Do not extrapolate.
- 2. The following formulas may be used:

 $t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \text{ x cfm}}$ 

 $t_{lwb}=\mbox{Wet-bulb}$  temperature corresponding to enthalpy of air leaving evaporator coil  $(h_{lwb})$ 

 $h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \text{ x cfm}}$ 

Where:  $h_{\text{ewb}} = \text{Enthalpy of air entering evaporator coil}$ 

			LING CAL					Ar		mperatu	re				10115
	4	DVC+A	<b>.</b>		85			95			105			115	
	48	BKC*A	סנ		EA (dB)										
				75	80	85	75	80	85	75	80	85	75	80	85
		58	TC	53.0	53.0	60.2	50.0	50.0	56.8	46.9	46.9	53.4	44.4	44.4	50.4
			SHC	45.9	53.0	60.2	43.1	50.0	56.8	40.3	46.9	53.4	38.4	44.4	50.4
		62	TC	56.0	56.0	57.5	52.2	52.2	55.4	48.2	48.2	53.3	44.7	44.7	52.1
٤	Q		SHC	41.4	49.5	57.5	39.3	47.4	55.4	37.2	45.2	53.3	36.2	44.2	52.1
1500 Cfm	EAT (wb)	67	TC	62.4	62.4	62.4	58.8	58.8	58.8	54.8	54.8	54.8	51.0	51.0	51.0
20	AT		SHC	33.5	41.4	49.4	31.7	39.7	47.7	29.6	37.7	45.7	28.6	36.6	44.6
		72	TC	67.5	67.5	67.5	64.3	64.3	64.3	60.7	60.7	60.7	55.4	55.4	55.4
			SHC TC	25.0	32.4	39.8	23.3	31.0	38.6	21.5	29.3	37.0	19.8	27.2	34.7
		76	SHC	_	71.1 25.6	71.1 32.7	_	68.3 24.2	68.3 31.3	_	64.8 22.5	64.8 29.9	_	58.4 20.3	58.4 27.7
			TC	56.7	56.7		53.5	53.5		50.2	50.2		47.4		
		58	SHC	49.1	56.7	64.3 64.3	46.2	53.5	60.8 60.8	43.3	50.2	57.2 57.2	41.0	47.4 47.4	53.9 53.9
			TC	58.3	58.3	63.9	54.4	54.4	61.8	51.8	51.8	56.4	47.5	47.4	56.1
_		62	SHC	45.3	54.6	63.9	43.2	52.5	61.8	39.6	48.0	56.4	38.9	47.5	56.1
1750 Cfm	(dv		TC	64.0	64.0	64.0	60.6	60.6	60.6	56.6	56.6	56.6	52.3	52.3	52.3
20 (	EAT (wb)	67	SHC	35.5	44.5	53.6	33.9	43.1	52.4	32.0	41.3	50.6	30.6	39.7	48.8
17	EA		TC	68.9	68.9	68.9	65.9	65.9	65.9	62.2	62.2	62.2	56.6	56.6	56.6
		72	SHC	25.5	33.9	42.2	24.0	32.7	41.4	22.2	31.1	40.1	20.2	28.7	37.1
			TC	_	72.4	72.4	_	69.7	69.7	-	66.1	66.1	-	59.5	59.5
		76	SHC	_	26.4	34.9	-	24.9	33.2		23.2	31.7		21.0	29.5
			TC	59.8	59.8	67.8	56.5	56.5	64.2	53.1	53.1	60.4	50.0	50.0	56.8
		58	SHC	51.8	59.8	67.8	48.9	56.5	64.2	45.8	53.1	60.4	43.3	50.0	56.8
		60	TC	60.2	60.2	69.7	57.0	57.0	66.0	53.2	53.2	62.9	50.1	50.1	59.2
L L		62	SHC	48.8	59.3	69.7	46.1	56.0	66.0	43.4	53.2	62.9	41.1	50.1	59.2
5	(w	67	TC	65.3	65.3	65.3	61.8	61.8	61.8	56.7	56.7	57.6	52.4	52.4	55.7
2000 Cfm	EAT (wb)	01	SHC	37.3	47.4	57.4	35.9	46.2	56.6	36.4	47.0	57.6	34.9	45.3	55.7
2	Ш	72	TC	70.2	70.2	70.2	67.0	67.0	67.0	63.2	63.2	63.2	57.3	57.3	57.3
			SHC	26.1	35.4	44.8	24.5	34.1	43.7	22.8	32.7	42.6	20.6	30.1	39.5
		76	TC	-	73.4	73.4	-	70.6	70.6	-	67.1	67.1		60.3	60.3
			SHC	-	27.0	36.5		25.5	35.0		23.8	33.3		21.5	31.0
		58	TC	62.2	62.2	70.5	59.0	59.0	66.9	55.5	55.5	63.0	52.1	52.1	59.1
			SHC	54.0	62.2	70.5	51.1	59.0	66.9	47.9	55.5	63.0	45.0	52.1	59.1
		62	TC SHC	63.4	63.4 60.5	70.9 70.9	59.1 48.5	59.1 59.1	69.7 69.7	55.5 45.4	55.5 55.5	65.6 65.6	52.1 42.7	52.1 52.1	61.5
Ę	(Q			50.2							55.5				61.5
) O	ڪ	67	TC SHC	66.3 38.9	66.3 50.0	66.3 61.0	62.4 39.2	62.4 50.8	62.4 62.3	58.9 36.2	58.9 47.9	59.6 59.6	54.1 34.0	54.1 45.2	56.3 56.3
2250 Cf	EAT (wb)		TC	71.1	71.1	71.1	68.0	68.0	68.0	64.1	64.1	64.1	57.9	57.9	57.9
		72	SHC	26.5	36.8	47.1	25.0	35.5	46.1	23.3	34.1	45.0	21.0	31.3	41.7
			TC	-	74.0	74.0	-	71.4	71.4	-	67.8	67.8	-	61.0	61.0
		76	SHC		27.3	37.6		26.0	36.5		24.3	34.9		21.8	32.2
			TC	64.0	64.0	72.4	60.9	60.9	69.1	57.4	57.4	65.2	53.3	53.3	60.5
		58	SHC	55.5	64.0	72.4	52.8	60.9	69.1	49.6	57.4	65.2	46.1	53.3	60.5
			TC	64.0	64.0	75.3	61.0	61.0	71.9	57.4	57.4	67.9	53.4	53.4	63.0
E		62	SHC	52.7	64.0	75.3	50.1	61.0	71.9	47.0	57.4	67.9	43.8	53.4	63.0
2500 Cfm	EAT (wb)	67	TC	67.3	67.3	67.3	63.7	63.7	64.5	59.5	59.5	64.2	54.6	54.6	59.3
00		67	SHC	40.6	52.5	64.5	39.6	52.0	64.5	38.7	51.5	64.2	35.4	47.3	59.3
25	E/	72	TC	71.7	71.7	71.7	68.8	68.8	68.8	64.9	64.9	64.9	58.4	58.4	58.4
		12	SHC	26.7	37.9	49.1	25.4	37.0	48.5	23.7	35.5	47.3	21.2	32.4	43.6
		76	TC	_	74.5	74.5	-	72.1	72.1	-	68.4	68.4	-	61.6	61.6
		ט	SHC	_	27.4	38.5	-	26.3	37.7		24.7	36.3	-	22.1	33.3

## LEGEND:

- Do not operate
Cfm - Cubic feet per minute (supply air)
EAT(db) - Entering air temperature (dry bulb) Entering air temperature (wet bulb)Sensible heat capacity EAT(wb)

SHC

TC - Total capacity

		48KC*B06 (	(5 TONS) – l	JNIT WITH H	IUMIDI-MIZ	ER SYSTEM	IN SUBCOO	LING MODE	1	
TEM	IP (F)			Α	IR ENTERIN	IG EVAPORA	TOR - SCF	М		
	ENT		1750			2000			2250	
	ENSER				Air Entering	Evaporator	Ewb (F)			
(E	db)	72	67	62	72	67	62	72	67	62
	TC	51.1	56.4	57.9	47.8	49.9	57.3	49.6	48.9	53.8
75	SHC	25.5	36.1	50.4	24.6	31.3	50.3	25.8	32.0	44.8
	kW	3.20	3.30	3.19	3.25	3.18	3.13	3.22	3.13	3.25
	TC	54.1	60.4	61.0	56.4	60.4	60.5	56.7	60.7	58.2
85	SHC	47.2	38.7	28.0	52.3	40.6	28.8	27.2	42.6	56.5
	kW	3.59	3.67	3.79	3.81	3.70	3.60	3.70	3.74	3.61
	TC	62.4	56.6	48.4	62.7	58.6	50.5	62.8	60.0	52.6
95	SHC	26.3	34.9	41.9	27.8	38.7	46.9	29.0	42.1	51.5
	kW	4.20	4.09	3.92	3.97	4.10	4.25	4.28	4.12	4.03
	TC	58.8	49.9	41.6	60.5	51.9	43.6	61.6	53.5	47.6
105	SHC	22.0	29.0	35.8	24.4	32.9	40.7	26.5	36.6	42.3
	kW	4.64	4.46	4.28	4.33	4.52	4.66	4.69	4.57	4.41
	TC	51.4	41.9	33.8	53.3	43.7	35.9	54.7	45.3	39.2
115	SHC	15.7	22.2	29.0	18.1	26.0	33.9	20.4	29.7	35.3
	kW	5.08	4.83	4.63	4.69	4.88	5.14	5.19	4.92	4.77

	48	8KC*B06 (5	TONS) – UN	IT WITH HUI	MIDI-MIZEF	SYSTEM IN	HOT GAS R	EHEAT MOI	DE	
				Al	R ENTERING	G EVAPORA	ΓOR – Ewb (	(F)		
AIR	IP (F) ENT ENSER		75 Dry Bulb 62.5 Wet Bul 50% Relative	b	(	75 Dry Bulb 64 Wet Bulb 56% Relative	ı		75 Dry Bulb 55.3 Wet Bull 60% Relative	b
(E	db)				Air Enter	ing Evaporat	or – Cfm			
		Air Entering Evaporator – Cfm           1750         2000         2250         1750         2000         2250         1750         2000           13.19         12.95         12.70         14.56         14.30         14.00         15.70         15.44								
	TC	13.19	12.95	12.70	14.56	14.30	14.00	15.70	15.44	15.05
80	SHC	-2.38	-1.55	0.65	-4.75	-4.25	-3.69	-6.74	-6.49	-6.21
	kW	3.15	3.16	3.16	3.19	3.20	3.20	3.22	3.23	3.23
	TC	16.14	15.95	15.71	17.36	17.20	16.84	18.30	18.20	17.81
75	SHC	0.44	1.23	2.03	-1.92	1.36	0.96	-3.90	-3.50	-3.31
	kW	3.04	3.05	3.06	3.07	3.08	3.09	3.10	3.12	3.12
	TC	18.90	18.68	18.52	19.97	19.85	19.50	20.86	20.62	20.17
70	SHC	3.13	3.80	4.51	0.85	1.39	1.70	-0.97	-0.69	-0.63
	kW	2.92	2.93	2.95	2.96	2.97	2.98	2.98	2.99	3.00
	TC	23.71	23.48	23.16	24.05	23.98	23.52	24.79	24.47	26.99
60	SHC	8.11	8.63	8.88	5.97	6.46	6.58	4.65	4.87	5.94
	kW	3.17	3.23	3.15	3.21	3.26	3.18	3.23	3.12	3.10
	TC	21.91	16.69	16.62	16.81	16.98	16.92	17.08	17.24	17.17
50	SHC	11.51	10.04	9.64	9.77	9.43	8.95	9.30	8.88	8.35
	kW	3.01	3.07	3.11	3.04	3.10	3.15	3.07	3.14	3.18
	TC	21.91	16.69	16.62	16.81	16.98	16.92	17.08	17.24	17.17
40	SHC	11.51	10.04	9.64	9.77	9.43	8.95	9.30	8.88	8.35
	kW	3.39	3.32	3.24	3.14	3.23	3.15	3.18	3.27	3.08

#### **LEGEND**

Edb - Entering Dry-Bulb Ewb - Entering Wet-Bulb

kW - Compressor Motor Power Input Idb - Leaving Dry-Bulb

lwb - Leaving Wet-Bulb

SHC - Sensible Heat Capacity (1000 Btuh) Gross

TC - Total Capacity (1000 Btuh) Gross

#### NOTES:

- 1. Direct interpolation is permissible. Do not extrapolate.
- 2. The following formulas may be used:

 $t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \text{ x cfm}}$ 

 $t_{lwb}=\mbox{Wet-bulb}$  temperature corresponding to enthalpy of air leaving evaporator coil  $(h_{lwb})$ 

 $h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \text{ x cfm}}$ 

Where:  $h_{\text{ewb}} = \text{Enthalpy of air entering evaporator coil}$ 

# Table 16 – STATIC PRESSURE ADDERS (IN. WG) (FACTORY OPTIONS AND/OR ACCESSORIES)

			3-	5-TONS									
CFM	600	800	1000	1250	1500	1750	2000	2250	2500				
Vertical Economizer	Vertical Economizer         0.012         0.020         0.030         0.046         0.066         0.089         0.115         0.145         0.179												
Horizontal Economizer	0.018	0.026	0.037	0.053	0.073	0.096	0.124	0.154	0.189				

All above data for both standard and ultra low leak models, where available.

			3-	5-TONS									
CFM         600         800         1000         1250         1500         1750         2000         2250         2500													
Humidi-MiZer	0.023	0.033	0.042	0.054	0.067	0.080	0.093	0.106	0.120				

	3-5-TONS									
Power Exhaust Performance										
Return Duct Static Pressure (in wg)	0.0	0.1	0.2	0.3	0.4	0.5				
Vertical Power Exhaust CFM	3239	2974	2642	2244	1780	1249				

# Table 17 – STATIC PRESSURE DEDUCTIONS (IN. WG) (GAS HEAT OPTIONS)

	3-5-TONS											
CFM         600         800         1000         1250         1500         1750         2000         2250         2500												
Medium Gas Heat Deduction	0.005	0.009	0.014	0.023	0.034	0.046	0.061	0.077	0.096			
Low Gas Heat Deduction	0.012	0.023	0.037	0.060	0.088	0.122	0.161	0.206	0.256			

# GENERAL FAN PERFORMANCE NOTES

- 1. Interpolation is permissible. Do not extrapolate.
- 2. External static pressure is the static pressure difference between the return duct and the supply duct plus the static pressure caused by any FIOPs or accessories.
- 3. Tabular data accounts for pressure loss due to clean filters, unit casing, and wet coils. Factory options and accessories may add static pressure losses. Selection software is available, through your salesperson, to help you select the best motor/drive combination for your application.
- 4. The Fan Performance tables offer motor/drive recommendations. In cases when two motor/drive combinations would work, Carrier recommended the lower horsepower option.
- 5. For information on the electrical properties of Carrier motors, please see the Electrical information section of this book.
- 6. For more information on the performance limits of Carrier motors, see the application data section of this book.
- 7. The EPACT (Energy Policy Act of 1992) regulates energy requirements for specific types of indoor fan motors. Motors regulated by EPACT include any general purpose, T-frame (three-digit, 143 and larger), single-speed, foot mounted, polyphase, squirrel cage induction motors of NEMA (National Electrical Manufacturers Association) design A and B, manufactured for use in the United States. Ranging from 1 to 200 Hp, these continuous-duty motors operate on 230 and 460 volt, 60 Hz power. If a motor does not fit into these specifications, the motor does not have to be replaced by an EPACT compliant energy efficient motor. Variable speed motors are exempt from EPACT compliance requirements. Therefore, the indoor fan motors for Carrier 48KC\*\*04-06 units are exempt from these requirements.

# FAN PERFORMANCE (DIRECT DRIVE)

Table 18 – 48KC\*04 Vertical Unit - Direct Drive

Speed **ESP CFM BHP** (Torque) tap 900 0.28 0.18 975 0.17 0.16 0.05 0.15 1050 1125 1200 1 1275 1350 1425 1500 900 0.34 0.20 975 0.21 0.19 1050 0.09 0.17 1125 2 1200 1275 1350 1425 1500 900 0.48 0.25 975 0.34 0.23 1050 0.20 0.22 0.20 1125 0.07 1200 \_ \_ 3 1275 1350 \_ 1425 1500 900 1.06 0.46 0.48 975 0.98 1050 0.90 0.50 1125 0.82 0.52 1200 0.72 0.54 4 0.53 1275 0.61 1350 0.49 0.53 1425 0.37 0.53 1500 0.24 0.53 0.47 900 1.10 975 1.02 0.49 1050 0.93 0.51 0.54 1125 0.85 1200 0.81 0.56 5 1275 0.74 0.58 1350 0.67 0.61 1425 0.60 0.63 1500 0.52 0.66

Table 19 – 48KC\*04 Horizontal Unit - Direct Drive

Speed (Torque) tap	СҒМ	ESP	ВНР
	900	0.44	0.22
	975	0.32	0.21
	1050	0.21	0.20
	1125	0.11	0.18
1	1200	0.04	0.16
	1275	-	_
	1350	-	_
	1425	-	-
	1500	-	_
	900	0.50	0.25
	975	0.38	0.23
	1050	0.26	0.22
	1125	0.16	0.20
2	1200	0.07	0.19
	1275	0.00	0.16
	1350	-	_
	1425	_	_
	1500	-	-
	900	0.66	0.30
	975	0.52	0.28
	1050	0.39	0.27
	1125	0.27	0.26
3	1200	0.16	0.24
	1275	0.05	0.24
	1350	-	-
	1425	-	-
	1500	_	_
	900	1.17	0.48
	975	1.10	0.49
	1050	1.04	0.51
	1125	0.97	0.53
4	1200	0.89	0.55
	1275	0.81	0.56
	1350	0.72	0.57
	1425	0.62	0.58
	1500	0.52	0.58
	900	1.20	0.49
	975	1.14	0.51
	1050	1.04	0.53
	1125	0.97	0.55
5	1200	0.95	0.57
	1275	0.90	0.60
	1350	0.84	0.62
	1425	0.78	0.65
	1500	0.72	0.68

Table 20 – 48KC\*05 Vertical Unit - Direct Drive

Speed **ESP CFM BHP** (Torque) tap 1200 0.35 0.36 0.34 1300 0.17 0.01 0.32 1400 1500 1600 1 1700 1800 1900 2000 1200 0.47 0.42 1300 0.28 0.39 1400 0.10 0.36 1500 2 1600 1700 1800 1900 2000 1200 0.77 0.55 1300 0.66 0.58 1400 0.54 0.60 1500 0.40 0.61 1600 0.25 0.60 3 1700 0.07 0.60 1800 --1900 2000 1200 0.78 0.55 0.58 1300 0.68 1400 0.58 0.61 1500 0.46 0.64 1600 0.35 0.66 4 0.68 1700 0.22 1800 0.09 0.70 1900 2000 ---1200 0.56 0.81 1300 0.72 0.59 1400 0.66 0.62 0.55 0.66 1500 1600 0.41 0.69 5 1700 0.29 0.73 1800 0.17 0.76 1900 0.05 0.80 2000 0.83

Table 21 – 48KC\*05 Horizontal Unit - Direct Drive

Speed (Torque) tap	СҒМ	ESP	ВНР
	1200	0.57	0.41
	1300	0.40	0.39
	1400	0.24	0.37
	1500	0.08	0.35
1	1600	-	-
	1700	_	-
	1800	-	-
	1900	-	-
	2000	_	-
	1200	0.69	0.46
	1300	0.52	0.45
	1400	0.36	0.43
	1500	0.18	0.40
2	1600	0.00	0.39
	1700	-	-
	1800	-	
	1900	_	_
	2000	-	-
	1200	0.91	0.56
	1300	0.83	0.59
	1400	0.74	0.62
	1500	0.64	0.64
3	1600	0.52	0.66
	1700	0.39	0.66
	1800	0.22	0.63
	1900	0.03	0.62
	2000	-	_
	1200	0.92	0.56
	1300	0.83	0.60
	1400	0.75	0.63
	1500	0.67	0.66
4	1600	0.58	0.69
	1700	0.49	0.72
	1800	0.39	0.74
	1900	0.26	0.76
	2000	0.12	0.76
	1200	0.95	0.57
	1300	0.88	0.61
	1400	0.80	0.64
	1500	0.72	0.68
5	1600	0.64	0.71
	1700	0.55	0.75
	1800	0.46	0.79
	1900	0.37	0.83
	2000	0.27	0.87

Table 22 – 48KC\*06 Vertical Unit - Direct Drive

Speed **ESP CFM BHP** (Torque) tap 1500 0.24 0.43 0.41 1625 0.05 1750 --1875 2000 1 2125 2250 2375 2500 1500 0.44 0.54 1625 0.21 0.52 1750 0.05 0.50 1875 2 2000 2125 2250 2375 2500 1500 0.89 0.81 1625 0.69 0.80 1750 0.48 0.78 0.75 1875 0.26 2000 0.06 0.73 3 2125 2250 2375 2500 1500 0.97 0.85 0.88 1625 0.81 1750 0.65 0.91 1875 0.47 0.87 2000 0.29 0.89 4 0.86 2125 0.09 2250 \_ 2375 2500 \_ -1500 1.00 0.87 1625 0.86 0.91 1750 0.77 0.95 0.98 1875 0.65 2000 0.41 1.01 5 2125 0.25 0.88 2250 0.06 1.01 2375 \_ -2500

Table 23 – 48KC\*06 Horizontal Unit - Direct Drive

Speed (Torque) tap	СҒМ	ESP	ВНР
	1500	0.36	0.48
	1625	0.17	0.45
	1750	0.01	0.43
	1875	-	-
1	2000	_	-
	2125	-	-
	2250	-	-
	2375	-	-
	2500	-	-
	1500	0.57	0.60
	1625	0.35	0.57
	1750	0.15	0.54
	1875	0.02	0.51
2	2000	_	_
	2125	_	_
	2250	_	_
	2375	_	_
	2500	_	_
	1500	1.02	0.86
	1625	0.85	0.87
	1750	0.65	0.85
	1875	0.44	0.82
3	2000	0.23	0.80
	2125	0.02	0.80
	2250	_	_
	2375	_	_
	2500	_	_
	1500	1.09	0.90
	1625	0.95	0.93
	1750	0.80	0.97
	1875	0.62	0.92
4	2000	0.43	0.97
	2125	0.23	0.93
	2250	0.00	0.91
	2375	_	_
	2500	_	_
	1500	1.12	0.92
	1625	1.00	0.96
	1750	0.86	1.00
	1875	0.72	1.04
5	2000	0.56	1.08
	2125	0.39	0.95
	2250	0.19	1.09
	2375	-	-
	2500	_	
	2500		

#### Table 24 - 48KC\*\*04

#### 1 PHASE

#### **3 TON VERTICAL SUPPLY**

		AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)										
CFM	0	0.2		0.4		0.6		.8	1.0			
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP		
900	592	0.14	721	0.25	826	0.38	916	0.53	997	0.69		
975	616	0.17	744	0.28	847	0.41	936	0.56	1016	0.72		
1050	641	0.19	766	0.30	868	0.44	957	0.59	1036	0.76		
1125	667	0.22	790	0.33	890	0.47	978	0.63	1056	0.80		
1200	693	0.25	813	0.37	913	0.51	999	0.67	1077	0.84		
1275	720	0.29	837	0.41	935	0.55	1021	0.71	1098	0.88		
1350	747	0.33	862	0.45	958	0.60	1043	0.76	1119	0.94		
1425	775	0.37	887	0.50	982	0.65	1066	0.81	1141	0.99		
1500	802	0.42	912	0.55	1006	0.70	1088	0.87	1163	1.05		

	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)										
CFM	1	1.2		1.4		1.6		.8	2.0		
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	2. RPM	BHP	
900	1070	0.88	1137	1.07	1201	1.29	-	-		-	
975	1089	0.91	1156	1.11	1219	1.32	-	-	-	_	
1050	1108	0.94	1175	1.14	1238	1.36	_	-	-	-	
1125	1128	0.98	1195	1.18	1257	1.40	_	_	_	_	
1200	1148	1.03	1214	1.23	1276	1.44	-	-		_	
1275	1169	1.07	1235	1.28	1296	1.50	-	-		_	
1350	1190	1.13	1255	1.33	-	-	-	-	-	_	
1425	1211	1.19	1276	1.39	-	_	-	_	_	-	
1500	1232	1.25	1297	1.46	-	_	_	-	-	-	

**NOTE**: For more information, see General Fan Performance Notes. **Boldface** indicates field – supplied drive is required.

Medium static 770 – 1175 RPM, 1.2 BHP max High static 1035 – 1466 RPM, 1.5 BHP max

Table 25 - 48KC\*\*04

#### 1 PHASE

#### 3 TON HORIZONTAL SUPPLY

	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)										
CFM	0	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	
900	582	0.14	715	0.24	825	0.35	921	0.48	1007	0.63	
975	606	0.16	735	0.26	843	0.38	938	0.51	1023	0.66	
1050	630	0.18	756	0.29	862	0.41	955	0.55	1040	0.70	
1125	655	0.21	778	0.32	882	0.45	974	0.58	1057	0.74	
1200	681	0.24	800	0.35	902	0.48	992	0.63	1074	0.78	
1275	708	0.27	823	0.39	923	0.53	1012	0.67	1093	0.83	
1350	735	0.31	847	0.43	945	0.57	1032	0.72	1112	0.88	
1425	762	0.35	871	0.48	967	0.62	1053	0.77	1131	0.94	
1500	790	0.40	896	0.53	990	0.67	1074	0.83	1151	1.00	

	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)										
CFM	1.	.2	1.4		1.6		1	.8	2.0		
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	
900	1086	0.79	1159	0.96	1228	1.14	1293	1.33	-	-	
975	1101	0.82	1174	0.99	1242	1.18	1306	1.37	-	-	
1050	1117	0.86	1189	1.03	1256	1.22	1320	1.41	-	-	
1125	1133	0.90	1204	1.08	1271	1.26	1335	1.46	-	-	
1200	1150	0.95	1221	1.13	1287	1.31	-	-	_	_	
1275	1168	1.00	1237	1.18	1303	1.37	-	-	_	_	
1350	1186	1.05	1255	1.24	1320	1.43	-	-	_	_	
1425	1204	1.11	1272	1.30	1337	1.49	-	-	_	_	
1500	1223	1.18	1291	1.36	-	-	-	-	_	_	

**NOTE**: For more information, see General Fan Performance Notes. **Boldface** indicates field—supplied drive is required.

Medium static 770 – 1175 RPM, 1.2 BHP max High static 1035 – 1466 RPM, 1.5 BHP max

Table 26 - 48KC\*\*04

#### 3 PHASE

## **3 TON VERTICAL SUPPLY**

			Δ	VAILABLE E	XTERNAL S	TATIC PRES	SURE (in. w	3)		
CFM	0	0.2		0.4		0.6		.8	1.0	
	RPM	ВНР	RPM	ВНР	RPM	ВНР	RPM	BHP	RPM	BHP
900	592	0.14	721	0.25	826	0.38	916	0.53	997	0.69
975	616	0.17	744	0.28	847	0.41	936	0.56	1016	0.72
1050	641	0.19	766	0.30	868	0.44	957	0.59	1036	0.76
1125	667	0.22	790	0.33	890	0.47	978	0.63	1056	0.80
1200	693	0.25	813	0.37	913	0.51	999	0.67	1077	0.84
1275	720	0.29	837	0.41	935	0.55	1021	0.71	1098	0.88
1350	747	0.33	862	0.45	958	0.60	1043	0.76	1119	0.94
1425	775	0.37	887	0.50	982	0.65	1066	0.81	1141	0.99
1500	802	0.42	912	0.55	1006	0.70	1088	0.87	1163	1.05

			Α	VAILABLE E	XTERNAL S	TATIC PRES	SURE (in. wo	g)									
CFM	1.	.2	1.	1.4		.6	1.	.8	2	.0							
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP							
900	1070	0.88	1137	1.07	1201	1.29	1260	1.51	1317	1.75							
975	1089	0.91	1156	1.11	1219	1.32	1279	1.54	1335	1.78							
1050	1108	0.94	1175	1.14	1238	1.36	1297	1.58	1353	1.82							
1125	1128	0.98	1195	1.18	1257	1.40	1316	1.62	1372	1.86							
1200	1148	1.03	1214	1.23	1276	1.44	1335	1.67	1391	1.91							
1275	1169	1.07	1235	1.28	1296	1.50	1354	1.72	1410	1.97							
1350	1190	1.13	1255	1.33	1316	1.55	1374	1.78	1429	2.03							
1425	1211	1.19	1276	1.39	1337	1.61	1394	1.85	1449	2.09							
1500	1232	1.25	1297	1.46	1357	1.68	1415	1.91	1469	2.16							

**NOTE**: For more information, see General Fan Performance Notes. **Boldface** indicates field – supplied drive is required.

Medium static 770 – 1175 RPM, 1.7 BHP max High static 1035 – 1466 RPM, 2.9 BHP max

Table 27 - 48KC\*\*04

#### 3 PHASE

## 3 TON HORIZONTAL SUPPLY

			A	VAILABLE E	XTERNAL S	TATIC PRES	SURE (in. w	g)		
CFM	0.2		0.4		0.6		0.8		1.0	
	RPM	ВНР	RPM	ВНР	RPM	ВНР	RPM	ВНР	RPM	BHP
900	582	0.14	715	0.24	825	0.35	921	0.48	1007	0.63
975	606	0.16	735	0.26	843	0.38	938	0.51	1023	0.66
1050	630	0.18	756	0.29	862	0.41	955	0.55	1040	0.70
1125	655	0.21	778	0.32	882	0.45	974	0.58	1057	0.74
1200	681	0.24	800	0.35	902	0.48	992	0.63	1074	0.78
1275	708	0.27	823	0.39	923	0.53	1012	0.67	1093	0.83
1350	735	0.31	847	0.43	945	0.57	1032	0.72	1112	0.88
1425	762	0.35	871	0.48	967	0.62	1053	0.77	1131	0.94
1500	790	0.40	896	0.53	990	0.67	1074	0.83	1151	1.00

			Α	VAILABLE E	XTERNAL S	TATIC PRES	SURE (in. w	g)		
CFM	1	.2	1	.4	1	.6	1	.8	2	.0
	RPM	ВНР	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
900	1086	0.79	1159	0.96	1228	1.14	1293	1.33	1354	1.53
975	1101	0.82	1174	0.99	1242	1.18	1306	1.37	1367	1.57
1050	1117	0.86	1189	1.03	1256	1.22	1320	1.41	1381	1.62
1125	1133	0.90	1204	1.08	1271	1.26	1335	1.46	1395	1.67
1200	1150	0.95	1221	1.13	1287	1.31	1350	1.51	1410	1.72
1275	1168	1.00	1237	1.18	1303	1.37	1365	1.57	1425	1.78
1350	1186	1.05	1255	1.24	1320	1.43	1382	1.63	1441	1.84
1425	1204	1.11	1272	1.30	1337	1.49	1398	1.70	1457	1.91
1500	1223	1.18	1291	1.36	1355	1.56	1415	1.77	1473	1.99

**NOTE**: For more information, see General Fan Performance Notes. **Boldface** indicates field—supplied drive is required.

Medium static 770 – 1175 RPM, 1.7 BHP max High static 1035 – 1466 RPM, 2.9 BHP max

Table 28 - 48KC\*\*05

#### 1 PHASE

#### 4 TON VERTICAL SUPPLY

			ΑV	/AILABLE E	XTERNAL S	TATIC PRES	SURE (in. w	g)		
CFM	C	).2	0	.4	0	.6	0	.8	1.	.0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	693	0.25	813	0.37	913	0.51	999	0.67	1077	0.84
1300	729	0.30	846	0.42	943	0.57	1028	0.73	1105	0.90
1400	765	0.35	879	0.48	974	0.63	1058	0.79	1134	0.97
1500	802	0.42	912	0.55	1006	0.70	1088	0.87	1163	1.05
1600	840	0.49	947	0.63	1038	0.78	1119	0.95	1193	1.14
1700	878	0.57	982	0.71	1071	0.87	1151	1.05	1224	1.24
1800	917	0.65	1017	0.81	1105	0.97	1183	1.15	1255	1.35
1900	956	0.75	1053	0.91	1139	1.08	1216	1.27	1287	1.47
2000	995	0.86	1090	1.02	1173	1.20	1249	1.39	-	-

			А	VAILABLE E	XTERNAL S	TATIC PRES	SURE (in. w	/g)			
CFM	1	.2	1	.4	1	.6	1	.8	RPM	2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	
1200	1148	1.03	1214	1.23	1276	1.44	-	-	-	_	
1300	1176	1.09	1241	1.30	-	_	-	-	-	-	
1400	1204	1.17	1269	1.37	-	-	-	-	-	-	
1500	1232	1.25	1297	1.46	-	_	_	-	_	-	
1600	1262	1.34	-	-		-	-	-	-	_	
1700	1291	1.44	-	-	_	_	-	-	-	-	
1800	_	_	_	_	_	_	_	_	_	-	
1900	_	_	_	_	_	_	_	-	_	_	
2000			-	-				_	-	_	

**NOTE**: For more information, see General Fan Performance Notes. **Boldface** indicates field – supplied drive is required.

Medium static 770 – 1175 RPM, 1.2 BHP max High static1035 – 1466 RPM, 1.5 BHP max

Table 29 - 48KC\*\*05

#### 1 PHASE

## **4 TON HORIZONTAL SUPPLY**

			ΑV	/AILABLE E	XTERNAL S	TATIC PRES	SURE (in. w	g)		
CFM	0	.2	0	.4	0	.6	0	.8	1	.0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	681	0.24	800	0.35	902	0.48	992	0.63	1074	0.78
1300	717	0.29	831	0.41	930	0.54	1019	0.69	1099	0.85
1400	753	0.34	863	0.46	959	0.60	1046	0.75	1125	0.92
1500	790	0.40	896	0.53	990	0.67	1074	0.83	1151	1.00
1600	828	0.46	930	0.60	1021	0.75	1103	0.91	1179	1.09
1700	866	0.54	964	0.68	1053	0.84	1133	1.01	1207	1.18
1800	905	0.62	1000	0.77	1085	0.94	1164	1.11	1238	1.29
1900	944	0.71	1036	0.87	1119	1.04	1195	1.22	1266	1.41
2000	984	0.82	1072	0.98	1153	1.15	1227	134	-	-

			Α	VAILABLE E	XTERNAL S	TATIC PRES	SURE (in. w	rg)		
CFM	1	.2	1	.4	1	.6	1	.8	2	.0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	1150	0.95	1221	1.13	1287	1.31	_	_	_	_
1300	1173	1.02	1243	1.20	1309	1.39	-	_	_	_
1400	1198	1.09	1266	1.28	1331	1.47	-	-	-	_
1500	1223	1.18	1291	1.36	-	_	_	_	_	_
1600	1249	1.27	1316	1.46		-	-	-	-	_
1700	1277	1.37	-	-		-	-	-	-	_
1800	1305	1.48	-	-		-	-	-	-	_
1900	-		-	-		-	-	-	-	_
2000	-			_			_		-	_

**NOTE**: For more information, see General Fan Performance Notes. **Boldface** indicates field—supplied drive is required.

Medium static 770 – 1175 RPM, 1.2 BHP max High static 1035 – 1466 RPM, 1.5 BHP max

Table 30 - 48KC\*\*05

#### 3 PHASE

#### 4 TON VERTICAL SUPPLY

			Δ	VAILABLE E	XTERNAL S	TATIC PRES	SURE (in. w	3)		
CFM	0	.2	0	.4	0	.6	0	.8	1.	.0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	693	0.25	813	0.37	913	0.51	999	0.67	1077	0.84
1300	729	0.30	846	0.42	943	0.57	1028	0.73	1105	0.90
1400	765	0.35	879	0.48	974	0.63	1058	0.79	1134	0.97
1500	802	0.42	912	0.55	1006	0.70	1088	0.87	1163	1.05
1600	840	0.49	947	0.63	1038	0.78	1119	0.95	1193	1.14
1700	878	0.57	982	0.71	1071	0.87	1151	1.05	1224	1.24
1800	917	0.65	1017	0.81	1105	0.97	1183	1.15	1255	1.35
1900	956	0.75	1053	0.91	1139	1.08	1216	1.27	1287	1.47
2000	995	0.86	1090	1.02	1173	1.20	1249	1.39	1319	1.59

			А	VAILABLE E	XTERNAL S	TATIC PRES	SURE (in. wo	g)		
CFM	1.	.2	1.	.4	1.	.6	1.	.8	2	.0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	1148	1.03	1214	1.23	1276	1.44	1335	1.67	1391	1.91
1300	1176	1.09	1241	1.30	1303	1.51	1361	1.74	1416	1.98
1400	1204	1.17	1269	1.37	1330	1.59	1388	1.82	1442	2.07
1500	1232	1.25	1297	1.46	1357	1.68	1415	1.91	1469	2.16
1600	1262	1.34	1325	1.55	1385	1.78	1442	2.01	1496	2.26
1700	1291	1.44	1354	1.66	1414	1.89	1470	2.12	1524	2.37
1800	1322	1.55	1384	1.77	1443	2.00	1499	2.25	1552	2.50
1900	1352	1.68	1414	1.90	1472	2.13	1528	2.38	1580	2.63
2000	1384	1.81	1445	2.04	1502	2.27	1557	2.52	1609	2.78

**NOTE**: For more information, see General Fan Performance Notes. **Boldface** indicates field – supplied drive is required.

Medium static 920 – 1303 RPM, 1.7 BHP max High static 1208 – 1639 RPM, 2.9 BHP max

Table 31 - 48KC\*\*05

#### 3 PHASE

## **4 TON HORIZONTAL SUPPLY**

			A	VAILABLE E	XTERNAL S	TATIC PRES	SURE (in. wo	<b>g</b> )		
CFM	0	.2	0.	.4	0	.6	0.	8	1.	.0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	681	0.24	800	0.35	902	0.48	992	0.63	1074	0.78
1300	717	0.29	831	0.41	930	0.54	1019	0.69	1099	0.85
1400	753	0.34	863	0.46	959	0.60	1046	0.75	1125	0.92
1500	790	0.40	896	0.53	990	0.67	1074	0.83	1151	1.00
1600	828	0.46	930	0.60	1021	0.75	1103	0.91	1179	1.09
1700	866	0.54	964	0.68	1053	0.84	1133	1.01	1207	1.18
1800	905	0.62	1000	0.77	1085	0.94	1164	1.11	1236	1.29
1900	944	0.71	1036	0.87	1119	1.04	1195	1.22	1266	1.41
2000	984	0.82	1072	0.98	1153	1.15	1227	1.34	1297	1.53

			Α	VAILABLE E	XTERNAL S	TATIC PRES	SURE (in. w	g)		
CFM	1	.2	1.	.4	1	.6	1	.8	2	.0
	RPM	ВНР	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	1150	0.95	1221	1.13	1287	1.31	1350	1.51	1410	1.72
1300	1173	1.02	1243	1.20	1309	1.39	1371	1.59	1430	1.80
1400	1198	1.09	1266	1.28	1331	1.47	1393	1.68	1451	1.89
1500	1223	1.18	1291	1.36	1355	1.56	1415	1.77	1473	1.99
1600	1249	1.27	1316	1.46	1379	1.66	1439	1.87	1496	2.09
1700	1277	1.37	1342	1.57	1404	1.77	1463	1.99	1520	2.21
1800	1305	1.48	1369	1.68	1430	1.89	1489	2.11	1545	2.34
1900	1333	1.60	1397	1.81	1457	2.02	1514	2.25	1570	2.48
2000	1363	1.73	1425	1.94	1484	2.16	1541	2.39	1596	2.63

**NOTE**: For more information, see General Fan Performance Notes. **Boldface** indicates field—supplied drive is required.

Medium static 920 – 1303 RPM, 1.7 BHP max v High static 1035 – 1208 – 1639 RPM, 2.9 BHP max

Table 32 - 48KC\*\*06

#### 1 PHASE

#### **5 TON VERTICAL SUPPLY**

			ΑV	/AILABLE E	XTERNAL S	TATIC PRES	SURE (in. w	g)		
CFM	0	.2	0	.4	0	.6	0	.8	1	.0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	847	0.41	966	0.55	1067	0.68	1158	0.81	1240	0.93
1625	896	0.50	1010	0.65	1109	0.79	1198	0.93	1278	1.07
1750	947	0.59	1056	0.76	1152	0.92	1238	1.07	1318	1.22
1875	998	0.70	1103	0.88	1196	1.05	1280	1.22	1358	1.38
2000	1049	0.82	1151	1.02	1241	1.20	1323	1.38	_	-
2125	1102	0.96	1199	1.17	1287	1.37	-	-	_	-
2250	1154	1.11	1248	1.33	_	_	-	-	-	_
2375	1208	1.28	1298	1.52	_	-	-	-	-	_
2500	1261	1.47	_	-	_		_	_	_	_

			A	VAILABLE E	XTERNAL S	TATIC PRES	SURE (in. w	g)		
CFM	1	.2	1	.4	1	.6	1	.8	2	.0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	1316	1.05	1387	1.17	1454	1.28	1517	1.39	1578	1.50
1625	1353	1.20	1423	1.33	1489	1.46	_	_	_	-
1750	1391	1.36	1460	1.51	-	_	_	_	_	-
1875	_	_	-	_	_	_	_	_	_	-
2000	_	_	-	_	_	_	_	_	_	_
2125	_	_	-	_	_	_	_	_	_	-
2250	_	_	-	_	_	_	_	_	_	-
2375	_	_	-	_	_	_	_	_	_	-
2500	_	-	_	_	_	_	_	_	_	_

**NOTE**: For more information, see General Fan Performance Notes. **Boldface** indicates field – supplied drive is required.

Medium static 1035-1466 RPM, 1.5 BHP max

Table 33 - 48KC\*\*06

## 1 PHASE

## **5 TON HORIZONTAL SUPPLY**

			ΑV	/AILABLE E	XTERNAL S	TATIC PRES	SURE (in. w	g)		
CFM	0	.2	0	.4	0	.6	0.	.8	1	.0
	RPM	ВНР	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	798	0.41	906	0.55	1002	0.71	1088	0.87	1167	1.05
1625	845	0.50	949	0.65	1041	0.81	1125	0.98	1202	1.17
1750	893	0.60	993	0.76	1081	0.93	1163	1.11	1238	1.30
1875	942	0.71	1037	0.88	1123	1.06	1202	1.25	1275	1.44
2000	992	0.84	1083	1.02	1166	1.21	1242	1.40	_	-
2125	1043	0.98	1129	1.17	1209	1.37	_	-	_	-
2250	1093	1.14	1177	1.34	-		-		_	_
2375	1145	1.32	1225	1.53	-		-		-	-
2500	1196	1.51	_	_	_	_	_	_	_	_

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	ВНР	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	1241	1.23	1310	1.42	-	-	-	-	-	-
1625	1274	1.36	-	-	-	-	-	-	-	-
1750	1308	1.50	-	-	-	-	-	-	-	-
1875	-	-	-	-	-	-	-	-	-	-
2000	-	-	-	-	-	-	-	-	-	-
2125	-	-	-	-	-	-	-	-	-	-
2250	-	-	-	-	-	-	-	-	-	-
2375	-	-	-	-	_	-	-	-	_	_
2500	-	-	-	-	-	-	-	-	-	-

**NOTE**: For more information, see General Fan Performance Notes.

Medium static 1035-1466 RPM, 1.5 BHP max

# FAN PERFORMANCE (BELT DRIVE) (cont.)

Table 34 - 48KC\*\*06

## 3 PHASE

# **5 TON VERTICAL SUPPLY**

			Α	VAILABLE E	XTERNAL S	TATIC PRES	SURE (in. wo	3)		
CFM	0	.2	0	.4	0	.6	0.	.8	1.	.0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	ВНР	RPM	BHP
1500	847	0.41	966	0.55	1067	0.68	1158	0.81	1240	0.93
1625	896	0.50	1010	0.65	1109	0.79	1198	0.93	1278	1.07
1750	947	0.59	1056	0.76	1152	0.92	1238	1.07	1318	1.22
1875	998	0.70	1103	0.88	1196	1.05	1280	1.22	1358	1.38
2000	1049	0.82	1151	1.02	1241	1.20	1323	1.38	1399	1.56
2125	1102	0.96	1199	1.17	1287	1.37	1367	1.56	1441	1.75
2250	1154	1.11	1248	1.33	1333	1.55	1411	1.75	1484	1.96
2375	1208	1.28	1298	1.52	1381	1.74	1457	1.96	1528	2.18
2500	1261	1.47	1349	1.72	1429	1.96	1503	2.19	1572	2.42

			Α	VAILABLE E	XTERNAL S	TATIC PRES	SURE (in. w	g)		
CFM	1	.2	1.	.4	1	.6	1	.8	2	.0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	1316	1.05	1387	1.17	1454	1.28	1517	1.39	1578	1.50
1625	1353	1.20	1423	1.33	1489	1.46	1552	1.58	1611	1.70
1750	1391	1.36	1460	1.51	1525	1.65	1587	1.78	1646	1.91
1875	1430	1.54	1498	1.70	1562	1.85	1623	2.00	1681	2.14
2000	1470	1.73	1537	1.90	1600	2.06	1660	2.23	1718	2.38
2125	1511	1.93	1576	2.12	1639	2.29	1698	2.47	1755	2.64
2250	1552	2.15	1617	2.35	1678	2.54	1737	2.73	_	-
2375	1595	2.39	1658	2.60	1718	2.80	_	_	_	-
2500	1638	2.64	1700	2.87	_	-	-	-	-	-

**NOTE**: For more information, see General Fan Performance Notes. **Boldface** indicates field – supplied drive is required.

Medium static 1035 – 1466 RPM, 2.9 BHP max High static 1303 – 1687 RPM, 2.9 BHP max

Table 35 - 48KC\*\*06

## 3 PHASE

# **5 TON HORIZONTAL SUPPLY**

			А	VAILABLE E	XTERNAL S	TATIC PRES	SURE (in. wo	9)		
CFM	0	.2	0	.4	0	.6	0.	.8	1.	.0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	798	0.41	906	0.55	1002	0.71	1088	0.87	1167	1.05
1625	845	0.50	949	0.65	1041	0.81	1125	0.98	1202	1.17
1750	893	0.60	993	0.76	1081	0.93	1163	1.11	1238	1.30
1875	942	0.71	1037	0.88	1123	1.06	1202	1.25	1275	1.44
2000	992	0.84	1083	1.02	1166	1.21	1242	1.40	1313	1.61
2125	1043	0.98	1129	1.17	1209	1.37	1283	1.57	1353	1.79
2250	1093	1.14	1177	1.34	1254	1.55	1325	1.76	1393	1.98
2375	1145	1.32	1225	1.53	1299	1.74	1369	1.97	1434	2.20
2500	1196	1.51	1273	1.73	1345	1.96	1413	2.19	1477	2.43

			Α	VAILABLE E	XTERNAL S	TATIC PRES	SURE (in. w	g)		
CFM	1	.2	1	.4	1	.6	1	.8	2	.0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	1241	1.23	1310	1.42	1375	1.63	1438	1.84	1497	2.06
1625	1274	1.36	1342	1.56	1406	1.77	1467	1.98	1526	2.21
1750	1308	1.50	1375	1.70	1438	1.92	1498	2.14	1555	2.37
1875	1344	1.65	1409	1.86	1471	2.09	1530	2.32	1586	2.55
2000	1380	1.82	1444	2.04	1505	2.27	1563	2.51	1619	2.75
2125	1418	2.01	1481	2.24	1540	2.47	1597	2.72	1652	2.97
2250	1457	2.21	1518	2.45	1576	2.69	1632	2.94	1686	3.20
2375	1497	2.43	1556	2.68	1614	2.93	1669	3.19	-	-
2500	1538	2.68	1596	2.93	1652	3.19		-		_

**NOTE**: For more information, see General Fan Performance Notes. **Boldface** indicates field—supplied drive is required.

Medium static 1035 – 1466 RPM, 2.9 BHP max High static 1303 – 1687 RPM, 2.9 BHP max

# **FAN PERFORMANCE (cont.)**

Table 36 - PULLEY ADJUSTMENT - BELT DRIVE

		MOTOR/DRIVE				M	OTOR PL	JLLEY TU	RNS OPE	N			
	UNIT	СОМВО	0	0.5	1	1.5	2	2.5	3	3.5	4	4.5	5
0.4		Medium Static	1175	1135	1094	1054	1013	973	932	892	851	811	770
04		High Static	1466	1423	1380	1337	1294	1251	1207	1164	1121	1078	1035
25		Medium Static	1175	1135	1094	1054	1013	973	932	892	851	811	770
05	1 phase	High Static	1466	1423	1380	1337	1294	1251	1207	1164	1121	1078	1035
00		Medium Static	1466	1423	1380	1337	1294	1251	1207	1164	1121	1078	1035
06		High Static	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
		Medium Static	1175	1135	1094	1054	1013	973	932	892	851	811	770
04		High Static	1466	1423	1380	1337	1294	1251	1207	1164	1121	1078	1035
		Medium Static	1303	1265	1226	1188	1150	1112	1073	1035	997	958	920
05	3 phase	High Static	1639	1596	1553	1510	1467	1424	1380	1337	1294	1251	1208
		Medium Static	1466	1423	1380	1337	1294	1251	1207	1164	1121	1078	1035
06		High Static	1687	1649	1610	1572	1533	1495	1457	1418	1380	1341	1303

 $\textbf{NOTE} \hbox{: Do not adjust pulley further than 5 turns open.}$ 

Factory settingsN/A - Not Available

# **ELECTRICAL INFORMATION**

Table 37 – 48KC\*\*04 SINGLE STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR 3 TONS

	UNIT V	OLTAGE	COI	MP 1	OFM	l (ea)		IFM	
V-Ph-Hz	RA	NGE	DIA	LDA	WATTS	FI A	TVDE	FFF at Full Load	E1 A
Ī	MIN	MAX	RLA	LRA	WAIIS	FLA	TYPE	EFF at Full Load	FLA
					190	1.0	DD-STD	78%	7.4
208-1-60	187	253	16.6	79	190	1.0	MED	67%	4.9
					190	1.0	HIGH	76%	7.0
					190	1.0	DD-STD	78%	7.4
230-1-60	187	253	16.6	79	190	1.0	MED	67%	4.9
					190	1.0	HIGH	76%	7.0
					190	1.0	DD-STD	78%	7.4
208-3-60	187	253	10.4	73	190	1.0	MED	87%	5.2
					190	1.0	HIGH	89%	8.4
					190	1.0	DD-STD	78%	7.4
230-3-60	187	253	10.4	73	190	1.0	MED	87%	4.9
					190	1.0	HIGH	89%	8.3
					190	0.5	DD-STD	78%	4.0
460-3-60	414	506	5.8	38	190	0.5	MED	87%	2.5
					190	0.5	HIGH	89%	4.2
					190	0.5	DD-STD	78%	4.0
575-3-60	518	633	3.8	37	190	0.5	MED	72%	1.6
					190	0.5	HIGH	77%	2.8

# Table 38 – 48KC\*\*05 SINGLE STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR 4 TONS

	UNIT V	OLTAGE	COI	MP 1	OFM	l (ea)		IFM	
V-Ph-Hz	RA	NGE	DI A	LBA	WATTS	ELA	TVDE	EFF at Full Load	ELA
	MIN	MAX	RLA	LRA	WAIIS	FLA	TYPE	EFF at Full Load	FLA
					325	1.5	DD-STD	78%	7.4
208-1-60	187	253	21.8	117	325	1.5	MED	67%	4.9
					325	1.5	HIGH	76%	7.0
					325	1.5	DD-STD	78%	7.4
230-1-60	187	253	21.8	117	325	1.5	MED	67%	4.9
					325	1.5	HIGH	76%	7.0
					325	1.5	DD-STD	78%	7.4
208-3-60	187	253	13.7	83	325	1.5	MED	87%	5.2
					325	1.5	HIGH	89%	8.4
					325	1.5	DD-STD	78%	7.4
230-3-60	187	253	13.7	83	325	1.5	MED	87%	4.9
					325	1.5	HIGH	89%	8.3
					325	0.8	DD-STD	78%	4.0
460-3-60	414	506	6.2	41	325	0.8	MED	87%	2.5
					325	0.8	HIGH	89%	4.2
					325	0.6	DD-STD	78%	4.0
575-3-60	518	633	4.8	33	325	0.6	MED	72%	1.6
					325	0.6	HIGH	77%	2.8

## Table 39 – 48KC\*\*06 SINGLE STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR 5 TONS

	UNIT V	OLTAGE	COI	MP 1	OFM	(ea)		IFM		
V-Ph-Hz	RA	NGE	DI A	LDA	WATTO	F1 A	T/DE	EEE of Early and	E. A	
[	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA	
208-1-60	187	253	25.0	134	325	1.4	DD-STD	78%	7.4	
200-1-00	107	253	25.0	134	325	1.4	MED	76%	7.0	
230-1-60	187	253	25.0	134	325	1.4	DD-STD	78%	7.4	
230-1-60	107	253	25.0	134	325	1.4	MED	76%	7.0	
					325	1.4	DD-STD	78%	7.4	
208-3-60	187	253	15.9	110	325	1.4	MED	89%	8.4	
					325	1.4	HIGH	89%	8.4	
					325	1.4	DD-STD	78%	7.4	
230-3-60	187	253	15.9	110	325	1.4	MED	89%	8.3	
					325	1.4	HIGH	89%	8.3	
					325	0.9	DD-STD	78%	4.0	
460-3-60	414	506	7.0	52	325	0.9	MED	89%	4.2	
					325	0.9	HIGH	89%	4.2	
					325	0.9	DD-STD	78%	4.0	
575-3-60	518	633	5.1	40	325	0.9	MED	77%	2.8	
					325	0.9	HIGH	77%	2.8	

Table 40 - UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA

		NOM. V-Ph-Hz			208/230-1-60			208/230-3-60	0 <b>*</b> *	зкс	460-3-60			575-3-60			208/230-1-60			208/230-3-60	0**	зкс	460-3-60			575-3-60	
		IFM TYPE		DD-STD	MED	HIGH	DD-STD	MED	HIGH	DD-STD	MED	HIGH	DD-STD	MED	HIGH	DD-STD	MED	HIGH	ODS-QQ	MED	HIGH	DD-STD	MED	HIGH	DD-STD	MED	HIGH
		Ç.	đ S	30	27	59	22	20/19	23/23	12	11	12	10	7	6	37	34	36	56	24/24	27/27	13	12	13	11	6	10
	ON	MAX FUSE	HACR	45	40	45	30	25/25	30/30	15	15	15	15	15	15	20	20	20	30	30/30	40/40	15	15	15	15	15	15
	NO P.E.	DISC. SIZE	FLA	29	26	28	22	19/19	23/23	12	10	12	10	7	80	35	32	35	56	23/23	27/27	13	Ξ	13	11	œ	6
NO C.O. or l		SIZE	LRA	88	93	118	82	111	147	43	22	75	42	45	09	128	133	158	94	123	159	47	61	79	39	45	22
NO C.O. or UNPWR C.O.		Š	<b>4</b> ∑	32	59	31	24	22/21	25/25	13	12	13	12	0	10	39	36	38	28	26/26	29/29	14	13	14	13	Ξ	12
	w/ P.E. (pw	MAX FUSE	HACR	45	45	45	30	30/30	30/30	15	15	15	15	15	15	20	90	20	40	30/30	40/40	20	15	20	15	15	15
	w/ P.E. (pwrd fr/ unit)	DISC. SIZE	FLA	31	28	30	24	21/21	25/25	13	1	13	12	6	10	37	35	37	28	26/25	29/29	14	12	14	13	10	12
		SIZE	LRA	06	92	120	84	113	149	44	58	92	44	47	62	130	135	160	96	125	161	48	62	80	41	44	59
		Š	<b>4</b>	ı	ı	ı	27	24/24	28/28	14	13	15	11	6	10	ı	ı	ı	31	29/29	32/32	15	14	15	13	10	12
	NO	MAX FUSE	HACR	ı	ı	ı	30	30/30	30/30	20	15	20	15	15	15	ı	ı	ı	40	40/40	45/45	20	15	20	15	15	15
	NO P.E.	DISC. SIZE	Ą	ı	ı	ı	27	25/24	28/28	14	13	15	12	O	10	1	ı	ı	32	29/29	33/33	15	13	15	13	10	11
w/ PWRD C.O.		SIZE	LRA	ı	ı	ı	87	116	152	45	69	77	44	47	62	ı	ı	ı	66	128	164	49	63	81	41	44	59
D C.O.		S S	<b>4</b>	ı	ı	ı	59	26/26	30/29	15	4	16	13	Ξ	12	ı	ı	ı	33	31/31	34/34	16	15	16	15	12	13
	w/ P.E. (pv	MAX FUSE	HACR	ı	ı	ı	35	30/30	35/32	20	15	20	15	15	15	ı	ı	ı	45	40/40	45/45	20	20	20	20	15	15
	w/ P.E. (pwrd fr/ unit)	DISC. SIZE	FLA		ı	ı	29	27/26	30/30	16	14	16	14	11	12	1	1	ı	34	31/31	35/35	16	15	17	15	12	14
		SIZE	LRA	ı	ı	ı	89	118	154	46	09	78	46	49	64		1	ı	101	130	166	50	64	82	43	46	61

See "Legend and Notes for Table 40 on page 42.

TABLE 40 - UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA (CONT)

		NOM. V-Ph-Hz		000	208/230-1-60		208/230-3-60	90:	** <b>O</b>	460-3-60			575-3-60						
						-DO-		Ī	-QQ		Ī	-QQ		Ī					
					IFM TYPE				DD-STD	MED	DD-STD	MED	HIGH	DD-STD	MED	HIGH	DD-STD	MED	HIGH
			Z C Z	41	40	59	30/30	30/30	14	4	4	12	Ξ	Ξ					
	NO	MAX FUSE	HACR	09	09	40	45/45	45/45	20	20	20	15	15	15					
2	NO P.E.	DISC. SIZE	FLA	39	38	28	30/29	30/29	14	4	4	12	10	10					
NO C.O. or UNPW		SIZE	LRA	144	174	120	185	185	28	06	06	46	64	64					
JNPWR C.O.			МСА		42	31	32/32	32/32	15	15	15	14	12	12					
	w/ P.E. (pw	MAX FUSE	HACR	09	09	45	45/45	45/45	20	20	20	15	15	15					
	w/ P.E. (pwrd fr/ unit)	DISC. SIZE	FLA	41	41	31	32/32	32/32	15	15	15	14	12	12					
		SIZE	LRA	146	176	122	187	187	69	91	91	48	99	99					
			A C D D	ı	ı	34	32/32	32/32	16	17	17	13	12	12					
	NO	MAX FUSE	HACR	ı	ı	45	20/20	20/20	20	20	20	15	15	15					
	NO P.E.	DISC. SIZE	FLA	ı	ı	34	35/35	35/35	16	16	16	13	12	12					
w/ PWRD C.O.		SIZE	LRA	1	ı	125	190	190	09	92	92	48	99	99					
3D C.O.			MCA	ı	ı	36	37/37	37/37	47	18	18	15	14	14					
	w/ P.E. (pv	MAX FUSE	HACR	ı	ı	90	20/20	20/20	20	20	20	20	15	15					
	w/ P.E. (pwrd fr/ unit)	DISC. SIZE	FLA	ı	ı	36	37/37	37/37	17	18	18	16	14	14					
		SIZE	LRA	ı	ı	127	192	192	61	93	93	20	89	89					

See "Legend and Notes for Table 40 on page 42.

## Legend and Notes for Table 40

LEGEND:

DD

MCA

**BRKR** Circuit breaker CO Convenient outlet

Direct drive (indoor fan motor) DISC Disconnect FLA Full load amps IFM Indoor fan motor LRA Locked rotor amps

MAX FUSE or HACR Breaker MOCP PF Power exhaust

PWRD CO Powered convenient outlet UNPWR CO Unpowered convenient outlet

NOTES:


1. In compliance with NEC requirements for multimotor and combination load equipment (refer to NEC Articles 430 and 440), the overcurrent protective device for the unit shall be fuse or HACR breaker. Canadian units may be fuse or cir-

Minimum circuit amps

#### 2. Unbalanced 3-Phase Supply Voltage

Never operate a motor where a phase imbalance in supply voltage is greater than 2%. Use the following formula to determine the percentage of voltage imbalance.

Example: Supply voltage is 230-3-60



Average Voltage = 
$$\frac{(224 + 231 + 226)}{3} = \frac{681}{3}$$

Determine maximum deviation from average voltage.

(AB) 227 - 224 = 3 v(BC) 231 - 227 = 4 v(AC) 227 - 226 = 1 vMaximum deviation is 4 v.

Determine percent of voltage imbalance.

% Voltage Imbalance = 
$$100 \times \frac{4}{227}$$
 =  $1.76\%$ 

This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%.

**IMPORTANT**: If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.

# **SEQUENCE OF OPERATION**

## General

The sequence below describes the sequence of operation for an electromechanical unit with and without a factory installed EconoMi\$er IV and X (called "economizer" in this sequence). For information regarding a direct digital controller, see the start-up, operations, and troubleshooting manual for the applicable controller.

## Electromechanical units with no economizer

#### Cooling (Single speed indoor fan motor) —

When the thermostat calls for cooling, terminals G and Y1 are energized. As a result, the indoor fan contactor (IFC) and the compressor contactor (C1) are energized, causing the indoor fan motor (IFM), compressor #1, and outdoor fan to start. If the unit has 2 stages of cooling, the thermostat will additionally energize Y2. The Y2 signal will energize compressor contactor #2 (C2), causing compressor #2 to start. Regardless of the number of stages, the outdoor fan motor runs continuously while unit is cooling. When SAV system is utilized, indoor fan motor runs at design CFM (full speed) during the heating operation.

#### Heating (Single speed indoor fan motor) —

When the thermostat calls for heating, power is sent to W on the Integrated Gas Controller (IGC) board. An LED (light-emitting diode) on the IGC board turns on and remains on during normal operation. A check is made to ensure that the rollout switch and limit switch are closed. If the check was successful, the induced-draft motor is energized, and when its speed is satisfactory, as proven by the "hall effect" sensor, the ignition activation period begins. The burners will ignite within 5 seconds. If the burners do not light, there is a 22-second delay before another 5-second attempt. This sequence is repeated for 15 minutes or until the burners light. If, after the 15 minutes, the burners still have not lit, heating is locked out. To reset the control, break 24-v power to the thermostat.

When ignition occurs, the IGC board will continue to monitor the condition of the rollout switch, the limit switches, the "hall effect" sensor, as well as the flame sensor. 45 seconds after ignition occurs, assuming the unit is controlled through a room thermostat set for fan auto, the indoor fan motor will energize (and the outdoor air dampers will open to their minimum position). If, for some reason, the over-temperature limit opens prior to the start of the indoor fan blower, the unit will shorten the 45-second delay to 5 seconds less than the time from initiation of heat to when the limit tripped. Gas will not be interrupted to the burners and heating will continue. Once the fan-on delay has been modified, it will not change back to 45 seconds until power is reset to the control.

On units with 2 stages of heat, when additional heat is required, W2 closes and initiates power to the second stage of the main gas valve. When the thermostat is satisfied, W1 and W2 open and the gas valve closes, interrupting the flow of gas to the main burners.

If the call for W1 lasted less than 1 minute, the heating cycle will not terminate until 1 minute after W1 became active. If the unit is controlled through a room thermostat set for fan auto, the indoor fan motor will continue to operate for an additional 45 seconds then stop. If the over-temperature limit opens after the indoor motor is stopped, but within 10 minutes of W1 becoming inactive, on the next cycle the time will be extended by 15 seconds. The maximum delay is 3 minutes. Once modified, the fan off delay will not change back to 45 seconds unless power is reset to the control. A LED indicator is provided on the IGC to monitor operation.

# **SEQUENCE OF OPERATION (cont.)**

# Electromechanical units with an economizer

## Cooling —

When free cooling is not available, the compressors will be controlled by the zone thermostat. When free cooling is available, the outdoor air damper is modulated by the EconoMi\u00a9er IV and X control to provide a 50°F (10°C) to 55°F (13°C) mixed air temperature into the zone. As the mixed air temperature fluctuates above 55°F (13°C)or below 50°F (10°C) dampers will be modulated (open or close) to bring the mixed air temperature back within control. If mechanical cooling is utilized with free cooling, the outdoor air damper will maintain its current position at the time the compressor is started. If the increase in cooling capacity causes the mixed air temperature to drop below 45°F (7°C), then the outdoor air damper position will be decreased to the minimum position. If the mixed air temperature continues to fall, the outdoor air damper will close. Control returns to normal once the mixed air temperature rises above 48°F (9°C). The power exhaust fans will be energized and de-energized, if installed, as the outdoor air damper opens and closes.

If field installed accessory CO<sub>2</sub> sensors are connected to the EconoMi\$er IV and X control, a demand controlled ventilation strategy will begin to operate. As the CO<sub>2</sub> level in the zone increases above the CO<sub>2</sub> setpoint, the minimum position of the damper will be increased proportionally. As the CO<sub>2</sub> level decreases because of the increase in fresh air, the outdoor air damper will be proportionally closed. For EconoMi\$er IV and X operation, there must be a thermostat call for the fan (G).

If the unit is occupied and the fan is on, the damper will operate at minimum position. Otherwise, the damper will be closed.

If field installed accessory CO<sub>2</sub> sensors are connected to the EconoMi\$er IV and X control, a demand controlled ventilation strategy will begin to operate. As the CO<sub>2</sub> level in the zone increases above the CO<sub>2</sub> setpoint, the minimum position of the damper will be increased proportionally. As the CO<sub>2</sub> level decreases because of the increase in fresh air, the outdoor air damper will be proportionally closed. For EconoMi\$er IV and X operation, there must be a thermostat call for the fan (G). If the unit is occupied and the fan is on, the damper will operate at minimum position. Otherwise, the damper will be closed.

When the EconoMi\$er IV and X control is in the occupied mode and a call for cooling exists (Y1 on the thermostat), the control will first check for indoor fan operation. If the fan is not on, then cooling will not be activated. If the fan is on, then the control will open the EconoMi\$er IV and X damper to the minimum position.

On the initial power to the EconoMi\$er IV and X control, it will take the damper up to 2 1/2 minutes before it begins to position itself. After the initial power-up, further changes in damper position can take up to 30 seconds to initiate. Damper movement from full closed to full open (or vice versa) will take between 1 1/2 and 2 1/2 minutes. If free cooling can be used as determined from the appropriate changeover command (switch, dry bulb, enthalpy curve, differential dry bulb, or differential enthalpy), then the control will modulate the dampers open to maintain the mixed air temperature setpoint at 50°F (10°C) to 55°F (13°C). If there is a further demand for cooling (cooling second stage - Y2 is energized), then the control will bring on compressor stage 1 to maintain the mixed air temperature setpoint. The EconoMi\$er IV and X damper will be open at maximum position.

## Heating

The sequence of operation for the heating is the same as an electromechanical unit with no economizer. The only difference is how the economizer acts. The economizer will stay at the Economizer Minimum Position while the evaporator fan is operating. The outdoor air damper is closed when the indoor fan is not operating.

#### Optional Humidi-MiZer Dehumidification System

Units with the factory equipped Humidi-MiZer option are capable of providing multiple modes of improved dehumidification as a variation of the normal cooling cycle. The Humidi-MiZer option includes additional valves in the liquid line and discharge line of each refrigerant circuit, a small reheat condenser coil downstream of the evaporator, and Motormaster variable-speed control of some or all outdoor fans. Operation of the revised refrigerant circuit for each mode is described below.

The Humidi-MiZer system provides three sub-modes of operation: Cool, Reheat1, and Reheat2.

**Cool mode** - provides a normal ratio of Sensible and Latent Cooling effect from the evaporator coil.

**Reheat1** - provides increased Latent Cooling while slightly reducing the Sensible Cooling effect.

**Reheat2** - provides normal Latent Cooling but with null or minimum Sensible Cooling effect delivered to the space.

The Reheat1 and Reheat2 modes are available when the unit is not in a Heating mode and when the Low Ambient Lockout switch is closed.

The following diagrams depict piping for Single Stage cooling units.

# **SEQUENCE OF OPERATION (cont.)**

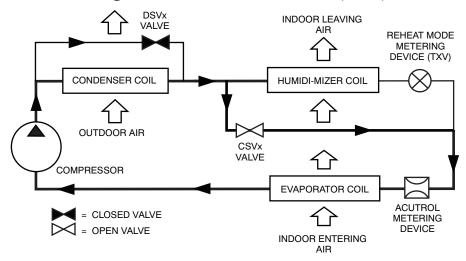


Fig. 5 - Normal Cooling Mode - Humidi-MiZer System with Single Stage Cooling

C12647

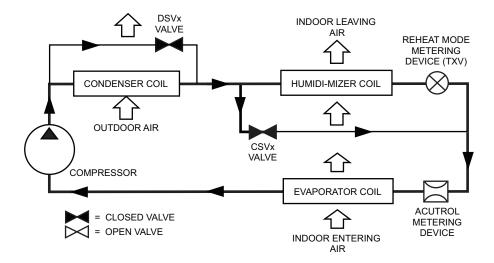


Fig. 6 - Subcooling Mode (Reheat 1) - Humidi-MiZer System with Single Stage Cooling

C12648

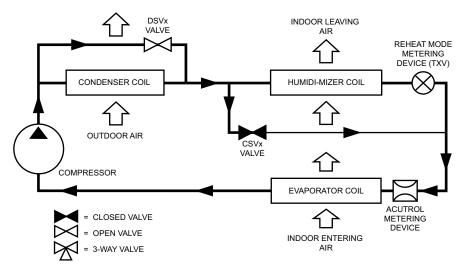


Fig. 7 - Hot Gas Reheat Mode (Reheat 2) - Humidi-MiZer System with Single Stage Cooling

C12649

# **GUIDE SPECIFICATIONS - 48KC\*\*04-06**

# Gas Heat/Electric Cooling Packaged Rooftop

# **HVAC Guide Specifications**

Size Range: 3 to 5 Nominal Tons

## **Section Description**

## 23 06 80 Schedules for Decentralized HVAC Equipment

23 06 80.13 Decentralized Unitary HVAC Equipment Schedule

23 06 80.13.A. Rooftop unit schedule

1. Schedule is per the project specification requirements.

## 23 07 16 HVAC Equipment Insulation

23 07 16.13 Decentralized, Rooftop Units:

23 07 16.13.A. Evaporator fan compartment:

- 1. Interior cabinet surfaces shall be insulated with a minimum 1/2-in. thick, minimum 1 1/2 lb density, flexible fiberglass insulation bonded with a phenolic binder, neoprene coated on the air side.
- 2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

23 07 16.13.B. Gas heat compartment:

- 1. Aluminum foil-faced fiberglass insulation shall be used.
- 2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

#### 23 09 13 Instrumentation and Control Devices for HVAC

23 09 13.23 Sensors and Transmitters

23 09 13.23.A. Thermostats

- 1. Thermostat must
  - a. energize both "W" and "G" when calling for heat.
  - b. have capability to energize 1 stage of cooling, and 2 different stages of heating.
  - c. include capability for occupancy scheduling.

### 23 09 23 Direct-digital Control system for HVAC

23 09 23.13 Decentralized, Rooftop Units:

23 09 23.13.A. PremierLink controller

- 1. Shall be ASHRAE 62 compliant.
- 2. Shall accept 18-32 VAC input power.
- 3. Shall have an operating temperature range from -40°F (-40°C) to 158°F (70°C), 10% 95% RH (non-condensing).
- 4. Shall include an integrated economizer controller to support an economizer with 4 to 20 mA actuator input and no microprocessor controller.
- 5. Controller shall accept the following inputs: space temperature, setpoint adjustment, outdoor air temperature, indoor air quality, outdoor air quality, indoor relative humidity, compressor lock-out, fire shutdown, enthalpy, fan status, remote time clock/door switch.
- 6. Shall accept a CO<sub>2</sub> sensor in the conditioned space, and be Demand Control Ventilation (DCV) ready.
- 7. Shall provide the following outputs: economizer, fan, cooling stage 1, cooling stage 2, heat stage 1, heat stage 2, heat stage 3/ exhaust/ reversing valve/ dehumidify/ occupied.
- 8. Unit shall provide surge protection for the controller through a circuit breaker.
- 9. Shall be Internet capable, and communicate at a Baud rate of 38.4K or faster
- 10. Shall have an LED display independently showing the status of activity on the communication bus, and processor operation.
- 11. Shall include an RS-485 protocol communication port, an access port for connection of either a computer or a Carrier technician tool, an RS-485 port for network communication to intelligent space sensors and displays, and a port to connect an optional LonWorks plug-in communications card.
- 12. Shall have built-in Carrier Comfort Network<sup>™</sup> (CCN) protocol, and be compatible with other CCN devices, including ComfortLink<sup>™</sup> and ComfortVIEW<sup>™</sup> controllers.
- 13. Shall have built-in support for Carrier technician tool.

- Software upgrades will be accomplished by local download. Software upgrades through chip replacements are not allowed.
- 15. Shall be shock resistant in all planes to 5G peak, 11ms during operation, and 100G peak, 11ms during storage.
- 16. Shall be vibration resistant in all planes to 1.5G @ 20-300 Hz.
- 17. Shall support a bus length of 4000 ft (1219m) max, 60 devices per 1000 ft (305m) section, and 1 RS-485 repeater per 1000 ft (305m) sections.
- 23 09 23.13.B. RTU Open Open protocol, direct digital controller:
  - 1. Shall be ASHRAE 62 compliant.
  - 2. Shall accept 18-30VAC, 50-60Hz, and consumer 15VA or less power.
  - 3. Shall have an operating temperature range from -40°F (-40°C) to 130°F (54°C), 10% 90% RH (non-condensing).
  - Shall include built-in protocol for BACNET (MS/TP and PTP modes), Modbus (RTU and ASCII), Johnson N2 and LonWorks. LonWorks Echelon processor required for all Lon applications shall be contained in separate communication board.
  - 5. Shall allow access of up to 62 network variables (SNVT). Shall be compatible with all open controllers.
  - 6. Baud rate Controller shall be selectable using a dipswitch.
  - 7. Shall have an LED display independently showing the status of serial communication, running, errors, power, all digital outputs, and all analog inputs.
  - 8. Shall accept the following inputs: space temperature, setpoint adjustment, outdoor air temperature, indoor air quality, outdoor air quality, compressor lock-out, fire shutdown, enthalpy switch, and fan status/filter status/humidity/remote occupancy.
  - 9. Shall provide the following outputs: economizer, variable frequency drive, fan, cooling stage 1, cooling stage 2, heat stage 1, heat stage 2, exhaust reversing valve/high fan speed.
  - 10. Shall have built-in surge protection circuitry through solid state polyswitches. Polyswitches shall be used on incoming power and network connections. Polyswitches will return to normal when the "trip" condition clears.
  - 11. Shall have a battery back-up capable of a minimum of 10,000 hours of data and time clock retention during power outages.
  - 12. Shall have built-in support for Carrier technician tool.
  - 13. Shall include an RS-485 protocol communication port, an access port for connection of either a computer or a Carrier technician tool, an RS-485 port for network communication to intelligent space sensors and displays, and a port to connect an optional LonWorks communications card.
  - 14. Software upgrades will be accomplished by either local or remote download. No software upgrades through chip replacements are allowed.

### 23 09 33 Electric and Electronic Control System for HVAC

23 09 33.13 Decentralized, Rooftop Units:

### 23 09 33.13.A. General:

- 1. Shall be complete with self-contained low-voltage control circuit protected by a resettable circuit breaker on the 24-v transformer side. Transformer shall have 75VA capability.
- 2. Shall utilize color-coded wiring.
- 3. Shall include a central control terminal board to conveniently and safely provide connection points for vital control functions such as: smoke detectors, phase monitor, gas controller, economizer, thermostat, DDC control options, and low and high pressure switches.
- 4. The heat exchanger shall be controlled by an integrated gas controller (IGC) microprocessor. See heat exchanger section of this specification.
- 5. Unit shall include a minimum of one 8-pin screw terminal connection board for connection of control wiring.

#### 23 09 33.23.B. Safeties:

- 1. Compressor over-temperature, over-current. High internal pressure differential.
- 2. Low pressure switch.
  - a. Low pressure switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
- 3. High pressure switch.
  - a. High pressure switch shall use different color wire than the low pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
- 4. Automatic reset, motor thermal overload protector.
- 5. Heating section shall be provided with the following minimum protections:
  - a. High temperature limit switches.

- b. Induced draft motor speed sensor.
- c. Flame rollout switch.
- d. Flame proving controls.

## 23 09 93 Sequence of Operations for HVAC Controls

- 23 09 93.13 Decentralized, Rooftop Units:
- 23 09 93.13 INSERT SEQUENCE OF OPERATION

#### 23 40 13 Panel Air Filters

- 23 40 13.13 Decentralized, Rooftop Units:
- 23 40 13.13.A. Standard filter section
  - 1. Shall consist of factory installed, low velocity, disposable 2-in. thick fiberglass filters of commercially available sizes.
  - 2. Unit shall use only one filter size. Multiple sizes are not acceptable.
  - 3. Filters shall be accessible through an access panel with "no-tool" removal as described in the unit cabinet section of this specification (23 81 19.13.G).

## 23 81 19 Self-Contained Air Conditioners

- 23 81 19.13 Small-Capacity Self-Contained Air Conditioners (48KC\*\*04-06)
- 23 81 19.13.A. General
  - 1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing a fully hermetic scroll compressor(s) for cooling duty and gas combustion for heating duty.
  - 2. Factory assembled, single-piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.
  - 3. Unit shall use Puron refrigerant.
  - 4. Unit shall be installed in accordance with the manufacturer's instructions.
  - 5. Unit must be selected and installed in compliance with local, state, and federal codes.

### 23 81 19.13.B. Quality Assurance

- 1. Unit meets ASHRAE 90.1 minimum efficiency requirements.
- 2. Unit shall be rated in accordance with AHRI Standards 210/240.
- 3. Unit shall be designed to conform to ASHRAE 15.
- 4. Unit shall be UL-tested and certified in accordance with ANSI Z21.47 Standards and UL-listed and certified under Canadian standards as a total package for safety requirements.
- 5. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
- 6. Unit casing shall be capable of withstanding 500-hour salt spray exposure per ASTM B117 (scribed specimen).
- 7. Unit shall be designed in accordance with ISO 9001, and shall be manufactured in a facility registered by ISO 9001.
- 8. Roof curb shall be designed to conform to NRCA Standards.
- 9. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
- 10. Unit shall be designed in accordance with UL Standard 1995, including tested to withstand rain.
- 11. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box up to 40 mph.
- 12. Unit shake tested to assurance level 1, ASTM D4169 to ensure shipping reliability.

### 23 81 19.13.C. Delivery, Storage, and Handling

- 1. Unit shall be stored and handled per manufacturer's recommendations.
- 2. Lifted by crane requires either shipping top panel or spreader bars.
- 3. Unit shall only be stored or positioned in the upright position.

## 23 81 19.13.D. Project Conditions

1. As specified in the contract.

## 23 81 19.13.E. Operating Characteristics

- 1. Unit shall be capable of starting and running at  $115^{\circ}$ F ( $46^{\circ}$ C) ambient outdoor temperature, meeting maximum load criteria of AHRI Standard 210/240 at  $\pm 10\%$  voltage.
- 2. Compressor with standard controls shall be capable of operation down to  $40^{\circ}F$  ( $4^{\circ}C$ ), ambient outdoor temperatures. Accessory winter start kit is necessary if mechanically cooling at ambient temperatures down to  $25^{\circ}F$  ( $-4^{\circ}C$ ).
- 3. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
- 4. Unit shall be factory configured for vertical supply & return configurations.
- 5. Unit shall be field convertible from vertical to horizontal airflow on all models. No special kit required.

- 6. Unit shall be capable of mixed operation: vertical supply with horizontal return or horizontal supply with vertical return.
- 23 81 19.13.F. Electrical Requirements
  - 1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.

#### 23 81 19.13.G. Unit Cabinet

- 1. Unit cabinet shall be constructed of galvanized steel, and shall be bonderized and coated with a prepainted baked enamel finish on all externally exposed surfaces.
- 2. Unit cabinet exterior paint shall be: film thickness, (dry) 0.003 inches minimum, gloss (per ASTM D523, 60°F / 16°C): 60, Hardness: H-2H Pencil hardness.
- 3. Evaporator fan compartment interior cabinet insulation shall conform to AHRI Standards 210/240 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 1/2-in. thick, 1 lb density, flexible fiberglass insulation, neoprene coated on the air side. Aluminum foil-faced fiberglass insulation shall be used in the gas heat compartment.
- 4. Base of unit shall have a minimum of four locations for thru-the-base gas and electrical connections (factory installed or field installed), standard.
- 5. Base Rail
  - a. Unit shall have base rails on a minimum of 2 sides.
  - b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
  - c. Holes shall be provided in the base rail for moving the rooftop by fork truck.
  - d. Base rail shall be a minimum of 16 gauge thickness.
- 6. Condensate pan and connections:
  - a. Shall be a sloped condensate drain pan made of a non-corrosive material.
  - b. Shall comply with ASHRAE Standard 62.
  - c. Shall use a 3/4" -14 NPT drain connection, possible either through the bottom or side of the drain pan. Connection shall be made per manufacturer's recommendations.
- 7. Top panel:
  - a. Shall be a single piece top panel on all sizes.
- 8. Gas Connections:
  - a. All gas piping connecting to unit gas valve shall enter the unit cabinet at a single location on side of unit (horizontal plane).
  - b. Thru-the-base capability
    - (1.) Standard unit shall have a thru-the-base gas-line location using a raised, embossed portion of the unit basepan.
    - (2.) Optional, factory approved, water-tight connection method must be used for thru-the-base gas connections.
    - (3.) No basepan penetration, other than those authorized by the manufacturer, is permitted.
- 9. Electrical Connections
  - a. All unit power wiring shall enter unit cabinet at a single, factory prepared, knockout location.
  - b. Thru-the-base capability.
    - (1.) Standard unit shall have a thru-the-base electrical location(s) using a raised, embossed portion of the unit basepan.
    - (2.) Optional, factory approved, water-tight connection method must be used for thru-the-base electrical connections.
    - (3.) No basepan penetration, other than those authorized by the manufacturer, is permitted.
- 10. Component access panels (standard)
  - a. Cabinet panels shall be easily removable for servicing.
  - b. Unit shall have one factory installed, tool-less, removable, filter access panel.
  - c. Panels covering control box, indoor fan, indoor fan motor, gas components (where applicable), and compressors shall have molded composite handles.
  - d. Handles shall be UV modified, composite. They shall be permanently attached, and recessed into the panel.
  - e. Screws on the vertical portion of all removable access panel shall engage into heat resistant, molded composite collars
  - f. Collars shall be removable and easily replaceable using manufacturer recommended parts.

#### 23 81 19.13.H. Gas Heat

- 1. General
  - a. Heat exchanger shall be an induced draft design. Positive pressure heat exchanger designs shall not be allowed.
  - b. Shall incorporate a direct-spark ignition system and redundant main gas valve.

- c. Gas supply pressure at the inlet to the rooftop unit gas valve must match that required by the manufacturer.
- 2. The heat exchanger shall be controlled by an integrated gas controller (IGC) microprocessor.
  - a. IGC board shall notify users of fault using an LED (light-emitting diode).
  - b. The LED shall be visible without removing the control box access panel.
  - c. IGC board shall contain algorithms that modify evaporator fan operation to prevent future cycling on high temperature limit switch.
  - d. Unit shall be equipped with anti-cycle protection with one short cycle on unit flame rollout switch or 4 continuous short cycles on the high temperature limit switch. Fault indication shall be made using an LED.
- 3. Standard Heat Exchanger construction
  - a. Heat exchanger shall be of the tubular-section type constructed of a minimum of 20-gauge steel coated with a nominal 1.2 mil aluminum-silicone alloy for corrosion resistance.
  - b. Burners shall be of the in-shot type constructed of aluminum-coated steel.
  - c. Burners shall incorporate orifices for rated heat output up to 2000 ft (610m) elevation. Additional accessory kits may be required for applications above 2000 ft (610m) elevation, depending on local gas supply conditions.
  - d. Each heat exchanger tube shall contain multiple dimples for increased heating effectiveness.
- 4. Optional Stainless Steel Heat Exchanger construction
  - a. Use energy saving, direct-spark ignition system.
  - b. Use a redundant main gas valve.
  - c. Burners shall be of the in-shot type constructed of aluminum-coated steel.
  - d. All gas piping shall enter the unit cabinet at a single location on side of unit (horizontal plane).
  - e. The optional stainless steel heat exchanger shall be of the tubular-section type, constructed of a minimum of 20-gauge type 409 stainless steel.
  - f. Type 409 stainless steel shall be used in heat exchanger tubes and vestibule plate.
  - g. Complete stainless steel heat exchanger allows for greater application flexibility.
- 5. Optional Low NO<sub>x</sub> Heat Exchanger construction
  - a. Low NO<sub>x</sub> reduction shall be provided to reduce nitrous oxide emissions to meet California's Air Quality Management District (SCAQMD) low-NO<sub>x</sub> emissions requirement of 40 nanograms per joule or less.
  - b. Primary tubes and vestibule plates on low NO<sub>x</sub> units shall be 409 stainless steel. Other components shall be aluminized steel.
- 6. Induced draft combustion motor and blower
  - a. Shall be a direct-drive, single inlet, forward-curved centrifugal type.
  - b. Shall be made from steel with a corrosion-resistant finish.
  - c. Shall have permanently lubricated sealed bearings.
  - d. Shall have inherent thermal overload protection.
  - e. Shall have an automatic reset feature.

#### 23 81 19.13.I. Coils

- 1. Standard Aluminum Fin Copper Tube Coils:
  - a. Standard evaporator and condenser coils shall have aluminum lanced plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
  - b. Evaporator coils shall be leak tested to 150 psig, pressure tested to 450 psig, and qualified to UL 1995 burst test at 1775 psig.
  - c. Condenser coils shall be leak tested to 150 psig, pressure tested to 650 psig, and qualified to UL 1995 burst test at 1980 psig.
- 2. Optional Pre-coated aluminum-fin condenser coils (3 Phase Models Only):
  - a. Shall have a durable epoxy-phenolic coating to provide protection in mildly corrosive coastal environments.
  - b. Coating shall be applied to the aluminum fin stock prior to the fin stamping process to create an inert barrier between the aluminum fin and copper tube.
  - c. Epoxy-phenolic barrier shall minimize galvanic action between dissimilar metals.
- 3. Optional Copper-fin evaporator and condenser coils (3 Phase Models Only):
  - a. Shall be constructed of copper fins mechanically bonded to copper tubes and copper tube sheets.
  - b. Galvanized steel tube sheets shall not be acceptable.
  - c. A polymer strip shall prevent coil assembly from contacting the sheet metal coil pan to minimize potential for galvanic corrosion between coil and pan.
- 4. Optional E-coated aluminum-fin evaporator and condenser coils (3 Phase Models Only):

- a. Shall have a flexible epoxy polymer coating uniformly applied to all coil surface areas without material bridging between fins.
- b. Coating process shall ensure complete coil encapsulation of tubes, fins and headers.
- c. Color shall be high gloss black with gloss per ASTM D523-89.
- d. Uniform dry film thickness from 0.8 to 1.2 mil on all surface areas including fin edges.
- e. Superior hardness characteristics of 2H per ASTM D3363-92A and cross-hatch adhesion of 4B-5B per ASTM D3359-93.
- f. Impact resistance shall be up to 160 in.-lb (ASTM D2794-93).
- g. Humidity and water immersion resistance shall be up to minimum 1000 and 250 hours respectively (ASTM D2247-92 and ASTM D870-92).
- h. Corrosion durability shall be confirmed through testing to be no less than 1000 hours salt spray per ASTM B117-90.

## 23 81 19.13.J. Refrigerant Components

- 1. Refrigerant circuit shall include the following control, safety, and maintenance features:
  - a. Fixed orifice metering system shall prevent mal-distribution of two-phase refrigerant by including multiple fixed orifice devices in each refrigeration circuit. Each orifice is to be optimized to the coil circuit it serves.
  - b. Refrigerant filter drier Solid core design.
  - c. Service gauge connections on suction and discharge lines.
  - d. Pressure gauge access through a specially designed access port in the top panel of the unit.
- 2. There shall be gauge line access port in the skin of the rooftop, covered by a black, removable plug.
  - a. The plug shall be easy to remove and replace.
  - b. When the plug is removed, the gauge access port shall enable maintenance personnel to route their pressure gauge lines.
  - c. This gauge access port shall facilitate correct and accurate condenser pressure readings by enabling the reading with the compressor access panel on.
  - d. The plug shall be made of a leak proof, UV-resistant, composite material.

### 3. Compressors

- a. Unit shall use fully hermetic, scroll compressor for each independent refrigeration circuit.
- b. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
- c. Compressors shall be internally protected from high discharge temperature conditions.
- d. Compressors shall be protected from an over-temperature and over-amperage conditions by an internal, motor overload device.
- e. Compressor shall be factory mounted on rubber grommets.
- f. Compressor motors shall have internal line break thermal, current overload and high pressure differential protection.
- g. Crankcase heaters shall not be required for normal operating range, unless required by compressor manufacturer due to refrigerant charge limits.

### 23 81 19.13.K. Filter Section

- 1. Filters access is specified in the unit cabinet section of this specification.
- 2. Filters shall be held in place by a pivoting filter tray, facilitating easy removal and installation.
- 3. Shall consist of factory installed, low velocity, throw-away 2-in. thick fiberglass filters.
- 4. Filters shall be standard, commercially available sizes.
- 5. Only one size filter per unit is allowed.

### 23 81 19.13.L. Evaporator Fan and Motor

- 1. Evaporator fan motor:
  - a. Shall have permanently lubricated bearings.
  - b. Shall have inherent automatic-reset thermal overload protection or circuit breaker.
  - c. Shall have a maximum continuous bhp rating for continuous duty operation; no safety factors above that rating shall be required.
- 2. Direct Drive ECM X13 Evaporator Fan Standard:
  - a. Multi-speed motor with easy quick adjustment settings.
  - b. Blower fan shall be double-inlet type with forward-curved blades.
  - c. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.
- 3. Belt-driven Evaporator Fan Factory Optional:
  - a. Belt drive shall include an adjustable pitch motor pulley.

- b. Shall use sealed, permanently lubricated ball-bearing type.
- c. Blower fan shall be double-inlet type with forward-curved blades.
- d. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.

#### 23 81 19.13.M. Condenser Fans and Motors

- 1. Condenser fan motors:
  - a. Shall be a totally enclosed motor.
  - b. Shall use permanently lubricated bearings.
  - c. Shall have inherent thermal overload protection with an automatic reset feature.
  - d. Shall use a shaft-down design on all sizes.
- 2. Condenser Fans:
  - a. Shall be a direct-driven propeller type fan.
  - b. Shall have galvalum blades riveted to corrosion-resistant steel spiders and shall be dynamically balanced.

## 23 81 19.13.N. Special Features Options and Accessories

- 1. Integrated EconoMi\$er IV, EconoMi\$er2, and EconoMi\$er X standard leak rate models. (Factory installed on 3 phase models only. Field installed on all 3 and 1 phase models)
  - a. Integrated, gear driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
  - b. Independent modules for vertical or horizontal return configuration shall be available. Vertical return modules shall be available as a factory installed option.
  - c. Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
  - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
  - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
  - f. Standard leak rate shall be equipped with dampers not to exceed 2% leakage at 1 in. wg pressure differential.
  - g. Economizer controller on EconoMi\$er IV models shall be Honeywell W7212 that provides:
    - (1.) Combined minimum and DCV maximum damper position potentiometers with compressor staging relay.
    - (2.) Functions with solid state analog enthalpy or dry bulb changeover control sensing.
    - (3.) Contain LED indicates for: when free cooling is available, when module is in DCV mode, when exhaust fan contact is closed.
  - h. Economizer controller on EconoMi\$er X models shall be the Honeywell W7220 that provides:
    - (1.) 2-line LCD interface screen for setup, configuration and troubleshooting.
    - (2.) On-board Fault Detection and Diagnostics (FDD) that senses and alerts when the economizer is not operating properly, per California Title 24.
    - (3.) Sensor failure loss of communication identification
    - (4.) Automatic sensor detection
    - (5.) Capabilities for use with multiple-speed indoor fan systems
    - (6.) Utilize digital sensors: Dry bulb and Enthalpy
  - i. Economizer controller on EconoMi\$er 2 models with PremierLink shall be 4-20mA design and controlled by the PremierLink controller. PremierLink does not comply with California Title 24 Fault Detection& Diagnostic (FDD) requirements.
  - j. Economizer controller on EconoMi\$er 2 models with RTU Open models shall be a 4-20mA design controlled directly by the RTU Open controller. RTU Open meets California Title 24 Fault Detection & Diagnostic (FDD) requirements.
  - k. Shall be capable of introducing up to 100% outdoor air.
  - 1. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements.
  - m. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
  - n. Dry bulb outdoor air temperature sensor shall be provided as standard. Enthalpy sensor is also available on factory installed only. Outdoor air sensor setpoint shall be adjustable and shall range from 40 to  $100^{\circ}$ F /4 to  $38^{\circ}$ C. Additional sensor options shall be available as accessories.
  - o. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 100%, with a range of 0% to 100%.

- p. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy.
- q. Dampers shall be completely closed when the unit is in the unoccupied mode.
- r. Economizer controller shall accept a 2-10 Vdc CO<sub>2</sub> sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor air damper to provide ventilation based on the sensor input.
- s. Compressor lockout temperature on W7220 is adjustable from -45°F to 80°F, set at a factory default of 32°F. Others shall open at 35°F (2°C) and closes at 50°F (10°C).
- t. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
- u. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
- 2. Integrated EconoMi\$er2, and EconoMi\$er X Ultra Low Leak rate models. (Factory installed on 3 phase models only. Field installed on all 3 and 1 phase models)
  - a. Integrated, gear driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
  - b. Independent modules for vertical or horizontal return configuration shall be available. Vertical return modules shall be available as a factory installed option.
  - c. Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
  - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
  - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control
  - f. Ultra Low Leak design meets California Title 24 section 140.4 and ASHRAE90.1 requirements for 4 cfm per sq.ft. on the outside air dampers and 10 cfm per sq. ft. on the return dampers.
  - g. Economizer controller on EconoMi\$er X models shall be the Honeywell W7220 that provides:
    - (1.) 2-line LCD interface screen for setup, configuration and troubleshooting
    - (2.) On-board Fault Detection and Diagnostics (FDD) that senses and alerts when the economizer is not operating properly, per California Title 24.
    - (3.) Sensor failure loss of communication identification
    - (4.) Automatic sensor detection
    - (5.) Capabilities for use with multiple-speed indoor fan systems
    - (6.) Utilize digital sensors: Dry bulb and Enthalpy
  - h. Economizer controller on EconoMi\$er 2 models with RTU Open models shall be a 4-20mA design controlled directly by the RTU Open controller. RTU Open meets California Title 24 Fault Detection & Diagnostic (FDD) requirements.
  - i. Shall be capable of introducing up to 100% outdoor air.
  - j. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements.
  - k. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
  - l. Dry bulb outdoor air temperature sensor shall be provided as standard. Enthalpy sensor is also available on factory installed only. Outdoor air sensor setpoint shall be adjustable and shall range from 40 to  $100^{\circ}$  F / 4 to  $38^{\circ}$  C. Additional sensor options shall be available as accessories.
  - m. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 100%, with a range of 0% to 100%.
  - n. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy.
  - o. Dampers shall be completely closed when the unit is in the unoccupied mode.
  - p. Economizer controller shall accept a 2-10 Vdc CO<sub>2</sub> sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor air damper to provide ventilation based on the sensor input.
  - q. Compressor lockout temperature on W7220 is adjustable from -45° F to 80° F, set at a factory default of 32° F. Others shall open at 35°F (2°C) and closes at 50°F (10°C).
  - r. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
  - s. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
- 3. Two-Position Damper (Factory installed on 3 Phase Models Only. Field installed on all 3 and 1 Phase Models)

- a. Damper shall be a Two-Position Damper. Damper travel shall be from the full closed position to the field adjustable %-open setpoint.
- b. Damper shall include adjustable damper travel from 25% to 100% (full open).
- c. Damper shall include single or dual blade, gear driven dampers and actuator motor.
- d. Actuator shall be direct coupled to damper gear. No linkage arms or control rods shall be acceptable.
- e. Damper will admit up to 100% outdoor air for applicable rooftop units.
- f. Damper shall close upon indoor (evaporator) fan shutoff and/or loss of power.
- g. The damper actuator shall plug into the rooftop unit's wiring harness plug. No hard wiring shall be required.
- h. Outside air hood shall include aluminum water entrainment filter.

## 4. Manual damper

- a. Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 25 or 50% outdoor air for year round ventilation.
- 5. Humidi-MiZer Adaptive Dehumidification System (3 Phase Models Only):
  - a. The Humidi-MiZer Adaptive Dehumidification System shall be factory installed and shall provide greater dehumidification of the occupied space by two modes of dehumidification operations in addition to its normal design cooling mode:
    - (1.) Subcooling mode further sub cools the hot liquid refrigerant leaving the condenser coil when both temperature and humidity in the space are not satisfied.
    - (2.) Hot gas reheat mode shall mix a portion of the hot gas from the discharge of the compressor with the hot liquid refrigerant leaving the condenser coil to create a two-phase heat transfer in the system, resulting in a neutral leaving air temperature when only humidity in the space is not satisfied.
    - (3.) Includes head pressure controller.

## 6. Head Pressure Control Package

- Controller shall control coil head pressure by condenser fan speed modulation or condenser fan cycling and wind baffles.
- b. Shall consist of solid-state control and condenser coil temperature sensor to maintain condensing temperature between 90°F (32°C) and 110°F (43°C) at outdoor ambient temperatures down to -20°F (-29°C).

#### 7. Propane Conversion Kit

- a. Package shall contain all the necessary hardware and instructions to convert a standard natural gas unit for use with liquefied propane, up to 2000 ft (610m) elevation.
- b. Additional accessory kits may be required for applications above 2000 ft (610m) elevation.

## 8. Flue Shield

- a. Flue shield shall provide protection from the hot sides of the gas flue hood.
- 9. Condenser Coil Hail Guard Assembly (Factory installed on 3 Phase Models Only. Field installed on all 3 and 1 Phase Models)
  - a. Shall protect against damage from hail.
  - b. Shall be either hood style or louvered.
- 10. Unit-Mounted, Non-Fused Disconnect Switch (Available on units with MOCP's of 80 amps or less):
  - a. Switch shall be factory installed, internally mounted.
  - b. National Electric Code (NEC) and UL approved non-fused switch shall provide unit power shutoff.
  - c. Shall be accessible from outside the unit.
  - d. Shall provide local shutdown and lockout capability.

#### 11. Convenience Outlet:

- a. Powered convenience outlet. (3 Phase Models Only)
  - (1.) Outlet shall be powered from main line power to the rooftop unit.
  - (2.) Outlet shall be powered from line side or load side of disconnect by installing contractor, as required by code. If outlet is powered from load side of disconnect, unit electrical ratings shall be UL certified and rated for additional outlet amperage.
  - (3.) Outlet shall be factory installed and internally mounted with easily accessible 115-v female receptacle.
  - (4.) Outlet shall include 15 amp GFI receptacles with independent fuse protection.
  - (5.) Voltage required to operate convenience outlet shall be provided by a factory installed step-down transformer.
  - (6.) Outlet shall be accessible from outside the unit.
  - (7.) Outlet shall include a field installed "Wet in Use" cover.
- b. Non-Powered convenience outlet.

- (1.) Outlet shall be powered from a separate 115/120v power source.
- (2.) A transformer shall not be included.
- (3.) Outlet shall be factory installed and internally mounted with easily accessible 115-v female receptacle.
- (4.) Outlet shall include 15 amp GFI receptacles with independent fuse protection.
- (5.) Outlet shall be accessible from outside the unit.
- (6.) Outlet shall include a field installed "Wet in Use" cover.

### 12. Flue Discharge Deflector:

- a. Flue discharge deflector shall direct unit exhaust vertically instead of horizontally.
- b. Deflector shall be defined as a "natural draft" device by the National Fuel and Gas (NFG) code.

#### 13. Thru-the-Base Connectors:

- a. Kits shall provide connectors to permit gas and electrical connections to be brought to the unit through the unit basepan.
- b. Minimum of four connection locations per unit.

## 14. Propeller Power Exhaust:

- a. Power exhaust shall be used in conjunction with an integrated economizer.
- b. Independent modules for vertical or horizontal return configurations shall be available.
- c. Horizontal power exhaust is shall be mounted in return ductwork.
- d. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0-100% adjustable setpoint on the economizer control.

#### 15. Roof Curbs (Vertical):

- a. Full perimeter roof curb with exhaust capability providing separate air streams for energy recovery from the exhaust air without supply air contamination.
- b. Formed galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
- c. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.

## 16. High Altitude Gas Conversion Kit:

a. Package shall contain all the necessary hardware and instructions to convert a standard natural gas unit to operate from 2000-7000 ft (610 to 2134m) elevation with natural gas or from 0-7000 ft (90-2134m) elevation with liquefied propane.

### 17. Outdoor Air Enthalpy Sensor:

a. The outdoor air enthalpy sensor shall be used to provide single enthalpy control. When used in conjunction with a return air enthalpy sensor, the unit will provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.

### 18. Return Air Enthalpy Sensor:

a. The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.

## 19. Indoor Air Quality (CO<sub>2</sub>) Sensor:

- a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
- b. The IAQ sensor shall be available in duct mount, wall mount, or wall mount with LED display. The setpoint shall have adjustment capability.

## 20. Smoke detectors (factory installed only):

- a. Shall be a Four-Wire Controller and Detector.
- b. Shall be environmental compensated with differential sensing for reliable, stable, and drift-free sensitivity.
- c. Shall use magnet-activated test/reset sensor switches.
- d. Shall have tool-less connection terminal access.
- e. Shall have a recessed momentary switch for testing and resetting the detector.
- f. Controller shall include:
  - (1.) One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel.
  - (2.) Two Form-C auxiliary alarm relays for interface with rooftop unit or other equipment.
  - (3.) One Form-C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station.
  - (4.) Capable of direct connection to two individual detector modules.
  - (5.) Can be wired to up to 14 other duct smoke detectors for multiple fan shutdown applications

## 21. Winter start kit

- a. Shall contain a bypass device around the low pressure switch.
- b. Shall be required when mechanical cooling is required down to 25°F (-4°C).

c. Shall not be required to operate on an economizer when below an outdoor ambient of 40°F (4°C).

## 22. Time Guard

- a. Shall prevent compressor short-cycling by providing a 5-minute delay (±2 minutes) before restarting a compressor after shutdown for any reason.
- b. One device shall be required per compressor.

# 23. Hinged Access Panels

- a. Shall provide easy access through integrated quarter turn latches.
- b. Shall be on major panels of: filter, control box, fan motor, and compressor.