

OPTIONS:
MATERIAL: 18ga. GALV STEEL
INSULATED PANELS (WHERE REQUIRED)
1" 1-1/2LB DUCT INSULATION (R VALUE 3.85)
GASKET PROVIDED WITH CURB
1 1/2" ADDED TO EXISTING CURB O.D.



DIMENSIONED AND TOLERENCED PER ANSI Y14.5M-1982

REVISIONS				
REV.	ECO#	DESCRIPTION	DATE	APPROVED
3		UPDATED BRACES	12/2/11	OO



Attn: \_\_\_\_\_

Tag: \_\_\_\_\_

Approval: \_\_\_\_\_

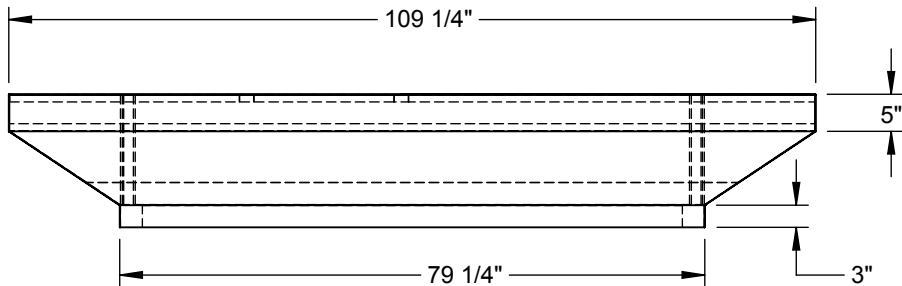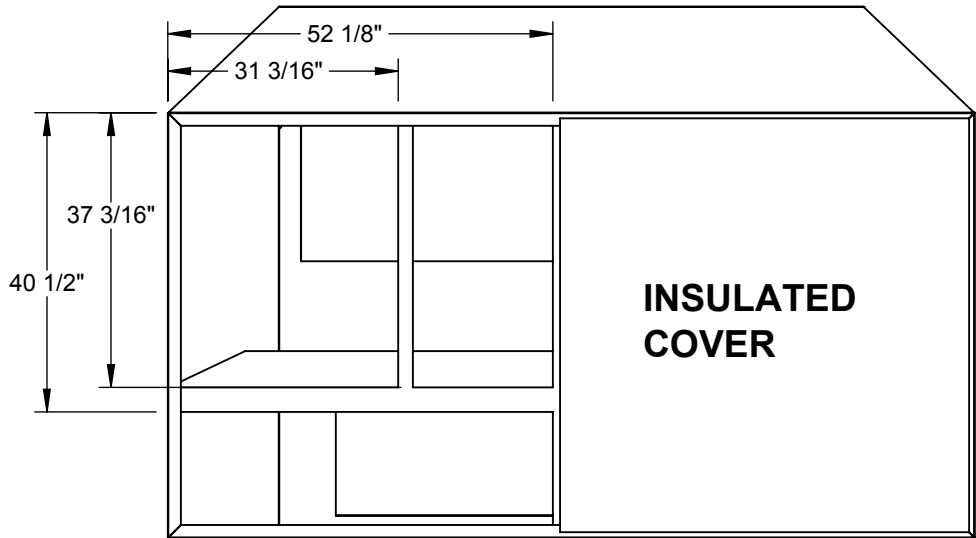

EXISTING CURB LAYOUT

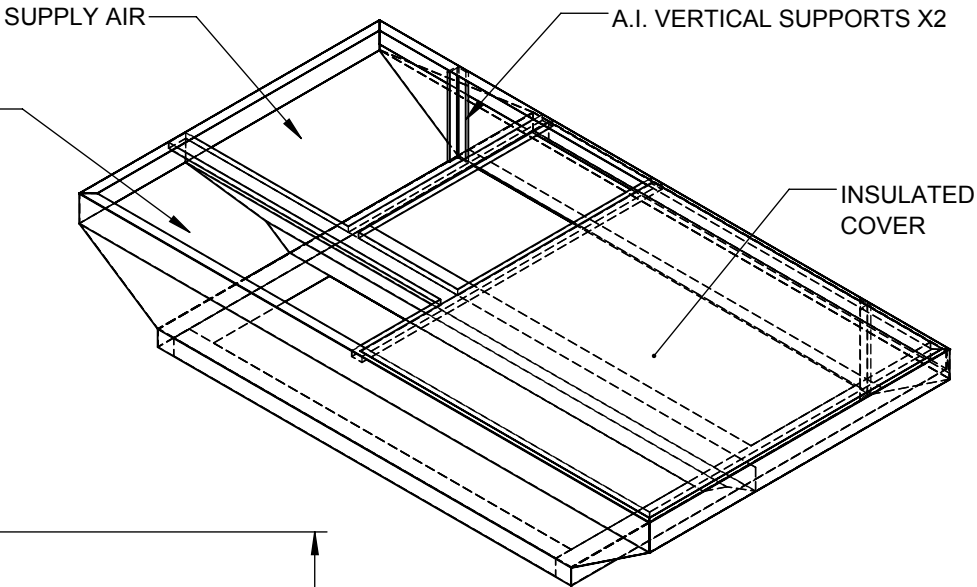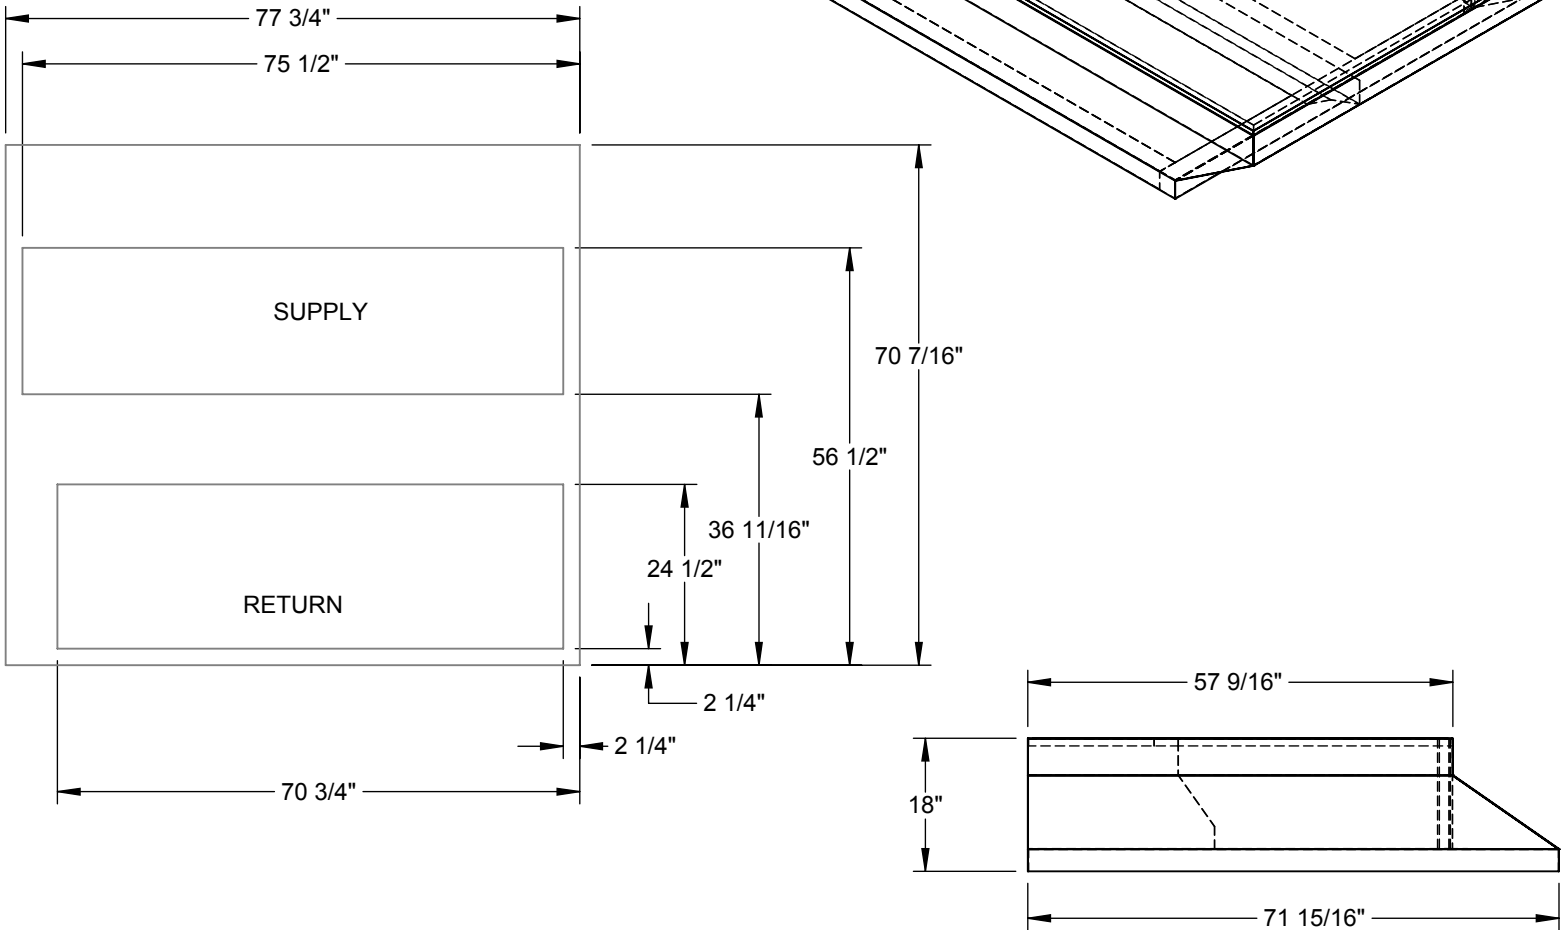

CDI Model Number	Existing Unit	New Unit	Tonnage	Supply Pressure Drop	Return Pressure Drop
1-4010-4008	4010	4008	15	0.236	0.391

CURB SHOWN IS CDI STANDARD CONFIGURATION CDI RESERVES THE RIGHT TO CHANGE LAYOUT WITHOUT NOTIFICATION. IF CURB IS NEEDED IN A DIFFERENT CONFIGURATION CDI MUST BE NOTIFIED PRIOR TO PLACING AN ORDER.

OPERATIONAL HEIGHT OF CDI ADAPTER IS 3" LESS THAN OVERALL CURB HEIGHT SHOWN.

THIS DRAWING & THE INFORMATION CONTAINED THEREIN IS THE CONFIDENTIAL, PROPRIETARY INFORMATION OF CRYSTAL DISTRIBUTION INC., & MAY NOT BE USED OR REPRODUCED WITHOUT THE APPROVAL OF CRYSTAL DISTRIBUTION, INC. ALL RIGHTS RESERVED		APPROVALS	DATE	TITLE/FILE NAME: <b>1-4010-4008</b>		
		DRAWN: spickar	3/20/2018			
		CHECKED:		DIMENSIONS ARE AS FOLLOWS: 1.00 in [25.40 mm]		
*VERIFY EXISTING CURB OD *VERIFY SUPPLY AND RETURN OPENINGS *NOTE ANY CHANGES *CALL WITH ANY QUESTIONS *FAX BACK IF DRAWING IS OK AS IS		3RD ANGLE PROJECTION	 Contact us @ www.cdicurbs.com or 1-888-234-7001		APPROXIMATE CURB WEIGHT (LBS.) <b>250.82</b>	ECO #:
					SCALE: 1:26	SHEET: 1 OF 3
					REV: <b>3</b>	