



Turn to the experts

2023 SPLIT SYSTEM COMPLIANCE FOR EXISTING INVENTORY

NEW DOE MINIMUM EFFICIENCY REQUIREMENTS

Beginning January 1, 2023, the DOE is increasing the minimum efficiencies for central air conditioners and heat pumps.

- For air conditioners in the North, the minimum efficiency will increase from 13.0 to 14.0 SEER under today's M test procedure
- For air conditioners in the South, the minimum efficiency will increase from 14.0 to 15.0 SEER under today's M test procedure
- The national heat pump minimum efficiency will increase from 14.0 to 15.0 SEER under today's M test procedure

COMPLIANCE FOR EXISTING SPLIT SYSTEM AC INVENTORY

Split system AC equipment manufactured prior to December 31, 2022, **can be installed** in the South or Southwest Regions after January 1, 2023, if the units meet the following requirements:

- 1 If the model is discontinued by Carrier, existing inventory can be sold if the least efficient coil-only SEER rating, as listed on the EnergyGuide label, is greater than the following:

< 45,000 Btu	≥ 45,000 Btu
15.0 SEER	14.5 SEER
If the EnergyGuide label includes a range for the least efficient SEER rating, the lower SEER rating should be used	
SEER ratings sourced from Federal Register Vol. 82, No. 4, page 1615	

- 2 If the model will continue to be sold by Carrier after January 1, 2023, existing inventory can be sold if its EnergyGuide label shows a least efficient SEER rating that meets the requirements in the table above and the active published SEER2 rating exceeds 14.3.


Note: Carrier is updating EnergyGuide labels on these products before the compliance date to minimize the amount of inventory that carries over into 2023 with Appendix M EnergyGuide labels.

- 3 In the Southwest region, the equipment must also meet the following EER requirements:

> 15.0 but < 16.0 SEER		≥ 16.0 SEER
< 45,000 Btu 12.2 EER	≥ 45,000 Btu 11.7 EER	10.2 EER

CAN I INSTALL AN AIR CONDITIONER THAT WAS MANUFACTURED BEFORE 2023 AFTER THE JANUARY 1, 2023, DEADLINE?

The chart below will help you get your answer depending on the region where your business is located. Check the EnergyGuide labels on your current air conditioner inventory against this chart and be sure to look for the lowest coil-only SEER rating on the label.

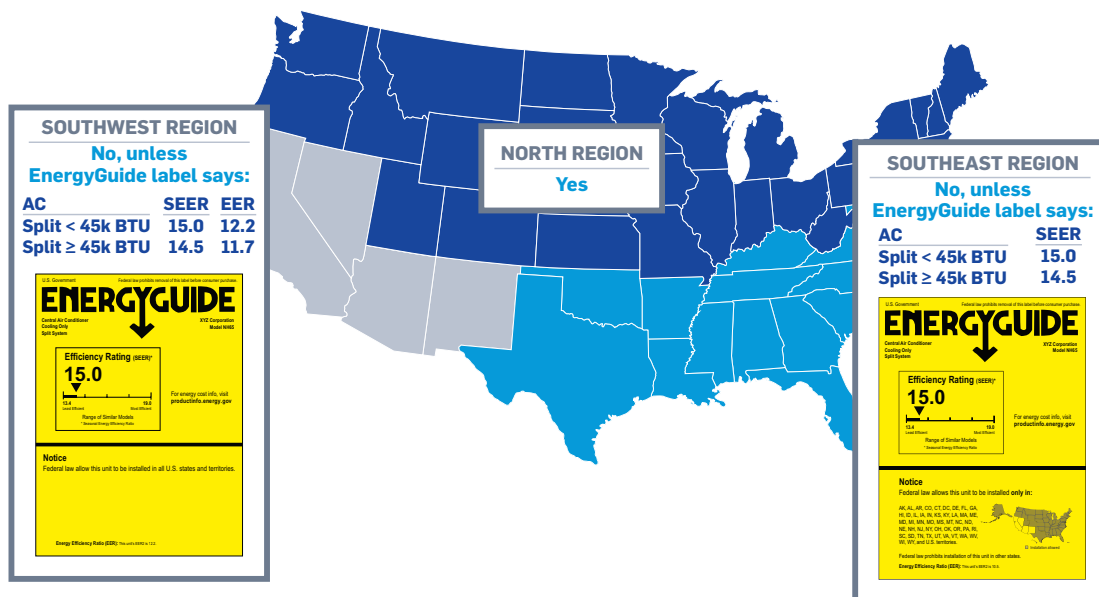

EXISTING MODEL SELL THROUGH ELIGIBILITY IN THE SOUTH

		Pre-2023 Model	Installation After January 1, 2023		
		Carrier	Southeast	Southwest	North
Deluxe		24VNA6	Yes*	Yes*	Yes
		24VNA9**	Yes*	Yes*	Yes
		24ANB1	No	No	Yes
		24ANB7	No	No	Yes
		24ANB6	No	No	Yes
Mid		24ACB7	No	No	Yes
		24APB6	No	No	Yes
		24ACC6	No	No	Yes
		24ACB3	No	No	Yes
Entry		24AHA4	No	No	Yes
		24ABC6	No	No	Yes
		24AAA5	No	No	Yes
		24AC(A/C)4	No	No	Yes
		24ABB3	No	No	Yes

* Note: Carrier is updating EnergyGuide labels on these products before the compliance date to minimize the amount of inventory that carries into 2023 with Appendix M EnergyGuide labels.

** Odd sizes qualify for the SW; Even sizes qualify for the SE and N.

We are **#2023READY** and we want you to be too.

Visit HVACpartners.com or contact your Carrier sales representative for more information.