

160 SW 12TH AVE SUITE 106, DEERFIELD BEACH, FL 33442
(954) 354-0660 | ENGINEERINGEXPRESS.COM

THIS DOCUMENT CONTAINS (4) PAGES: THE FIRST PAGE MUST BEAR AN ORIGINAL SIGNATURE & SEAL OF THE CERTIFYING PE TO BE VALID FOR USE
(Issued September 28, 2017 Subject to Renew January 1, 2019)
(or next code cycle change)

EVALUATION SUBJECT: BRYANT SPLIT UNITS

TER-16-3190.6

REPORT HOLDER:

BRYANT HEATING AND COOLING
2000 PARKS OAKS AVE
ORLANDO, FL 33428 USA
(954) 247-2003 | FL. WWW.BRYANT.COM



SCOPE OF EVALUATION (compliance with the following codes):

THIS IS A STRUCTURAL (WIND) PERFORMANCE EVALUATION ONLY. NO ELECTRICAL OR TEMPERATURE PERFORMANCE RATINGS OR CERTIFICATIONS ARE OFFERED OR IMPLIED HEREIN.

This Product Evaluation Report is being issued in accordance with the requirements of the Florida Building Code Fifth Edition (2014) with 2016 supplements per FBC Section 104.11, FMC 301.15, FBC Building Ch. 16, ASCE-7-10, FBC Existing Building sections 701.1, 706.6.1, FBC Building 1522.2, and FBC Residential M1202.1, M1301.1, FS 471.025, including Broward County Administrative Provisions 107.3.4. The product noted on this report has been tested and/or evaluated as summarized herein. **IN ACCORDANCE WITH THESE CODES EACH OF THESE REPORTS MUST BEAR THE ORIGINAL SIGNATURE & RAISED SEAL OF THE EVALUATING ENGINEER.**

SUBSTANTIATING DATA:

• **Product Evaluation Documents**

Substantiating documentation has been submitted to support this TER and is summarized in the sections that follow.

• **Structural Engineering Calculations**

Structural engineering calculations have been prepared which evaluate the product based on comparative and/or rational analysis to qualify the following design criteria:

- Maximum allowable unit panel wind pressure connection integrity
- Maximum allowable uplift, sliding, & overturning moment for ground and roof applications

Calculation summary for this TER is provided in the forces summary table. No 33% increase in allowable stress has been used in the design of this product. Microsoft Excel was used to carry out the calculations present in this report.

INSTALLATION:

The product(s) listed in this report shall be installed in strict compliance with this TER & manufacturer-provided model specifications. The product components shall be of the material specified in the manufacturer-provided product specifications. All screws must be installed in accordance with the applicable provisions & anchor manufacturer's published installation instructions.

LIMITATIONS & CONDITIONS OF USE:

Use of this product shall be in strict accordance with this TER as noted herein. See final page for complete limitations and conditions of use.

OPTIONS:

This evaluation is valid for all BRYANT models present in the table located on the final page.

FINISH:

Baked enamel.

NOTE: GRAPHICAL DEPICTIONS IN THIS REPORT ARE FOR ILLUSTRATIVE PURPOSES ONLY. ACTUAL UNITS MAY DIFFER SLIGHTLY IN APPEARANCE.

UNIT CASING MATERIAL:

1.14mm galvanized sheet steel ASTM A653 EDDS cold rolled steel for removable top panel. 1.14mm galvanized sheet steel ASTM A653 EDDS cold rolled steel for base pan. 0.86mm galvanized steel sheet ASTM A653 for side protector panels, secured with #10-16 sheet metal screws into top and base pan.

INSTALLATION:

Shall follow manufacturer specifications as well as the information provided herein.

STRUCTURAL PERFORMANCE:

Models referenced herein are subject to the following design limitations: ASCE7-10 Exposure Category C, Risk II

Up to and including 175mph (Vult) for up to 200' MRH**. HVHZ**

Up to and including 170mph (Vult) for up to 250' MRH**. HVHZ**

Up to and including 200mph (Vult) for up to 200' MRH**. Non-HVHZ**

Ground or Roof Application per installation instructions

Mean Roof Height *High Velocity Hurricane Zone

Maximum Rated Wind Pressure:

193psf Lateral, 93psf Uplift (less Dead Load)

Site specific wind analysis may produce alternate limitations provided maximum rated wind pressure is not exceeded.


ORIGINAL SIGNATURE AND RAISED SEAL
REQUIRED TO BE VALID PER CODE:

September 28, 2017
Frank L. Bennardo, P.E., SECB
ENGINEERING EXPRESS®
PE #0046549 CA #9885

Copyright © 2017 Engineering Express® / Frank L. Bennardo PE, Inc. All Rights Reserved

The FBC 14 defines APPROVED SOURCE (Section 202) as: "An independent person, firm or corporation, approved by the building official, who is competent and experienced in the application of engineering principles to materials, methods or systems analyses." Engineering Express® professionals meet the competency requirements as defined in the FBC and can seal their work. Engineering Express® is regularly engaged in conducting and providing engineering evaluations of single-element and full-scale building systems.

SECTION 2 PRODUCT INSTALLATION

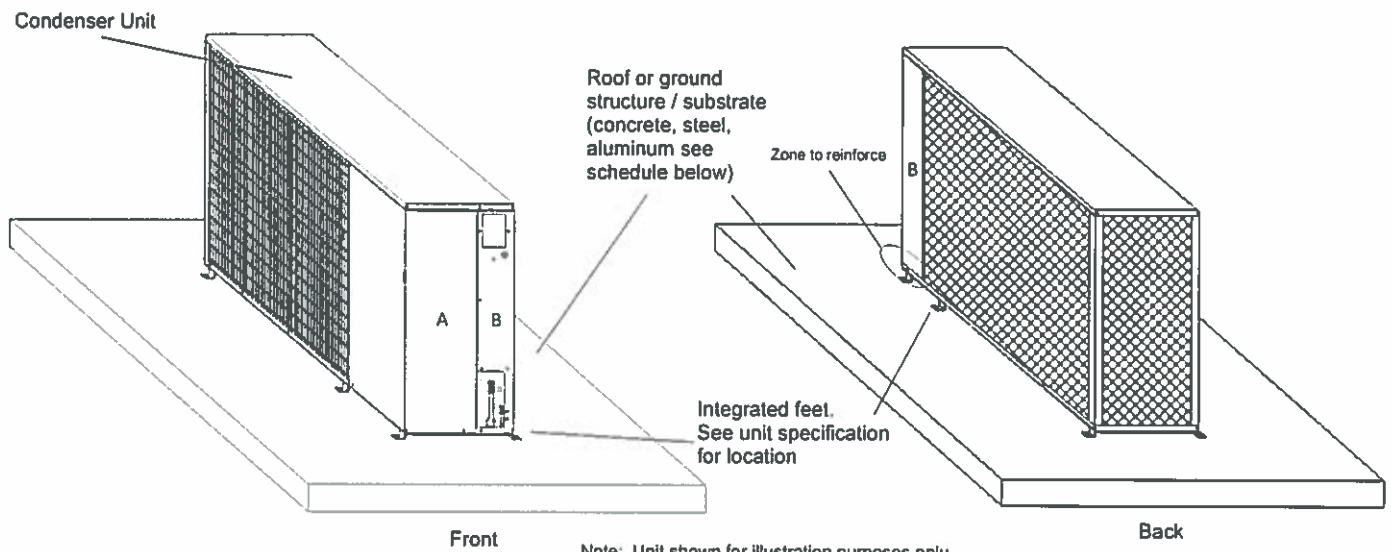

TIE-DOWN STRAP SCHEDULE

Ground or Roof Height*	Tie-down Strap on unit
Ground	NA
Up to 200' (250')	4

* The value shown in parentheses indicates the allowable roof height in 170mph conditions. i.e. 60' (80') indicates an allowable roof height of 60' for 175mph or 80' for 170mph Vult.

Note:

1. Straps shall be wrapped as shown in details on section 4. The straps shall be tightened to a snug fit around the unit. Straps shall be 1" width and 22ga galvanized metal. For Non-HVHZ, use (4) metal straps, up to 200' MRH. Values shown in table are minimum specified. Using stronger straps per each height is allowed at installer's discretion.
2. For ground mount use integrated feet.

Tie-down Strap: (for roof applications)

- Minimum edge distance 3" from the unit corners.
- Use a minimum of (2) tie-down straps per side, straps shall be overlaid.

ANCHOR TO HOST STRUCTURE SCHEDULE

Ground or Roof Height*	Anchor Type		
	Concrete 3,000 Psi	1/8" Min A36 Steel	1/8" Min 6061-T6 Aluminum
Ground	A	NA	NA
Up to 200' (250')	NA	B	B

Anchor Types to Host Structure:

A. - 3/8" Power Fastener Wedge-Bolt OT Anchor embedded 1 1/2" in 3,000 psi concrete. 6" from edge minimum. 6" spacing minimum.

B. - 3/8" UNC SAE Grade 5 bolt min. 1/2" from edges with nut and washer OD 1"

NA. - No anchors apply.

IN ALL CONDITIONS IT IS THE RESPONSIBILITY OF THE PERMIT HOLDER TO ENSURE THE HOST STRUCTURE IS CAPABLE OF WITHSTANDING THE RATED GRAVITY, LATERAL, AND UPLIFT FORCES BY SITE-SPECIFIC DESIGN. NO WARRANTY OF ANY KIND, EXPRESSED OR IMPLIED, IS OFFERED BY ENGINEERING EXPRESS AS TO THE INTEGRITY OF THE HOST STRUCTURE TO CARRY DESIGN FORCE LOADS INCURRED BY THIS UNIT.

ENGINEERING EXPRESS® 160 SW 12TH AVE. SUITE 106 DEERFIELD BEACH, FL 33442

(954) 354-0660 ENGINEERINGEXPRESS.COM

Page 2 of 4

Copyright © 2017 Engineering Express® / Frank L. Bennardo PE, Inc. All Rights Reserved

SECTION 3 SUPPORTING CALCULATIONS & SUMMARY

FORCES SUMMARY

Ground or Roof Height*	Lateral Pressure (Psf)	Uplift Pressure (Psf)	Max Large Side Force (lbs)	Max Large Side Overturn (lbs-in)	Max Large Side Tension (lbs)	Max Short Side Force (lbs)	Max Short Side Overturn (lbs-in)	Max Short Side Tension (lbs)	Max Uplift Force (lbs)
Ground	43.2	0	575.7	12413.9	727.6	220.7	4759.8	107.0	0.0
200' (250')	193.0	93.4	2572.1	55460.4	3250.4	986.2	21265.0	477.9	492.4


Calculations performed according to the information provided by the client. Cabinets were assumed solid (0% porosity) for shear and tension calculation purposes. These forces correspond to the dimension of the biggest unit in this group.

PANEL INTEGRITY SUMMARY

Ground or Roof Height*	Panel Name	Rqrd Wind Pressure (lb/ft²)	Force on Panel (lbs)	Add'l Screw Qty Needed (pcs)	Additional screws required beyond original manufactured cabinet
Ground	TOP PANEL	0.0	0.0	0	Yes
	PANEL A	43.2	219.5	0	
	PANEL B	43.2	138.4	2	
up to 200' (up to 250')	TOP PANEL	93.4	492.5	0	Yes
	PANEL A	193.0	618.8	0	
	PANEL B	193.0	339.6	2	


*The value shown in parentheses indicates the allowable roof height in 170mph conditions. i.e. 60' (80') indicates an allowable roof height of 60' for 175mph or 80' for 170mph Vult.

SECTION 4 DETAILS

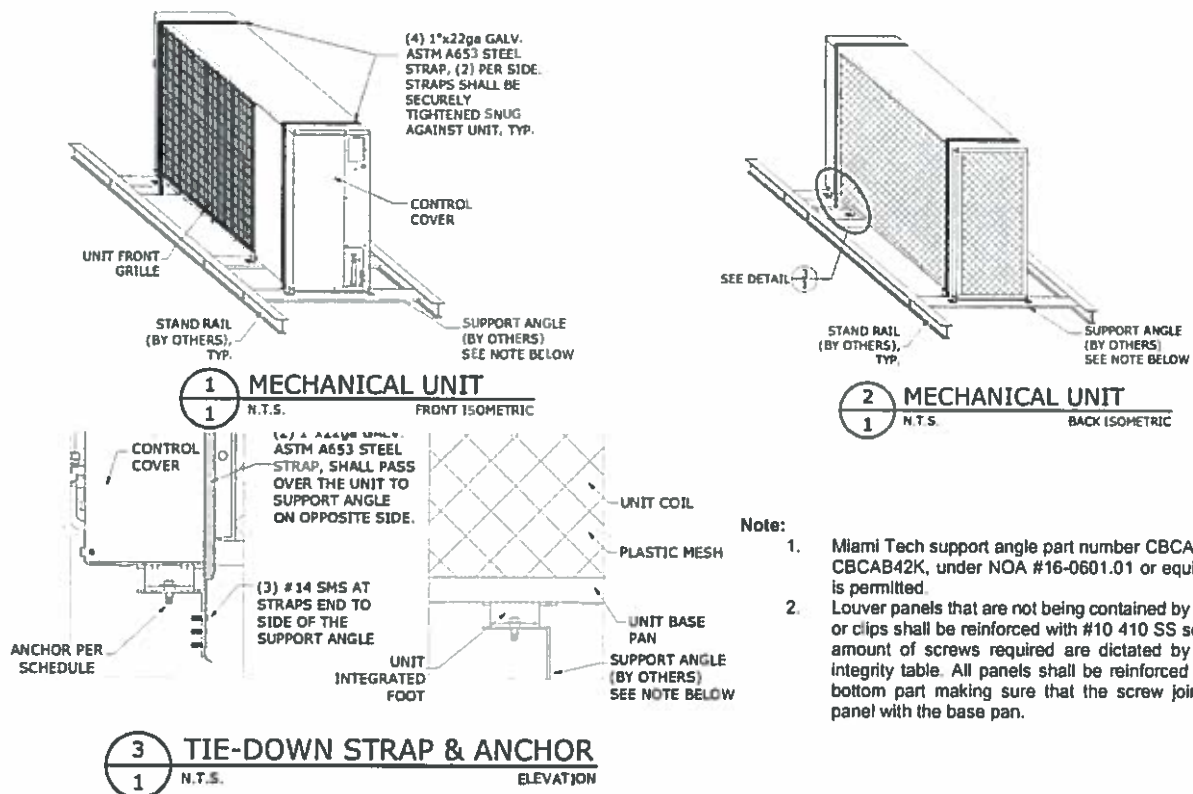

CABINETS & DIMENSIONS

Family	Unit Model	Width (in)	Depth (in)	Height (in)
224A	224A**018	36.94	14.56	25.13
	224A**024	36.94	14.56	31.13
	224A**030	44.50	17.06	37.13
	224A**036	44.50	17.06	37.13
	224A**048	44.50	17.06	43.13
	224A**060	44.50	17.06	43.13
124A	124A**018	36.94	14.56	31.13
	124A**024	36.94	14.56	31.13
	124A**030	44.50	17.06	37.13
	124A**036	44.50	17.06	37.13
	124A**048	44.50	17.06	37.13
	124A**060	44.50	17.06	43.13

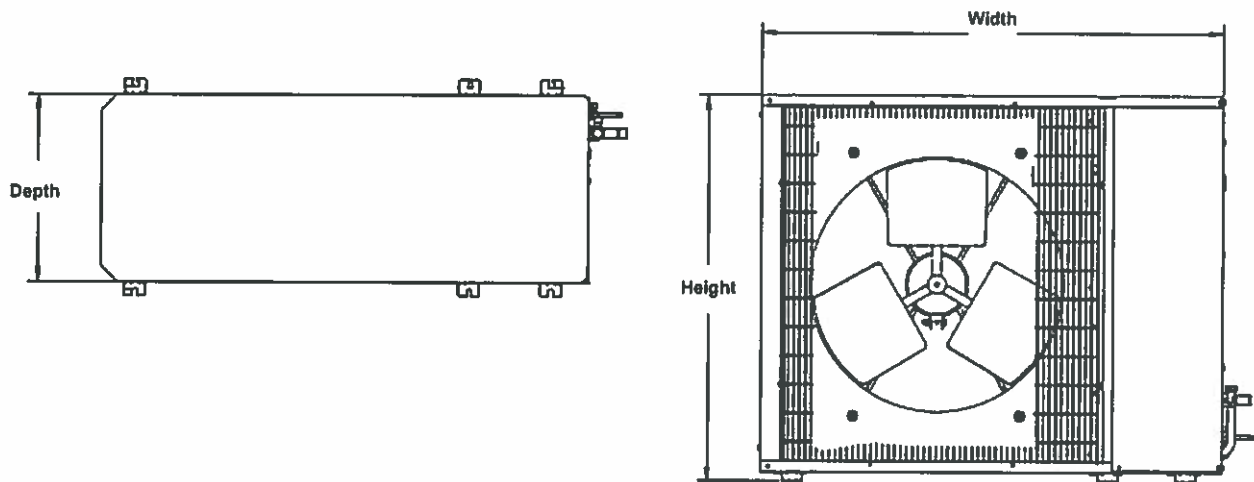

Note: Image is not to scale and is for illustration purposes only.
Actual units may differ slightly in appearance.

LIMITATIONS & CONDITIONS OF USE:

Use of this product shall be in strict accordance with this TER as noted herein.

The supporting host structure shall be designed to resist all superimposed loads as determined by others on a site specific basis as may be required by the Authority Having Jurisdiction. Host structure conditions which are not accounted for in this product's respective anchor schedule shall be designed on a site-specific basis by a registered professional engineer. No evaluation is offered for the host supporting structure by use of this document; Adjustment factors noted herein and the applicable codes must be considered, where applicable. All supporting components which are permanently installed shall be protected against corrosion, contamination, and other such damage at all times. Fasteners must penetrate the supporting members such that the full length of the threaded portion is embedded within the main member. All anchors, screws, straps, clips, and attachment part can be substituted for equivalent parts, as long as the capacities of the equivalent parts are equal or stronger. This evaluation does not offer any evaluation to meet large missile impact debris requirements which typically are not required for this type of product.

All of the wind resisting exterior panels, individually meet or exceed their capacity to resist the design wind loads as stated in the calculations as required by the Florida Building Code Fifth Edition (2014). Due to the indeterminate nature of these units, distortion and deflection cannot be accurately evaluated, but with diaphragm action of external components and internal stiffeners, the base unit has the capacity to withstand these forces with individual external parts being contained. Yearly inspections, during equipment maintenance or after a named storm, all screws, cabinet components, clips, anchor, bolts, straps and cables are to be verified by the A/C contractor. All damaged cabinet components, loose, corroded, broken screws or anchor bolts shall be replaced to ensure structural integrity for hurricane wind forces.

ENGINEERING EXPRESS® 160 SW 12TH AVE. SUITE 106 DEERFIELD BEACH, FL 33442

(954) 354-0660 ENGINEERINGEXPRESS.COM

Page 4 of 4

Copyright © 2017 Engineering Express® /
Frank L. Bennardo PE, Inc. All Rights Reserved