



**Curb Mounting**


Part Number BRK-CRBHOLD-01: Z-Bracket Kit (Curb)  
 One Kit Contains:  
 Qty. 4 - Z-Brackets  
 Qty. 16 - 1/4" x 6" TEK Screws  
 Qty. 8 - 1/4" x 1" TEK Screws  
 Qty. 1 - Instructions  
 Two Kits Required per Unit

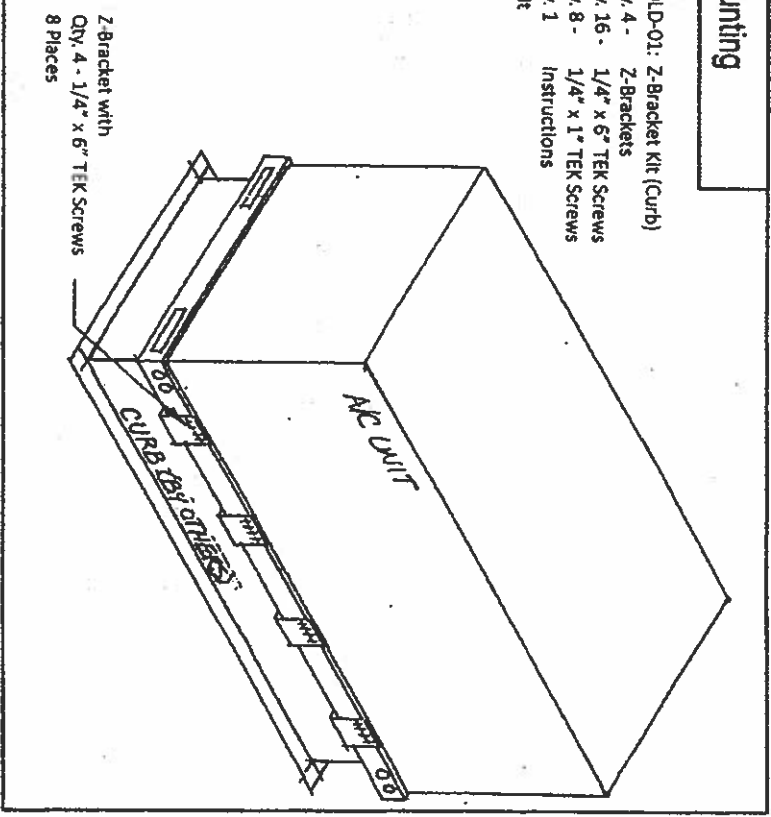


Z-Bracket with  
 Qty. 4 - 1/4" x 6" TEK Screws  
 8 Places

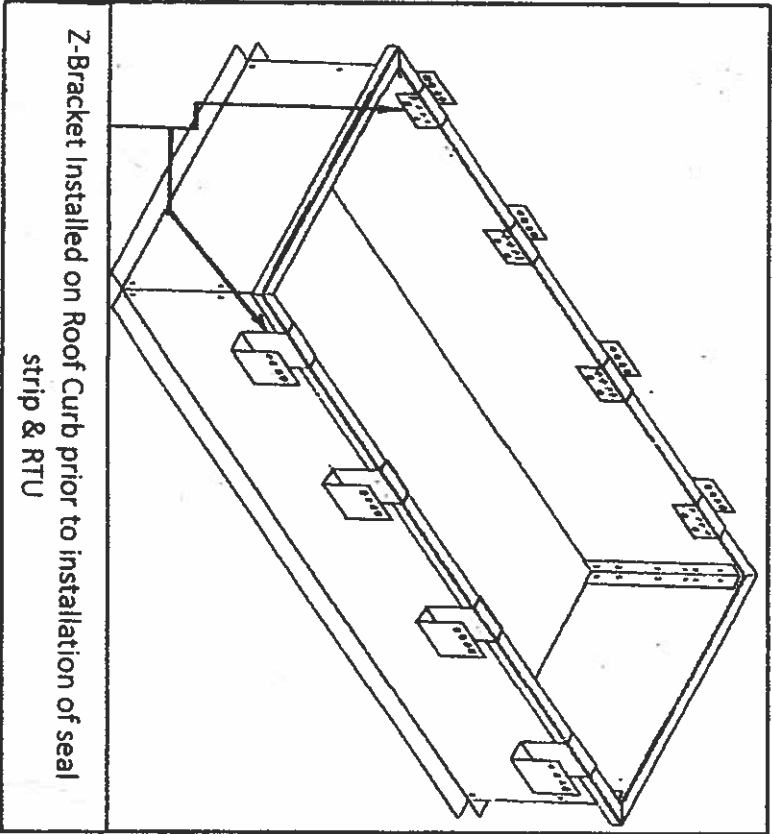

Z-Bracket Installed on Roof Curb prior to installation of seal strip & RTU

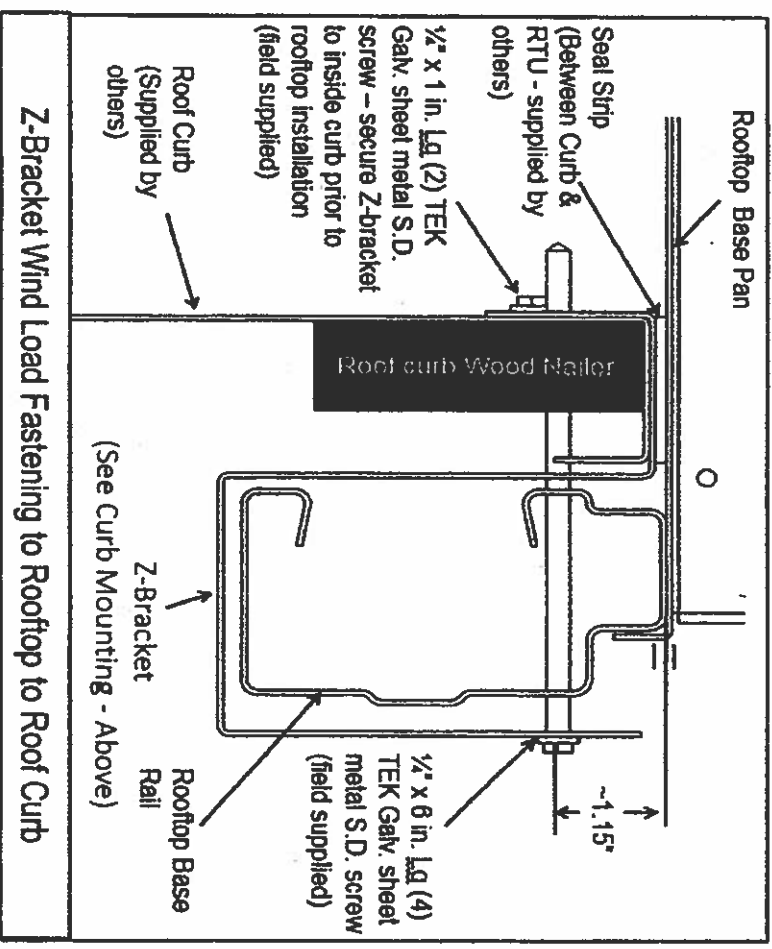

Z-Bracket Wind Load Fastening to Rooftop to Roof Curb

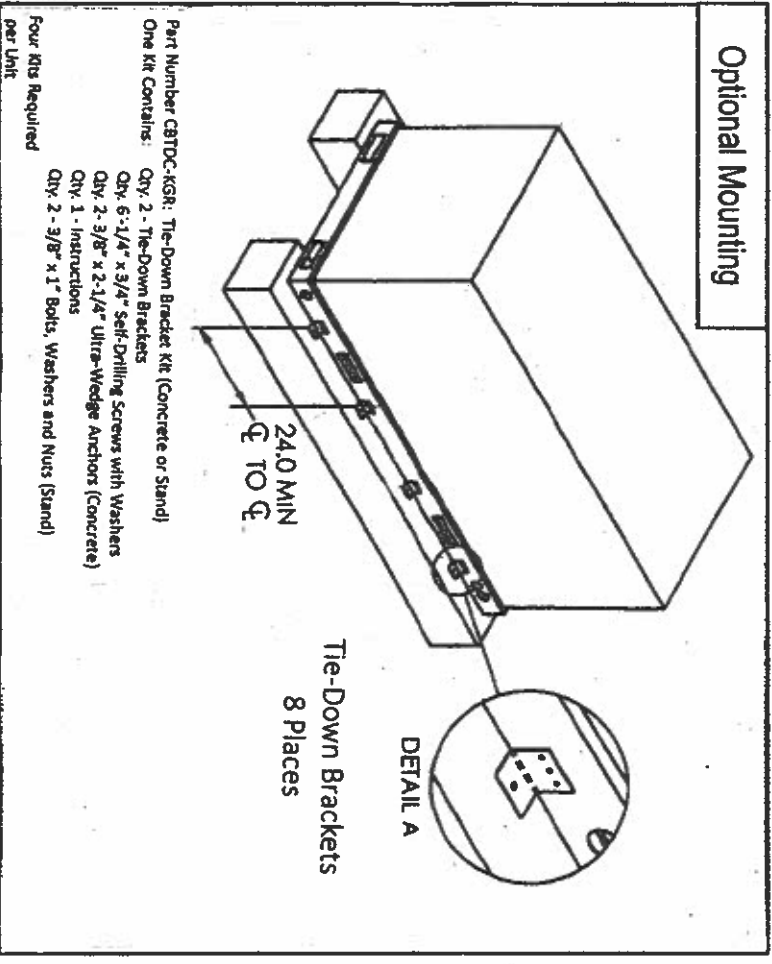

**Optional Mounting**

Part Number GATDC-KSR: Tie-Down Bracket Kit (Concrete or Stand)  
 One Kit Contains:  
 Qty. 2 - Tie-Down Brackets  
 Qty. 6 - 1/4" x 3/4" Self-Drilling Screws with Washers  
 Qty. 2 - 3/8" x 2-1/4" Ultra-Wedge Anchors (Concrete)  
 Qty. 1 - Instructions  
 Qty. 2 - 3/8" x 1" Bolts, Washers and Nuts (Stand)  
 Four Kits Required per Unit

Tie-Down Brackets  
 8 Places

**BRYANT Chassis 5:**  
 Models: 580J/588J size 16, 548J size 14, 581J/551J size 14, and 549J size 12  
 Each package unit air conditioner listed above conforms to the Florida Building Code 7<sup>th</sup> Edition (2020) requirements for installation including High Velocity Hurricane Zone (HVHZ), Risk Category III (V = 186 MPH), exposure category "D", and installation height up to and including 65 feet above grade. Worst case is -08 (chassis 5) 115-7/8" x 63-3/8" x 57-3/8" tall.

**ALLOWABLE DESIGN PRESSURES FOR THE UNIT ITSELF:**  
 Design Lateral Pressure = 197.2 lb/ft<sup>2</sup>  
 Design Uplift Pressure = 95.4 lb/ft<sup>2</sup>  
 Unit itself will withstand wind loads imposed by 197.2 PSF lateral and 95.4 PSF uplift design pressures provided the 16 gage galvanized base rails are properly fastened to a suitable slab, curb, curb adapter, or other suitable mounting arrangement and all factory supplied assembly fasteners are in place.

**John Buerosse, P.E., P.A.**  
 Structural and Mechanical Engineering  
 750 E. Sample Road, Bldg. 3 #220  
 Pompano Beach, FL 33064  
 Tel: 954-633-4692 Fax: 954-784-004

<b>S1</b>	Job No. Chassis 5	Job No.: Bryant Rooftop Units
	Date: 01/11/21	Title: Model List and Details
	Created by: J. Buerosse	

**Rational Analysis: Worst case is - 16 (Chassis 5) 115-7/8" x 63-3/8" x 57-3/8" tall.**

Design Pressures complying to FBC Building 1620.6 (HVHZ):  
 V = 186 mph (Risk Cat. III), For Exp. Cat. "D" and Z = 65 ft,  $K_z = 1.33$ ,  $K_d = 1.0$ ,  $K_e = 0.90$   
 $q_z = .00256K_z K_d K_e V^2 = 106.01 \text{ lb/ft}^2$   
 Using 1620.6,  
 Lateral Wind Pressure =  $W_L = q_z(3.1) = 328.64 \text{ lb/ft}^2$   
 Uplift Wind Pressure =  $U_L = q_z(1.5) = 159.02 \text{ lb/ft}^2$   
 Factoring in the required Load Combination factor (0.6):

Design Lateral Pressure =  $W_L(0.6) = 197.18 \text{ lb/ft}^2$   
 Design Uplift Pressure =  $U_L(0.6) = 95.41 \text{ lb/ft}^2$

Since positive pressure acts toward the surface being considered and negative pressure acts away, only the uplift pressure will remove a panel from the machine. The design lateral pressure which is considered to act toward the windward surface is recognized to be a combination of the pressures acting on the windward and leeward surfaces. Wall pressure coefficients from ASCE7-16, Chapter 27, Figure 27.3-1 may be used to distribute the Design Lateral Pressure into positive and negative components acting on the windward and leeward surfaces, respectively.

L/B =  $63.375/115.875 = 0.55$  for wind on long (115-7/8") side  
 L/B =  $115.875/63.375 = 1.83$  for wind on short (63-3/8") side

Worst case positive pressure coefficient is 0.8 for windward wall which has a corresponding negative pressure coefficient of 0.5 on the leeward wall. The worst case negative pressure coefficient is 0.7 for the sidewall (side parallel to wind). Since the windward and leeward wall pressures act in the same direction, the distributed pressures are computed as follows:

Lateral Positive Design Pressure =  $197.18(0.8)/(0.8+0.5) = 121.34 \text{ lb/ft}^2$  (Worst Case Positive)  
 Lateral Negative Design Pressure =  $197.18(0.5)/(0.8+0.5) = 75.84 \text{ lb/ft}^2$   
 Sidewall Negative Design Pressure =  $197.18(0.7)/(0.8+0.5) = 106.17 \text{ lb/ft}^2$  (Worst Case Negative)

22, 20, and 18 ga. panels and columns are fastened together and to 16 ga. base rails using #10 serrated washer head self tapping screws having 0.425" head diameter, 0.19" nominal diameter, and 0.14 minor diameter. These screws are expected to exhibit the following properties based upon ICC-ES Report ESR-2196:

- |  |  |
|--|--|
| Pullout Strength in 22 ga. = 306 lbs (ultimate)  | Pullout Strength in 20 ga. = 351 lbs (ultimate)  |
| Pullover Strength of 22 ga. = 828 lbs (ultimate) | Pullover Strength of 20 ga. = 993 lbs (ultimate) |
| Shear Strength in 22 ga. = 684 lbs (ultimate)    | Shear Strength in 20 ga. = 684 lbs (ultimate)    |
| Pullout Strength in 18 ga. = 450 lbs (ultimate)  |  |
| Shear Strength in 16 ga. = 927 lbs (ultimate)    |  |

**For Top Panel Assembly (SOTM500066 and SOTM500065 joined using SOTM500359 and 12 screws):**  
 114.35" x 61.61" draw formed 20 ga. assembly anchored at edges and through top to 16 ga. center panel and 18 ga. control box. Worst case portion is over air handler section since condenser section has three large holes in the top causing internal and external pressure to be equal. For portion tributary to air handling section:

A =  $61.61(55.41)/12(12) = 23.70 \text{ ft}^2$   
 Load =  $23.70(95.41) = 2261.9 \text{ lbs}$   
 For outside edge (9 screws, all in shear through 20 ga. top panel into 22 ga. indoor panel and corner posts), Screw Load =  $2261.9/2(9) = 125.7 \text{ lbs}$   
 Safety Factor =  $684/125.7 = 5.4 \text{ OK}$

For inside edge (8 screws in tension through 20 ga. top panel into 16 ga. center panel and 4 screws in shear through top panel into 22 ga. center posts),  
 Screw Load =  $2261.9/2(12) = 94.2 \text{ lbs}$   
 Safety Factor =  $684/94.2 = 7.3 \text{ OK}$

**For Inside Panel (SOTM500063):**  
 61.5" x 53.42" draw formed 22 ga. panel anchored at edges with 7 screws through top panel into face at top, 6 screws each vertical edge through flange perpendicular to face, and 6 screws at 7/16 inch above bottom edge through panel into base rail, and 5 screws between supply and return openings into diffuser (SOTM500058) fastened to condensing coil.

A =  $61.5(53.42)/12(12) = 22.81 \text{ ft}^2$   
 Load =  $22.81(106.17) = 2422.2 \text{ lbs}$   
 Screw Load =  $2422.2/2(6+6) = 100.93 \text{ lbs}$   
 Safety Factor =  $450/100.93 = 4.5 \text{ OK}$

**For Access Panels (SOTM500062):**  
 53.30" x 25.61" draw formed 22 ga. panel anchored with 3 screws through face each vertical side, 2 screws through face at bottom edge into 16 ga. base rail, and top edge fits inside top panel (trapped).

A =  $53.30(25.61)/12(12) = 9.48 \text{ ft}^2$   
 Load =  $9.48(106.17) = 1006.4 \text{ lbs}$   
 Screw Load =  $1006.4/2(2+3) = 100.64 \text{ lbs}$   
 Safety Factor =  $306/100.64 = 3.0 \text{ OK for Components and Cladding}$

**For Access Panel Assembly (SOTM500086 and SOTM500061):**  
 53.0" x 53.30" assembly of draw formed 20 ga. panels anchored with 3 screws through face each vertical side, 5 screws through face at bottom edge into 16 ga. base rail, and top edge fits inside top panel (trapped).

A =  $53.0(53.30)/12(12) = 19.62 \text{ ft}^2$   
 Load =  $19.62(106.17) = 2082.8 \text{ lbs}$   
 Screw Load =  $2082.8/2(5+3) = 130.17 \text{ lbs}$   
 Safety Factor =  $306/130.17 = 2.4 \text{ OK for Components and Cladding}$

Remaining panels are trivial cases of the above due to greater fastener quantity or having openings that limit negative pressure effects.

**For connection of upper frame and panels to base rails:**  
 16 screws each long side fasten frame posts and 22 ga. (min) panels to the long 16 ga. base rails. 6 screws fasten inside panel to short base rail at air handler end. Opposite end is louvered and has a large opening in the top and mesh over cooling coils.

Lateral Wind Area =  $A_L = 114.35(53.625)/12(12) = 42.58 \text{ ft}^2$   
 Lateral Design Load =  $42.58(197.18) = 8296.6 \text{ lbs}$   
 Overturning Moment =  $8396.6(53.625)/2 = 225134 \text{ in-lb}$

Uplift Wind Area =  $A_U = 114.35(61.61)/12(12) = 48.92 \text{ ft}^2$   
 Uplift Design Load =  $48.92(95.41) = 4667.9 \text{ lbs}$   
 Uplift Moment =  $4667.9(61.61)/2 = 143794 \text{ in-lb}$

Screw Load =  $(225134 + 143794)/16(61.61) = 374.3 \text{ lbs (shear)}$   
 Safety Factor =  $927/374.3 = 2.5 \text{ OK for Components and Cladding}$

Unit itself will withstand wind loads imposed by 197.18 psf lateral and 95.41 psf uplift design pressures provided the 16 gage galvanized base rails are properly fastened to a suitable slab, stand, curb, curb adapter, or other suitable mounting arrangement and all factory supplied assembly fasteners are in place.

**For connection of unit base rails to properly designed curb, metal stand, or structural concrete (by others):**

Lateral Wind Area =  $A_L = 115.875(57.375)/12(12) = 46.17 \text{ ft}^2$   
 Lateral Design Load =  $346.17(197.18) = 9103.6 \text{ lbs}$   
 Overturning Moment =  $9103.6(57.375)/2 = 261159 \text{ in-lb}$   
 Uplift Wind Area =  $A_U = 115.875(63.375)/12(12) = 51.00 \text{ ft}^2$   
 Uplift Design Load =  $51.00(95.41) = 4882.6 \text{ lbs}$   
 Uplift Moment =  $4882.6(63.375)/2 = 129369 \text{ in-lb}$

**For connection of 16 ga. (min) straps, clips, or brackets spaced 30" min apart to unit base rails on long sides using 1/4" (#14) self-drilling screws:**

Pullout Strength in 16 ga. = 573 lbs (ultimate)  
 Shear Strength in 16 ga. = 1389 lbs (ultimate)

Using 4 screws per strap, clip, or bracket, with 4 straps, clips, or brackets each long side (see sheet 4):  
 Screw Load =  $(261159 + 129369)/4(4)(63.375) = 385.1 \text{ lbs (shear) at base rail outer surface}$   
 Safety Factor =  $1389/385.1 = 3.6 \text{ OK for Components and Cladding}$

**For 4-Z-Brackets each long side similar to Micromet design but modified to eliminate hidden structural fasteners (see sheets 2 and 3) anchored to 18 ga. (min) curb (by others):**


Shear Strength in 18 ga. = 1218 lbs (ultimate)

Screw Load =  $(261159 + 129369)/4(4)(53.81) = 453.6 \text{ lbs (shear) at curb inside surface}$   
 Safety Factor =  $1218/453.6 = 2.7 \text{ OK for Components and Cladding}$

**For quantity 8 angle clips 1" wide x 6" x 1-1/2" x 125" (min) thick each long side in clusters of 2 spaced 30" (min) on center:**  
 Anchor Load =  $(261159 + 129369)/8(64.125) = 761.3 \text{ lbs (tension)}$   
 Anchor Load =  $9103.6/16 = 569.0 \text{ lbs (shear) at 3/4" beyond base rail outer surface}$

**For 3/8" SAE Gr. 5 bolts with nuts and washers to steel (by others),**  
 Safety Factor =  $3720/761.3 = 4.9 \text{ (tension) OK}$   
 Safety Factor =  $1937/569.0 = 3.4 \text{ (shear) OK}$

**For 3/8" Powers Wedge-Bolt + anchors with 2-1/8" (min) embedment into 2000 psi (min) concrete (by others), 4" (min) thick, 2-3/4" (min) edge distance, and 2-1/2" (min) spacing:**  
 Safety Factor =  $3000/761.3 = 3.9 \text{ (tension) OK}$   
 Safety Factor =  $3100/569.0 = 5.4 \text{ (shear) OK}$

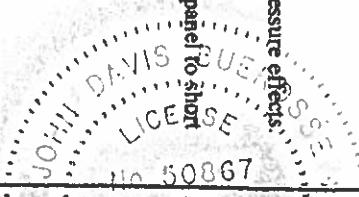

**John Buerosse, P.E., P.A.**  
 Structural and Mechanical Engineering  
 750 E. Sample Road - Bldg. 3 - #220  
 Pompano Beach, FL 33064  
 Tel: 954-633-4692 Fax: 954-784-004

<b>S2</b>	Job No. Chassis 5	Job No.: Bryant Rooftop Units
	Date: 01/11/21	Title: Model List and Details
	Created by: J. Buerosse	