

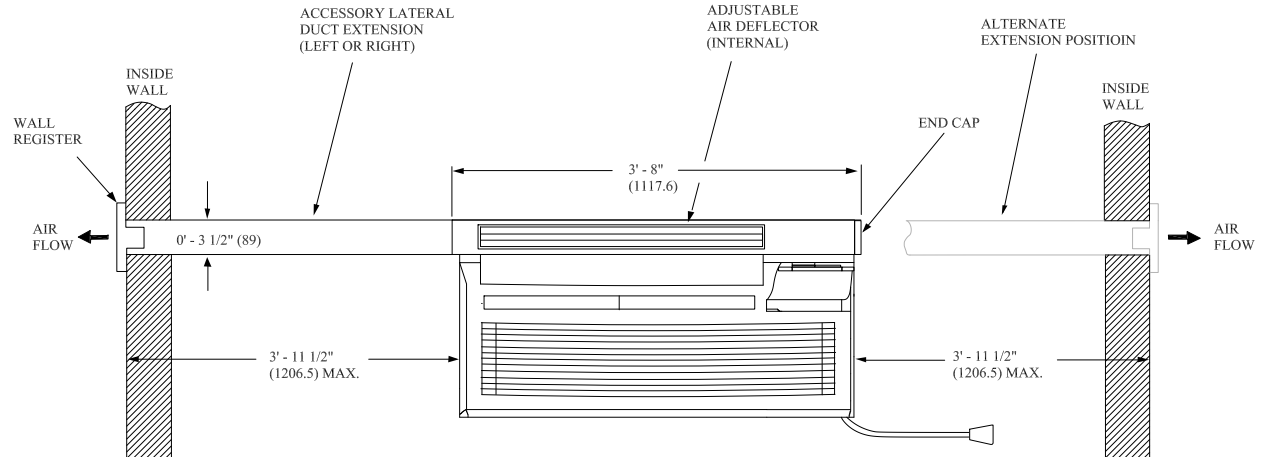
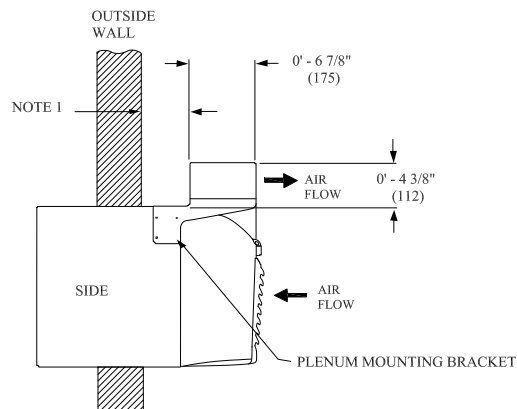


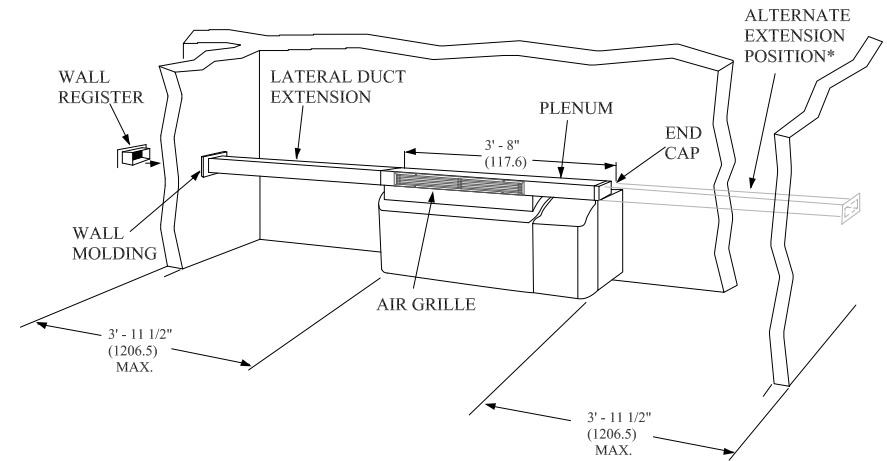


PROVEN PRODUCTS FOR THE HVAC INDUSTRY



NOTES:

- 1) For all lateral duct applications, the wall sleeve must extend 3-inches into the room for proper mounting of support brackets.
- 2) Maximum duct extension length is 47.5 inches.
- 3) Extension duct run must be straight and horizontal; no bends or turns.
- 4) Minimum recommended clearance between unit and adjoining room wall is 6 inches.
- 5) Provisions must be made for return air from the adjoining room.

DRAWING RELEASE LEVEL:		First America Products, LLC					
THIRD ANGLE PROJECTION		UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN MILLIMETERS TOLERANCES ON:				THIS DOCUMENT AND THE INFORMATION CONTAINED THEREIN IS PROPRIETARY TO FIRST AMERICA PRODUCTS, LLC AND SHALL NOT BE USED OR DISCLOSED TO OTHERS, IN WHOLE OR IN PART, WITHOUT THE WRITTEN AUTHORIZATION OF FIRST AMERICA PRODUCTS, LLC.	
MATERIAL		0 DEC	1 DEC	2 DEC	ANG		
		±1.0	±0.8	±0.25	±1.0°		
WEIGHT:	SURFACE FINISH	ENGINEERING		MANUFACTURING		TITLE DIMENSIONAL DRAWING LATERAL DUCT	
		DRAFTER		CHECKER			
		MODEL (INTERNAL USE ONLY)		NEXT DRAWING		SCALE	DISTRIBUTION
				DRAWING NUMBER		REV	
				FAP402884-CD			
				SHEET 1 OF 1			

LATERAL DUCT CERTIFIED DRAWING